

CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE)

Results Report – Nonresidential Outdoor Lighting Power Allowance

Measure Number: 2016-NR-LTG3-F

Nonresidential Lighting

2016 CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS

California Utilities Statewide Codes and Standards Team

September 2015

Prepared by: Michael Mutmanský (TRC Energy Services)

With technical support from Darcie Chinnis (Clanton & Associates, Inc.)



This report was prepared by the California Statewide Codes and Standards Enhancement (CASE) Program that is funded, in part, by California utility customers under the auspices of the California Public Utilities Commission.

Copyright 2015 Pacific Gas and Electric Company, Southern California Edison, Southern California Gas Company, San Diego Gas & Electric Company, Los Angeles Department of Water and Power.

All rights reserved, except that this document may be used, copied, and distributed without modification.

Neither Pacific Gas and Electric Company, Southern California Edison, San Diego Gas & Electric Company, Southern California Gas Company, Los Angeles Department of Water and Power nor any of its employees makes any warranty, express or implied; or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any data, information, method, product, policy or process disclosed in this document; or represents that its use will not infringe any privately-owned rights including, but not limited to, patents, trademarks or copyrights.

TABLE OF CONTENTS

1. Preface.....	1
2. Executive Summary	1
2.1 Measure Description	1
2.2 Summary of Revisions that Occurred during CEC Pre-rulemaking and Rulemaking...	2
2.3 Energy Savings.....	2
3. Evolution of Requirements.....	2
3.1 Changes to Table 140.7-A (General Hardscape allowance table)	3
3.2 Changes to Table 140.7-B (Specific Applications allowance table).....	3
4. Adopted Standards	4
4.1 Building Energy Efficiency Standards Code Language.....	5
4.2 Reference Appendices Code Language.....	10
4.3 Compliance Manual	10
5. Final Cost-effectiveness Results.....	11
5.1 Energy Savings Estimates	11
5.2 Final Cost-effectiveness Estimates.....	11
6. Acknowledgments	12
Appendix A: Docketed Version of CASE Report	13
Appendix B: Docketed Comments Log.....	14
Appendix C: Revisions to Cost-Effectiveness and Statewide Impacts Calculations compared to Draft Version of CASE Report	16
6.1 Draft CASE Report Energy Savings Estimates	16
6.2 Draft CASE Report Cost-effectiveness Estimates	16
6.3 Changes from the Draft Version to the Final Version	17

Document Information

Category: Codes and Standards

Keywords: Statewide Codes and Standards Team, Statewide CASE Team, Codes and Standards Enhancements, Title 24, 2016, efficiency, outdoor lighting, lighting power allowance, LPA, LED.

1. PREFACE

The Codes and Standards Enhancement (CASE) initiative presents recommendations to support California Energy Commission's (CEC) efforts to update California's Building Energy Efficiency Standards (Title 24) to include new requirements or to upgrade existing requirements for various technologies. The four California Investor Owned Utilities (IOUs) – Pacific Gas and Electric Company (PG&E), San Diego Gas and Electric (SDG&E), Southern California Edison (SCE) and Southern California Gas Company (SoCalGas) – and Los Angeles Department of Water and Power (LADWP) sponsored this effort. The program goal is to prepare and submit proposals that will result in cost-effective enhancements to energy efficiency in buildings. This report and the code change proposal presented herein is a part of the effort to develop technical and cost-effectiveness information for proposed regulations on building energy efficient design practices and technologies. Portions of the code change proposals presented in this report are now included in the 2016 Building Energy Efficiency Standards.

2. EXECUTIVE SUMMARY

2.1 Measure Description

The Outdoor Lighting Power Allowance (LPA) values in Title 24 are subject to change as new technologies (in particular, light source technologies that increase lamp efficacy) become available to the market. As a result, the LPA values have continued to slowly move downward over time in response to these technological advancements, most recently for Pulse-Start Metal Halide (PSMH) technology.

Light Emitting Diode (LED) light source technology is advancing rapidly, and the raw lamp efficacy of LED light sources are rapidly improving beyond that of both PSMH (the current baseline standard), and High Pressure Sodium (HPS) light sources. As a result, LED is rapidly claiming a large portion of the exterior lighting market, and the market adoption of LED is anticipated to accelerate as the cost of LED products continues to decrease.

This measure intends to replace PSMH light sources with LED as the basis for the calculation of Lighting Power Allowances (LPA) for all exterior applications where it is technically feasible to do so.

This proposal results in modifications to Sections 10-114, 140.6, and 140.7 of the Title 24 Building Energy Efficiency Standards. The proposal did not result in changes to the Reference Appendices. CEC adopted the 2016 Standards and Reference Appendices on June 10, 2015.

The compliance manuals and compliance forms will be updated to reflect the changes to the standards. This change does not require changes to the Alternative Calculation Manual (ACM) Reference Manuals or the compliance software.

2.2 Summary of Revisions that Occurred during CEC Pre-rulemaking and Rulemaking

The Statewide CASE Team solicited feedback from a variety of stakeholders when developing the version of the CASE Report that CEC used as a “document relied upon” in their rulemaking package (see Appendix A). In addition to personal outreach to key stakeholders, the Statewide CASE Team conducted a public stakeholder meeting to discuss the proposal on May 15, 2014. Feedback that stakeholders provided during the utility-sponsored stakeholder meeting is summarized in Section 2.4 of the report presented in Appendix A.

There are two changes that were made between the preliminary CASE Report and the adopted 2016 standards language. These changes are a modification to the values and details in Table 140.7-A (the General Hardscape allowances table) and the elimination of most proposed changes to the values in Table 140.7-B (the Specific Applications allowances table).

These changes were predicated primarily on feedback from CEC and did not arise due to comments from stakeholder feedback documents. The Statewide CASE Team supports the changes to Table 140.7-A, but does not agree with the decision by CEC to disregard the recommended changes to Table 140.7-B.

See Section 3 for additional information about changes that occurred during CEC’s pre-rulemaking and rulemaking process.

2.3 Energy Savings

The first year statewide impacts of this code proposal are 28 gigawatt-hours per year and 0 megawatts of electrical demand. These loads have a primarily nighttime profile, and all demand reduction is anticipated to take place after peak demand periods. The methodology used to estimate energy savings is described in detail in Section 5.

Table 1: First year statewide energy impacts estimate

	First Year Statewide Savings			TDV Dollar Savings (\$ Millions)
	Electricity Savings (GWh)	Power Demand Reduction (MW)	Natural Gas Savings (MMtherms)	
TOTAL	28	N/A	N/A	46

3. EVOLUTION OF REQUIREMENTS

The Statewide CASE Team solicited feedback from a variety of stakeholders when developing the version of the CASE Report that is presented in Appendix A. In addition to personal outreach to key stakeholders, the Statewide CASE Team conducted a public stakeholder meeting to discuss the proposal on May 15, 2014. Section 2.4 of the report presented in Appendix A summarizes issues that were addressed between the time the Statewide CASE Team commenced work on the project and the time the CASE Report was submitted to CEC. The following paragraphs summarize how the code change proposals evolved between the time the most recent version of the CASE Report was submitted to CEC and the time the standards

were adopted. See Appendix B for a list of comments that were submitted to CEC throughout the pre-rulemaking and rulemaking process that are relevant to this measure.

3.1 Changes to Table 140.7-A (General Hardscape allowance table)

The initial calculations in the preliminary CASE Report for the General Hardscape table were based on the then-current 1998 version of the Illuminating Engineering Society (IES) Recommended Practice for Parking Lot Lighting document (RP-20-98), with the majority of the calculations being made in the summer of 2014. A new version of RP-20 was released in winter of 2014, with changes to both the design criteria and the methods of calculations that impact the lighting energy consumption in parking lots, and therefore the General Hardscape Table 140.7-A.

As a result, new calculations were developed to make modifications to Table 140.7-A. These calculations were performed by the Statewide CASE Team with assistance from Jim Benya to develop the final recommendations for the Table 140.7-A. A specific new allowance was proposed to replace the allowance values for lighting zones 2 and 3 when more than 50% of the total surface area of a parking lot is paved with concrete. This condition is anticipated to occur in 10% of the state parking square footage. Therefore, the statewide impact values have been adjusted downward for this impact on an area-weighted basis.

3.2 Changes to Table 140.7-B (Specific Applications allowance table)

The initial calculations in the preliminary version of the CASE Report indicated that some of the individual lines within the specific applications table did not appear to be cost-effective in the substitution from an incumbent light source technology to LED technology.

This had to do primarily with a detail in the calculation approach that was penalizing the LED calculations and causing a penalty for the LED lighting systems in two manners. The wattage was increased, which caused the cost of the LED system to be calculated higher than absolutely necessary to achieve equivalent lumen output. The model for comparison between LED and the incumbent light source technology was done on a 'cost per watt' basis to make comparisons among multiple products of a variety of configurations and outputs valid in a scaled equivalent output basis.

However, because the wattage was increased, the energy savings compared to the incumbent system was reduced. This double penalty of higher cost and lower energy savings resulted in substantially lower benefit to cost ratio values for each individual line item, but the combined measure savings for the state to switch over to LED was demonstrated to be strongly cost-effective.

This approach (establishing higher wattage LED allowances, yielding higher initial cost and lower energy savings) is predicated on the concern that the radical reductions that the LED lighting systems can produce is too great of a reduction in the allowance tables (some of the reductions calculated to be in the 75% range) to recommend in a single code change revision cycle. The Statewide CASE Team listened to stakeholders and the general design community early in the measure development process and determined that the best way to codify this

radical change to the lighting industry was to propose that the reductions be done over two code cycle changes.

The Statewide CASE Team explained this approach to CEC and provided new calculations to show the actual lumen equivalency cost-effectiveness. The Statewide CASE Team suggested that CEC consider changing the table to a true lumen equivalent allowance table if they preferred to have each individual line item in the tables show cost-effectiveness. However, at that point, CEC determined there was not sufficient time to accommodate the changes and removed all reductions from Table 140.7-B except for the reductions associated with the Building Entries line item, which did show cost-effectiveness even at the higher allowance values.

The Statewide CASE Team strongly disagrees with this decision and believes that the removal of the recommended reduced values in the table reflects a missed opportunity to strategically implement LED lighting technology realities into the code. The lighting industry is implementing these products as cost-effectiveness of the products improves, and by the final date of the enactment of the 2016 Title 24 Standards (expected to be January 2017), most aspects of exterior lighting will have moved in that direction. CEC would have been able to get ahead of the move toward LED and have reasonable allowance in place to ensure that LED lighting is not implemented in a manner that causes overlighting, even while meeting the existing allowance values (which now predominately carry over until 2019 and require deeper revisions at that time).

4. ADOPTED STANDARDS

The adopted 15-Day Language and Reference Appendices are presented in the following sections. Additions released in the 45-Day Language Express Terms are underlined and deletions are struck with lines. Revisions included in the 15-Day Language are in red font and are double underlined if the language was added or struck with double lines if the language was deleted.

4.1 Building Energy Efficiency Standards Code Language

4.1.1 Table 10-114 – Lighting Zone Characteristics for Amendments by Local Jurisdictions

TABLE 10-114-A LIGHTING ZONE CHARACTERISTICS AND RULES FOR AMENDMENTS BY LOCAL JURISDICTIONS

Zone	Ambient Illumination	State wide Default Location	Moving Up to Higher Zones	Moving Down to Lower Zones
<u>LZ0</u>	<u>Very Low</u>	<u>Undeveloped areas of government designated parks, recreation areas, and wildlife preserves.</u>	<u>Undeveloped portions of government designated park, recreation area, wildlife preserve, can be designated as LZ1 or LZ2 if they are contained within a higher zone.</u>	<u>Not applicable.</u>
LZ1	<u>Dark Low</u>	<u>Developed portions of government designated parks, recreation areas, and wildlife preserves. Those that are wholly contained within a higher lighting zone may be considered by the local government as part of that lighting zone.</u>	<u>Developed portions of a government designated park, recreation area, wildlife preserve, or portions thereof, can be designated as LZ2 or LZ3 if they are contained within such a zone.</u>	Not applicable.
LZ2	<u>Low Moderate</u>	Rural areas, as defined by the 2010 U.S. Census.	Special districts within a default LZ2 zone may be designated as LZ3 or LZ4 by a local jurisdiction. Examples include special commercial districts or areas with special security considerations located within a rural area.	Special districts and government designated parks within a default LZ2 zone may be designated as LZ1 by the local jurisdiction for lower illumination standards, without any size limits.
LZ3	<u>Medium Moderately High</u>	Urban areas, as defined by the 2010 U.S. Census.	Special districts within a default LZ3 may be designated as a LZ4 by local jurisdiction for high intensity nighttime use, such as entertainment or commercial districts or areas with special security considerations requiring very high light levels.	Special districts and government designated parks within a default LZ3 zone may be designated as LZ1 or LZ2 by the local jurisdiction, without any size limits.
LZ4	High	None.	Not applicable.	Not applicable.

4.1.2 Table 130.2-B – Glare Ratings

TABLE 130.2-A Uplight Ratings (Maximum Zonal Lumens)

Secondary Solid Angle	Maximum Zonal Lumens per Outdoor Lighting Zone				
	<u>LZ0</u>	<u>QLZ 1</u>	<u>QLZ 2</u>	<u>QLZ 3</u>	<u>QLZ 4</u>
Uplight High (UH) 100 to 180 degrees	<u>0</u>	10	50	500	1,000
Uplight Low (UL) 90 to <100 degrees	<u>0</u>	10	50	500	1,000

TABLE 130.2-B Glare Ratings (Maximum Zonal Lumens)

Glare Rating for Asymmetrical Luminaire Types (Type I, Type II, Type III, Type IV)					
Secondary Solid Angle	Maximum Zonal Lumens per Outdoor Lighting Zone				
	<u>LZ 0</u>	<u>QLZ 1</u>	<u>QLZ 2</u>	<u>QLZ 3</u>	<u>QLZ 4</u>
Forward Very High (FVH) 80 to 90 degrees	<u>10</u>	100	225	500	750
Backlight Very High (BVH) 80 to 90 degrees	<u>10</u>	100	225	500	750
Forward High (FH) 60 to <80 degrees	<u>660</u>	1,800	5,000	7,500	12,000
Backlight High (BH) 60 to <80 degrees	<u>110</u>	500	1,000	2,500	5,000
Glare Rating for Quadrilateral Symmetrical Luminaire Types (Type V, Type V Square)					
Secondary Solid Angle	Maximum Zonal Lumens per Outdoor Lighting Zone				
	<u>LZ 0</u>	<u>QLZ 1</u>	<u>QLZ 2</u>	<u>QLZ 3</u>	<u>QLZ 4</u>
Forward Very High (FVH) 80 to 90 degrees	<u>10</u>	100	225	500	750
Backlight Very High (BVH) 80 to 90 degrees	<u>10</u>	100	225	500	750
Forward High (FH) 60 to <80 degrees	<u>660</u>	1,800	5,000	7,500	12,000
Backlight High (BH) 60 to <80 degrees	<u>660</u>	1,800	5,000	7,500	12,000

4.1.3 Section 140.7 – Requirements for Outdoor Lighting

- (a) An outdoor lighting installation complies with this section if it meets the requirements in Subsections (b) and (c), and the actual outdoor lighting power installed is no greater than the allowed outdoor lighting power calculated under Subsection (d). The allowed outdoor lighting shall be calculated according to Outdoor Lighting Zone in Title 24, Part 1, Section 10-114.

EXCEPTIONS to Section 140.7(a): When more than 50 percent of the light from a luminaire falls within one or more of the following applications, the lighting power for that luminaire shall be exempt from Section 140.7:

1. Temporary outdoor lighting.
2. Lighting required and regulated by the Federal Aviation Administration, and the Coast Guard.
3. Lighting for public streets, roadways, highways, and traffic signage lighting, including lighting for driveway entrances occurring in the public right-of-way.
4. Lighting for sports and athletic fields, and children's playgrounds.
5. Lighting for industrial sites, including but not limited to, rail yards, maritime shipyards and docks, piers and marinas, chemical and petroleum processing plants, and aviation facilities.
- ~~6. Lighting specifically for Automated Teller Machines as required by California Financial Code Section 13040, or required by law through a local ordinance.~~
- ~~7. Lighting of public monuments.~~
- ~~8. Lighting of signs complying with the requirements of Sections 130.3 and 140.8.~~
- ~~9. Lighting of tunnels, bridges, stairs, wheelchair elevator lifts for American with Disabilities Act (ADA) compliance, and ramps that are other than parking garage ramps.~~
- ~~10. Landscape lighting.~~
- ~~11. In theme parks: outdoor lighting only for themes and special effects.~~
- ~~12. Lighting for outdoor theatrical and other outdoor live performances, provided that these lighting systems are additions to area lighting systems and are controlled by a multiscene or theatrical cross-fade control station accessible only to authorized operators.~~
- ~~13. Outdoor lighting systems for qualified historic buildings, as defined in the California Historic Building Code (Title 24, Part 8), if they consist solely of historic lighting components or replicas of historic lighting components. If lighting systems for qualified historic buildings contain some historic lighting components or replicas of historic components, combined with other lighting components, only those historic or historic replica components are exempt. All other outdoor lighting systems for qualified historic buildings shall comply with Section 140.7.~~

4.1.4 Table 140.7-A – General Hardscape Lighting Allowances

TABLE 140.7-A GENERAL HARDSCAPE LIGHTING POWER ALLOWANCE

Type of Power Allowance	Lighting Zone 0	Lighting Zone 1	Lighting Zone 2 ²	Lighting Zone 3 ²	Lighting Zone 4
Area Wattage Allowance (AWA)	No allowance ¹	0.0350_020 W/ft ²	0.0450_030 W/ft ²	0.0900_040 W/ft ²	0.1150_050 W/ft ²
Linear Wattage Allowance (LWA)		0.250_15 W/lf	0.450_25 W/lf	0.600_35 W/lf	0.850_45 W/lf
Initial Wattage Allowance (IWA)		340 W	540_450 W	770_520 W	1030_640 W

¹Continuous lighting is explicitly prohibited in Lighting Zone 0. A single luminaire of 15 Watts or less may be installed at an entrance to a parking area, trail head, fee payment kiosk, outhouse, or toilet facility, as required to provide safe navigation of the site infrastructure. Luminaires installed in Lighting Zone 0 shall meet the maximum zonal lumen limits for Uplight and Glare specified in Table 130.2-A and 130.2-B.

²For Lighting Zone 2 and 3, where greater than 50% of the paved surface of a parking lot is finished with concrete, the AWA for that area shall be 0.035 W/ft² for Lighting Zone 2 and 0.040 W/ft² for Lighting Zone 3, and the LWA for both lighting zones shall be 0.70 W/lf. This does not extend beyond the parking lot, and does not include any other General Hardscape areas.

4.1.5 Table 140.7-B Additional Lighting Power Allowances for Specific Applications

TABLE 140.7-B ADDITIONAL LIGHTING POWER ALLOWANCE FOR SPECIFIC APPLICATIONS
All area and distance measurements in plan view unless otherwise noted.

Lighting Application	Lighting Zone 0	Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4
WATTAGE ALLOWANCE PER APPLICATION. Use all that apply as appropriate.					
Building Entrances or Exits. Allowance per door. Luminaires qualifying for this allowance shall be within 20 feet of the door.	<u>Not applicable</u>	30-15 watts	60-25 watts	90-35 watts	90-45 watts
Primary Entrances to Senior Care Facilities, Police Stations, Hospitals, Fire Stations, and Emergency Vehicle Facilities. Allowance per primary entrance(s) only. Primary entrances shall provide access for the general public and shall not be used exclusively for staff or service personnel. This allowance shall be in addition to the building entrance or exit allowance above. Luminaires qualifying for this allowance shall be within 100 feet of the primary entrance.	<u>Not applicable</u>	45 watts	80 watts	120 watts	130 watts
Drive Up Windows. Allowance per customer service location. Luminaires qualifying for this allowance shall be within 2 mounting heights of the sill of the window.	<u>Not applicable</u>	40 watts	75 watts	125 watts	200 watts
Vehicle Service Station Uncovered Fuel Dispenser. Allowance per fueling dispenser. Luminaires qualifying for this allowance shall be within 2 mounting heights of the dispenser.	<u>Not applicable</u>	120 watts	175 watts	185 watts	330 watts
ATM Machine Lighting. Allowance per ATM machine. Luminaires qualifying for this allowance shall be within 50 feet of the dispenser.	<u>Not applicable</u>	<u>250 watts for first ATM machine, 70 watts for each additional ATM machine.</u>			
WATTAGE ALLOWANCE PER UNIT LENGTH (w/linear ft). May be used for one or two frontage side(s) per site.					
Outdoor Sales Frontage. Allowance for frontage immediately adjacent to the principal viewing location(s) and unobstructed for its viewing length. A corner sales lot may include two adjacent sides provided that a different principal viewing location exists for each side. Luminaires qualifying for this allowance shall be located between the principal viewing location and the frontage outdoor sales area.	<u>Not applicable</u>	No Allowance	22.5 W/linear ft	36 W/linear ft	45 W/linear ft
WATTAGE ALLOWANCE PER HARDSCAPE AREA (W/ft²). May be used for any illuminated hardscape area on the site.					
Hardscape Ornamental Lighting. Allowance for the total site illuminated hardscape area. Luminaires qualifying for this allowance shall be rated for 100 watts or less as determined in accordance with Section 130.0(d), and shall be post-top luminaires, lanterns, pendant luminaires, or chandeliers.	<u>Not applicable</u>	No Allowance	0.02 W/ft ²	0.04 W/ft ²	0.06 W/ft ²
WATTAGE ALLOWANCE PER SPECIFIC AREA (W/ft²). Use as appropriate provided that none of the following specific applications shall be used for the same area.					
Building Facades. Only areas of building façade that are illuminated shall qualify for this allowance. Luminaires qualifying for this allowance shall be aimed at the façade and shall be capable of illuminating it without obstruction or interference by permanent building features or other objects.	<u>Not applicable</u>	No Allowance	0.18 W/ft ²	0.35 W/ft ²	0.50 W/ft ²
Outdoor Sales Lots. Allowance for uncovered sales lots used exclusively for the display of vehicles or other merchandise for sale. Driveways, parking lots or other non sales areas shall be considered hardscape areas even if these areas are completely surrounded by sales lot on all sides. Luminaires qualifying for this allowance shall be within 5 mounting heights of the sales lot area.	<u>Not applicable</u>	0.164 W/ft ²	0.555 W/ft ²	0.758 W/ft ²	1.285 W/ft ²
Vehicle Service Station Hardscape. Allowance for the total illuminated hardscape area less area of buildings, under canopies, off property, or obstructed by signs or structures. Luminaires qualifying for this allowance shall be illuminating the hardscape area and shall not be within a building, below a canopy, beyond property lines, or obstructed by a sign or other structure.	<u>Not applicable</u>	0.014 W/ft ²	0.155 W/ft ²	0.308 W/ft ²	0.485 W/ft ²
Vehicle Service Station Canopies. Allowance for the total area within the drip line of the canopy. Luminaires qualifying for this allowance shall be located under the canopy.	<u>Not applicable</u>	0.514 W/ft ²	1.005 W/ft ²	1.300 W/ft ²	2.200 W/ft ²
Sales Canopies. Allowance for the total area within the drip line of the canopy. Luminaires qualifying for this allowance shall be located under the canopy.	<u>Not applicable</u>	No Allowance	0.655 W/ft ²	0.908 W/ft ²	1.135 W/ft ²
Non-sales Canopies <u>and Tunnels</u> . Allowance for the total area within the drip line of the canopy <u>or inside the tunnel</u> . Luminaires qualifying for this allowance shall be located under the canopy <u>or tunnel</u> .	<u>Not applicable</u>	0.084 W/ft ²	0.205 W/ft ²	0.408 W/ft ²	0.585 W/ft ²

Guard Stations. Allowance up to 1,000 square feet per vehicle lane. Guard stations provide access to secure areas controlled by security personnel who stop and may inspect vehicles and vehicle occupants, including identification, documentation, vehicle license plates, and vehicle contents. Qualifying luminaires shall be within 2 mounting heights of a vehicle lane or the guardhouse.	Not applicable	0.154 W/ft ²	0.355 W/ft ²	0.708 W/ft ²	0.985 W/ft ²
--	----------------	-------------------------	-------------------------	-------------------------	-------------------------

CONTINUED: TABLE 140.7-B ADDITIONAL LIGHTING POWER ALLOWANCE FOR SPECIFIC APPLICATIONS

All area and distance measurements in plan view unless otherwise noted.

Lighting Application	Lighting Zone 0	Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4
Student Pick-up/Drop-off zone. Allowance for the area of the student pick-up/drop-off zone, with or without canopy, for preschool through 12th grade school campuses. A student pick-up/drop off zone is a curbside, controlled traffic area on a school campus where students are picked-up and dropped off from vehicles. The allowed area shall be the smaller of the actual width or 25 feet, times the smaller of the actual length or 250 feet. Qualifying luminaires shall be within 2 mounting heights of the student pick-up/drop-off zone.	Not applicable	No Allowance	0.12 W/ft ²	0.45 W/ft ²	No Allowance
Outdoor Dining. Allowance for the total illuminated hardscape of outdoor dining. Outdoor dining areas are hardscape areas used to serve and consume food and beverages. Qualifying luminaires shall be within 2 mounting heights of the hardscape area of outdoor dining.	Not applicable	0.014 W/ft ²	0.135 W/ft ²	0.240 W/ft ²	0.400 W/ft ²
Special Security Lighting for Retail Parking and Pedestrian Hardscape. This additional allowance is for illuminated retail parking and pedestrian hardscape identified as having special security needs. This allowance shall be in addition to the building entrance or exit allowance.	Not applicable	0.007 W/ft ²	0.009 W/ft ²	0.019 W/ft ²	No Allowance

4.2 Reference Appendices Code Language

The Statewide CASE Team did not propose changes to the Reference Appendices for the nonresidential outdoor lighting controls standards.

4.3 Compliance Manual

In May of 2015, the Statewide CASE Team provided CEC with proposed revisions to the Nonresidential Compliance Manual to describe how to comply with the code change outlined in this CASE Report. The revisions that the Statewide CASE Team provided served as the first draft of CEC’s revisions to the Compliance Manual. At the time of writing CEC has released a version of the Compliance Manual for public review. The Compliance Manuals are scheduled to be approved during the November 2015 CEC Business Meeting. The Statewide CASE Team recommended revisions to the following sections of the Compliance Manual:

- Chapter 6 – Section 6.1.1 Mandatory Changes
- Chapter 6 – Section 6.2.1 History and Background
- Chapter 6 – Section 6.2.2 Scope and Application
- Chapter 6 – Section 6.3.1 Minimum Luminaire Control
- Chapter 6 – Section 6.3.2 Luminaire Cutoff Zonal Lumen Limits
- Chapter 6 – Section 6.3.3 Controls for Outdoor Lighting

- Chapter 6 – Section 6.4.1 Lighting Zones
- Chapter 6 – Section 6.4.6 General Hardscape Lighting Power Allowance
- Chapter 6 – Section 6.4.7 Additional Light Power Allowance by Applications

5. FINAL COST-EFFECTIVENESS RESULTS

5.1 Energy Savings Estimates

Statewide impacts from this measure are presented in Table 2.

The savings estimates have changed because of the changes made by CEC as part of the revisions to Tables 140.7-A and 140.7-B. This has reduced the statewide savings prediction by approximately 36%, from 44 GWh to 28 GWh. See Appendix C for an explanation of the changes to the savings estimates.

Table 2: Estimated first year energy savings

	First Year Statewide Savings			TDV Dollar Savings (\$ Millions)
	Electricity Savings (GWh)	Power Demand Reduction (MW)	Natural Gas Savings (MMtherms)	
TOTAL	28	N/A	N/A	46

5.2 Final Cost-effectiveness Estimates

As shown in Table 3, the code change is cost-effective. The cost-effectiveness estimates have changed since submitting the CASE Report to CEC in December 2014, but the portions of the measure that have remained since the preliminary report are largely unchanged. The calculations shown include only those portions that are remaining after the changes associated with CEC discussions in the winter and spring of 2015.

Note that the cost-effectiveness reflects a negative benefit to cost ratio, which is indicative of a measure that is instantaneously cost-effective, because it has lower initial costs in many cases due to increased efficiencies in the geometry of LED parking lot lighting systems.

The latest version of the CASE Report is included, in its entirety in Appendix A of this report.

Table 3: Cost-effectiveness summary¹

Climate Zone	Units	Benefit: TDV Energy Cost Savings ² (2017 PV\$)	Cost: Total Incremental Cost ³ (2017 PV\$)	Change in Lifecycle Cost ⁴ (2017 PV\$)	Benefit to Cost Ratio ⁵
Outdoor Lighting LPA (Entire Measure)	Per Square Foot	0.27	-0.15	-0.42	-1.7

1. Relative to existing conditions. All cost values presented in 2017 dollars.
2. Present value of TDV cost savings equals TDV electricity savings plus TDV natural gas savings; $\Delta\text{TDV}\$ = \Delta\text{TDV}\$\text{E} + \Delta\text{TDV}\G .
3. Total incremental cost equals incremental construction cost (post adoption) plus present value of incremental maintenance cost; $\Delta\text{C} = \Delta\text{CI}_{\text{PA}} + \Delta\text{CM}$.
4. Negative values indicate the measure is cost-effective. Change in lifecycle cost equals cost premium minus TDV energy cost savings; $\Delta\text{LCC} = \Delta\text{C} - \Delta\text{TDV}\$$
5. The Benefit-to-Cost Ratio is the TDV energy costs savings divided by the total incremental costs; $\text{B/C} = \Delta\text{TDV}\$ \div \Delta\text{C}$. The measure is cost-effective if the B/C ratio is greater than 1.0.

6. ACKNOWLEDGMENTS

The Pacific Gas and Electric Company, Southern California Edison, Southern California Gas Company, San Diego Gas and Electric Company and Los Angeles Department of Water and Power sponsored this report as part of the CASE (Codes and Standards Enhancement) project for the 2016 Building Energy Efficiency Standards. Stuart Tartaglia of PG&E was the project manager for the 2016 Building Standards Advocacy Project on behalf of the utility team. Patrick Eilert is the program manager for the PG&E's CASE program; Stu Tartaglia, Marshall Hunt and Jon McHugh (McHugh Energy) supported this measure on behalf of PG&E. Randall Higa and Ishtiaq Chisti were the CASE program managers for SCE; Chris Kuch supported this measure on behalf of SCE. Sue Kristjansson, Martha Garcia, Dipu Olatunji and Phil Pratt were SoCalGas's CASE program managers; Lovell Willmore supported this measure on behalf of SoCalGas. Chip Fox was SDG&E's CASE program manager; Adrian Salas and John Barbour supported this measure on behalf of SDG&E. Jim Kemper was the CASE program manager on behalf of LADWP.

Energy Solutions is the prime contractors and provided coordination for all CASE Reports. Michael Mutmansky of TRC Energy Services, Inc. and Darcie Chinnis of Clanton & Associates, Inc. performed the analysis and reporting presented here. Energy Solutions provided technical and editorial review.

We would like to thank the many reviewers that volunteered their time and effort to improving this proposal. We would particularly like to thank Mazi Shirakh and Simon Lee of CEC, Jim Benya of Benya Burnett Consultancy for valuable feedback on the evolving standards in the new IES RP-20 Document, and Cheryl English of Acuity Brands for discussion and feedback on the evolution of LED lighting technology and market readiness.

APPENDIX A: DOCKETED VERSION OF CASE REPORT

CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE)

Nonresidential Outdoor Lighting Power Allowance

Measure Number: 2016-NR-LTG3-F

Nonresidential Lighting

2016 CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS

California Utilities Statewide Codes and Standards Team

December 2014

Prepared by: Michael Mutmansky (TRC Energy Services)

With technical support from Darcie Chinnis (Clanton & Associates, Inc.)



This report was prepared by the California Statewide Utility Codes and Standards Program and funded by the California utility customers under the auspices of the California Public Utilities Commission.

Copyright 2014 Pacific Gas and Electric Company, Southern California Edison, Southern California Gas Company, San Diego Gas & Electric Company, Los Angeles Department of Water and Power.

All rights reserved, except that this document may be used, copied, and distributed without modification.

Neither PG&E, SCE, SDG&E, SoCalGas, LADWP nor any of its employees makes any warranty, express or implied; or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any data, information, method, product, policy or process disclosed in this document; or represents that its use will not infringe any privately-owned rights including, but not limited to, patents, trademarks or copyrights.

TABLE OF CONTENTS

Executive Summary	xi
1. Introduction	1
2. Measure Description	2
2.1 Measure Overview	2
2.1.1 Measure Description	2
2.1.2 Measure History	3
2.1.3 Existing Standards.....	4
2.1.4 Alignment with Zero Net Energy Goals	4
2.1.5 Relationship to Other Title 24 Measures	5
2.2 Summary of Changes to Code Documents	5
2.2.1 Catalogue of Proposed Changes	5
2.2.2 Standards Change Summary	6
2.2.3 Standards Reference Appendices Change Summary	6
2.2.4 Nonresidential Alternative Calculation Method (ACM) Reference Manual Change Summary	6
2.2.5 Compliance Forms Change Summary	7
2.2.6 Simulation Engine Adaptations	7
2.2.7 Other Areas Affected	7
2.3 Code Implementation	7
2.3.1 Verifying Code Compliance	7
2.3.2 Code Implementation.....	7
2.3.3 Acceptance Testing	7
2.4 Issues Addressed During CASE Development Process	7
3. Market Analysis.....	8
3.1 Market Structure	9
3.2 Market Availability and Current Practices.....	9
3.3 Useful Life, Persistence, and Maintenance	9
3.4 Market Impacts and Economic Assessments.....	10
3.4.1 Impact on Builders	10
3.4.2 Impact on Building Designers.....	10
3.4.3 Impact on Occupational Safety and Health.....	10
3.4.4 Impact on Building Owners and Occupants	10

3.4.5	Impact on Retailers (including manufacturers and distributors).....	10
3.4.6	Impact on Energy Consultants	10
3.4.7	Impact on Building Inspectors	10
3.4.8	Impact on Statewide Employment	10
3.5	Economic Impacts	10
3.5.1	Creation or Elimination of Jobs	11
3.5.2	Creation or Elimination of Businesses within California	11
3.5.3	Competitive Advantages or Disadvantages for Businesses within California.....	13
3.5.4	Increase or Decrease of Investments in the State of California	13
3.5.5	Incentives for Innovation in Products, Materials, or Processes	14
3.5.6	Effects on the State General Fund, State Special Funds and Local Governments.....	14
4.	Methodology	15
4.1	Existing Conditions	15
4.2	Proposed Conditions	15
4.3	Calculation Methodology	15
4.4	Prototype Building Sites	18
4.5	Climate Dependent.....	20
4.6	Time Dependent Valuation	20
4.7	Energy Impacts Methodology	20
4.7.1	Per Unit Energy Impacts Methodology	21
4.7.2	Statewide Energy Impacts Methodology	21
4.8	Cost-effectiveness Methodology	28
4.8.1	Incremental Cost Methodology.....	28
4.8.2	Cost Savings Methodology	29
4.8.3	Cost-effectiveness Methodology.....	29
4.9	Environmental Impacts Methodology.....	30
4.9.1	Greenhouse Gas Emissions Impacts Methodology.....	30
4.9.2	Water Use Impacts Methodology	30
4.9.3	Material Impacts Methodology (Optional)	30
4.9.4	Other Impacts Methodology	30
5.	Analysis and Results.....	30
5.1	Energy Impacts Results	30
5.1.1	Per Unit Energy Impacts Results	32
5.1.2	Statewide Energy Impacts Results.....	38
5.2	Cost-effectiveness Results.....	38

5.2.1	Incremental Cost Results	38
5.2.2	Cost Savings Results	39
5.2.3	Cost-effectiveness Results	41
5.3	Environmental Impacts Results.....	42
5.3.1	Greenhouse Gas Emissions Results	42
5.3.2	Water Use and Water Quality Impacts.....	42
5.3.3	Material Impacts Results.....	42
5.3.4	Other Impacts Results	42
6.	Proposed Language	43
6.1	Standards	43
6.2	Reference Appendices.....	49
6.3	ACM Reference Manual.....	49
6.4	Compliance Manuals	49
6.5	Compliance Forms	49
7.	References and Other Research	50
	Appendix A: Environmental Impacts Methodology	52
	Appendix B: Outdoor Lighting Calculations Methodology	53
	Appendix C: Outdoor Lighting LPA Calculations Results	58
	Appendix D: Models for General Calculations.....	70
	Appendix E: Lighting Use Profiles for Calculations	72
	Appendix F: General Hardscape Cost Effectiveness Calculations	79
	Appendix G: Statewide General Hardscape Area Estimates Information	86
	Appendix H: Cost Effectiveness Calculation Information for Other Line Items	90
	Appendix I: Statewide Cost Effectiveness Calculation Results.....	145

List of Tables

Table 1: Scope of Code Change Proposal.....	xi
Table 2: Estimated First Year Energy Savings.....	xiv
Table 3: Cost-effectiveness Summary ¹ – Statewide Weighted Average Across Lighting Zones for all Measure Line-Items.....	xv
Table 4: Estimated Statewide Greenhouse Gas Emissions Impacts.....	xvi
Table 5: Scope of Code Change Proposal.....	5
Table 6: Sections of Standards Impacted by Proposed Code Change.....	5
Table 7: Industries Receiving Energy Efficiency Related Investment, by North American Industry Classification System (NAICS) Code.....	13
Table 8: Sample of Calculations for Building Entrance Baseline Scenario.....	16
Table 9: Sample of Calculations for Building Entrance LED Scenario.....	17
Table 10: Sample of Calculation of Building Entrance Efficacy Adjustments.....	17
Table 11: Prototype Sites used for Energy Impact Analysis.....	19
Table 12: Additional Ideal Prototype Site used for Energy Impact Analysis.....	19
Table 13: Prototype Sites used for Cost Impact Analysis.....	20
Table 14: Key assumptions for per unit Energy Impacts Analysis.....	21
Table 15: Lighting Zone Area and Likely Construction Activity within the Respective Lighting Zones in the State.....	22
Table 16: Proxy Assumptions for Statewide Impacts Estimate Calculations for Specific Applications.....	23
Table 17: Proxy Assumptions for Statewide Impacts Estimate Calculations for General Hardscape.....	24
Table 18: Description of Space Types used in the Nonresidential New Construction Forecast ..	25
Table 19. Translation from FCZ to BCZ.....	26
Table 20: Estimated New Nonresidential Construction in 2017 by Climate Zone and Building Type (Million Square Feet).....	27
Table 21: Key Assumptions for per unit Incremental Construction Cost.....	29
Table 22: Outdoor Lighting LPA Recommendations Table.....	31
Table 23: Outdoor Lighting LPA Recommendations Reduction Percentage Table.....	32
Table 24: Effective Power Density Impacts per Square Foot of General Hardscape.....	33
Table 25: Energy Impacts per Square Foot – General Hardscape.....	33
Table 26: Energy Impacts per Unit – Other Line Items LZ1.....	34
Table 27: Energy Impacts per Unit – Other Line Items LZ2.....	35

Table 28: Energy Impacts per Unit – Other Line Items LZ3.....	36
Table 29: Energy Impacts per Unit – Other Line Items LZ4.....	37
Table 30: Statewide Energy Impacts	38
Table 31: Lighting Zone Area Weighting Factors.....	39
Table 32: Weighted TDV Energy Cost Savings Over 15 Years - Per Unit.....	40
Table 33: Per Unit Cost-effectiveness Summary – General Hardscape by Lighting Zone	41
Table 34: Cost-effectiveness Summary ¹ – Statewide Weighted Average Across Lighting Zones for all Measure Line-Items.....	41
Table 35: Statewide Greenhouse Gas Emissions Impacts	42
Table 36: Impacts of Water Use and Water Quality.....	42
Table 37: Cost-effectiveness Summary ¹ – Weighted Average Across Lighting Zones	146

List of Figures

Figure 1: Diagram of LED Chip Efficacy Projections.....	54
Figure 2: LED Chip Efficacy and Price Projections.....	55
Figure 3: Roadway and Area Luminaire Efficacy Projections with 95% Confidence Bands.	55
Figure 4: LED Luminaire Efficacy Projections Compared To ‘Best in Class’ HID and LFL Products.....	57
Figure 5: General Hardscape Possible LPA Calculation Results LZ1-1	58
Figure 6: General Hardscape Possible LPA Calculation Results LZ1-2	59
Figure 7: General Hardscape Possible LPA Calculation Results LZ1-3	60
Figure 8: General Hardscape Possible LPA Calculation Results LZ2-1	61
Figure 9: General Hardscape Possible LPA Calculation Results LZ2-2	62
Figure 10: General Hardscape Possible LPA Calculation Results LZ3-1	63
Figure 11: General Hardscape Possible LPA Calculation Results LZ3-2	64
Figure 12: General Hardscape Possible LPA Calculation Results LZ3-3	65
Figure 13: General Hardscape Possible LPA Calculation Results LZ4-1	66
Figure 14: General Hardscape Possible LPA Calculation Results LZ4-2	67
Figure 15: General Hardscape Effective LPA Calculation Results	68
Figure 16: General Hardscape Effective Watts Per Square Foot LPA Adjustment Results based on Nine Prototype Properties	69
Figure 17: Nine Site Prototypes Used to Calculate Reasonable Site Impact Calculations.....	70

Figure 18: Three Site Prototypes Used to Calculate Cost Calculations for LED Lighting Systems	71
Figure 19: Nonresidential Outdoor Lighting Use Curve for General Hardscape (Statewide Use Estimates Only).....	72
Figure 20: Hotel Outdoor Lighting Use Curve for General Hardscape (Statewide Use Estimates Only).....	73
Figure 21: Retail Outdoor Lighting Use Curve for General Hardscape (Statewide Use Estimates Only).....	73
Figure 22: Schedule A: Winter and Summer Curves.....	74
Figure 23: Schedule B: Winter and Summer Curves.....	74
Figure 24: Schedule C: Winter and Summer Curves.....	75
Figure 25: General Hardscape Use Schedule.....	75
Figure 26: ATM Use Schedule	76
Figure 27: Retail Lighting Use Schedule.....	76
Figure 28: Service Station Canopies Use Schedule.....	77
Figure 29: Service Station Hardscape Use Schedule.....	77
Figure 30: Lighting Application Schedule Use Matrix.....	78
Figure 31: Luminaire Costs for Construction, Based on Factory Representative Quotes and Adjusted Forward.....	79
Figure 32: Itemized Costs for Construction, Based on RS Means and Adjusted Forward.....	80
Figure 33: Costing Calculations for LZ1 of Real Site Design.....	81
Figure 34: Costing Calculations for LZ2 of Real Site Design.....	82
Figure 35: Costing Calculations for LZ3 of Real Site Design.....	83
Figure 36: Costing Calculations for LZ4 of Real Site Design.....	84
Figure 37: Costing Calculations for Real Site Designs of Three Sites in Four Lighting Zones...	85
Figure 38: Parking Space Requirements for Various Metropolitan Regions	88
Figure 39: Representative Code Parking Space Requirements Employed.....	88
Figure 40: Parking Space Area Multipliers Applied in Statewide Calculations.....	89
Figure 41: Building Entrances Calculation Results and Recommendations	90
Figure 42: Building Entrances Lumen Equivalency Calculation Pt. 1	91
Figure 43: Building Entrances Lumen Equivalency Calculation Pt. 2	92
Figure 44: Building Entrances Cost Calculation Pt. 1	93
Figure 45: Building Entrances Cost Calculation Pt. 2	94
Figure 46: Building Primary Entrances Calculation Results and Recommendations.....	95

Figure 47: Building Primary Entrances Lumen Equivalency Calculation Pt. 1	95
Figure 48: Building Primary Entrances Lumen Equivalency Calculation Pt. 2	96
Figure 49: Building Primary Entrances Cost Calculation Pt. 1	97
Figure 50: Building Primary Entrances Cost Calculation Pt. 2	98
Figure 51: Drive-Up Windows Calculation Results and Recommendations.....	99
Figure 52: Drive-Up Windows Lumen Equivalency Calculation Pt. 1	99
Figure 53: Drive-Up Windows Lumen Equivalency Calculation Pt. 2	100
Figure 54: Drive-Up Windows Cost Calculation Pt. 1	101
Figure 55: Drive-Up Windows Cost Calculation Pt. 2	102
Figure 56: Vehicle Service Station Uncovered Fuel Dispenser Calculation Results and Recommendations	103
Figure 57: Vehicle Service Station Uncovered Fuel Dispenser Lumen Equivalency Calculation Pt. 1.....	103
Figure 58: Vehicle Service Station Uncovered Fuel Dispenser Lumen Equivalency Calculation Pt. 2.....	103
Figure 59: Vehicle Service Station Uncovered Fuel Dispenser Cost Calculation Pt. 1	104
Figure 60: Vehicle Service Station Uncovered Fuel Dispenser Cost Calculation Pt. 2	104
Figure 61: ATM Calculation Results and Recommendations	105
Figure 62: Outdoor Sales Frontage Calculation Results and Recommendations	106
Figure 63: Outdoor Sales Frontage Lumen Equivalency Calculation Pt. 1	106
Figure 64: Outdoor Sales Frontage Lumen Equivalency Calculation Pt. 2.....	107
Figure 65: Outdoor Sales Frontage Cost Calculation Pt. 1	108
Figure 66: Outdoor Sales Frontage Cost Calculation Pt. 2.....	108
Figure 67: Building Facades Calculation Results and Recommendations	109
Figure 68: Building Facades Lumen Equivalency Calculation Pt. 1	110
Figure 69: Building Facades Lumen Equivalency Calculation Pt. 2	111
Figure 70: Building Facades Cost Calculation Pt. 1	112
Figure 71: Building Facades Cost Calculation Pt. 2.....	113
Figure 72: Outdoor Sales Lots Calculation Results and Recommendations	114
Figure 73: Outdoor Sales Lots Lumen Equivalency Calculation Pt. 1	114
Figure 74: Outdoor Sales Lots Lumen Equivalency Calculation Pt. 2.....	114
Figure 75: Outdoor Sales Lots Cost Calculation Pt. 1	115
Figure 76: Outdoor Sales Lots Cost Calculation Pt. 2.....	115

Figure 77: Vehicle Service Station Hardscape Calculation Results and Recommendations.....	116
Figure 78: Vehicle Service Station Hardscape Lumen Equivalency Calculation Pt. 1	116
Figure 79: Vehicle Service Station Hardscape Equivalency Calculation Pt. 2.....	116
Figure 80: Vehicle Service Station Hardscape Cost Calculation Pt. 1	117
Figure 81: Vehicle Service Station Hardscape Cost Calculation Pt. 2	117
Figure 82: Vehicle Service Station Canopies Calculation Results and Recommendations.....	118
Figure 83: Vehicle Service Station Canopies Lumen Equivalency Calculation Pt. 1	118
Figure 84: Vehicle Service Station Canopies Equivalency Calculation Pt. 2.....	119
Figure 85: Vehicle Service Station Canopies Cost Calculation Pt. 1	120
Figure 86: Vehicle Service Station Canopies Cost Calculation Pt. 2	121
Figure 87: Sales Canopies Calculation Results and Recommendations.....	122
Figure 88: Sales Canopies Lumen Equivalency Calculation Pt. 1.....	122
Figure 89: Sales Canopies Equivalency Calculation Pt. 2.....	123
Figure 90: Sales Canopies Cost Calculation Pt. 1.....	124
Figure 91: Sales Canopies Cost Calculation Pt. 2.....	125
Figure 92: Non-Sales Canopies Calculation Results and Recommendations.....	126
Figure 93: Non-Sales Canopies Lumen Equivalency Calculation Pt. 1	127
Figure 94: Non-Sales Canopies Equivalency Calculation Pt. 2.....	128
Figure 95: Non-Sales Canopies Cost Calculation Pt. 1	129
Figure 96: Non-Sales Canopies Cost Calculation Pt. 2	130
Figure 97: Guard Station Calculation Results and Recommendations.....	131
Figure 98: Guard Station Lumen Equivalency Calculation Pt. 1.....	131
Figure 99: Guard Station Lumen Equivalency Calculation Pt. 2.....	132
Figure 100: Guard Station Cost Calculation Pt. 1.....	133
Figure 101: Guard Station Cost Calculation Pt. 2.....	134
Figure 102: Student Pick-up/Drop-off Zone Calculation Results and Recommendations.....	135
Figure 103: Student Pick-up/Drop-off Zone Lumen Equivalency Calculation Pt. 1.....	135
Figure 104: Student Pick-up/Drop-off Zone Equivalency Calculation Pt. 2.....	136
Figure 105: Student Pick-up/Drop-off Zone Cost Calculation Pt. 1.....	137
Figure 106: Student Pick-up/Drop-off Zone Cost Calculation Pt. 2.....	138
Figure 107: Outdoor Dining Calculation Results and Recommendations.....	139
Figure 108: Outdoor Dining Lumen Equivalency Calculation Pt. 1	139
Figure 109: Outdoor Dining Equivalency Calculation Pt. 2.....	139

Figure 110: Outdoor Dining Cost Calculation Pt. 1 140
Figure 111: Outdoor Dining Cost Calculation Pt. 2 140
Figure 112: Special Security Lighting for Retail Calculation Results and Recommendations .. 141
Figure 113: Special Security Lighting for Retail Lumen Equivalency Calculation Pt. 1 141
Figure 114: Special Security Lighting for Retail Equivalency Calculation Pt. 2 142
Figure 115: Special Security Lighting for Retail Cost Calculation Pt. 1 143
Figure 116: Special Security Lighting for Retail Cost Calculation Pt. 2..... 144

Document Information

Category: Codes and Standards

Keywords: Statewide Codes and Standards Team, Statewide CASE Team, Codes and Standards Enhancements, Title 24, 2016, efficiency, outdoor lighting, lighting power allowance, LPA, LED.

EXECUTIVE SUMMARY

Introduction

The Codes and Standards Enhancement (CASE) initiative presents recommendations to support California Energy Commission’s (CEC) efforts to update California’s Building Energy Efficiency Standards (Title 24) to include new requirements or to upgrade existing requirements for various technologies. The four California Investor Owned Utilities (IOUs) – Pacific Gas and Electric Company, San Diego Gas and Electric, Southern California Edison and Southern California Gas Company – and Los Angeles Department of Water and Power (LADWP) sponsored this effort. The program goal is to prepare and submit proposals that will result in cost-effective enhancements to energy efficiency in buildings. This report and the code change proposal presented herein is a part of the effort to develop technical and cost-effectiveness information for proposed regulations on building energy efficient design practices and technologies.

The overall goal of this CASE Report is to propose a code change proposal for Nonresidential Outdoor Lighting Power Allowances (LPA). The report contains pertinent information that justifies the code change including:

- Description of the code change proposal, the measure history, and existing standards (Section 2);
- Market analysis, including a description of the market structure for specific technologies, market availability, and how the proposed standard will impact building owners and occupants, builders, and equipment manufacturers, distributors, and sellers (Section 3);
- Methodology and assumption used in the analyses energy and electricity demand impacts, cost-effectiveness, and environmental impacts (Section 4);
- Results of energy and electricity demand impacts analysis, Cost-effectiveness Analysis, and environmental impacts analysis (Section 5); and
- Proposed code change language (Section 6).

Scope of Code Change Proposal

Nonresidential Outdoor LPA will affect the following code documents listed in Table 1.

Table 1: Scope of Code Change Proposal

Standards Requirements (see note below)	Compliance Option	Appendix	Modeling Algorithms	Simulation Engine	Forms
M, Ps	No	No	No	No	No

Note: An (M) indicates mandatory requirements, (Ps) Prescriptive, (Pm) Performance.

Measure Description

The Nonresidential Outdoor LPA measure intends to replace pulse start Metal Halide (PSMH) light sources with LED as the basis for the calculation of Lighting Power Allowances (LPA) for all exterior applications where it is technically feasible to do so.

Section 2 of this report provides detailed information about the code change proposal including: *Section 2.2 Summary of Changes to Code Documents (page 5)* provides a section-by-section description of the proposed changes to the standards, appendices, alternative compliance manual and other documents that will be modified by the proposed code change. See the following tables for an inventory of sections of each document that will be modified:

- Table 5: Scope of Code Change Proposal (page 5)
- Table 6: Sections of Standards Impacted by Proposed Code Change (page 5)

Detailed proposed changes to the text of the building efficiency standards, the reference appendices, are given in *Section 6 Proposed Language* of this report. This section proposes modifications to language with additions identified with underlined text and deletions identified with ~~struck-out~~ text.

The following documents will be modified by the proposed change:

SECTION 140.6 – PRESCRIPTIVE REQUIREMENTS FOR INDOOR LIGHTING

Subsection 140.6(a)3: Will have the exception for ATM lighting removed.

Table 140.6-C: Will add an allowance for ATM lighting in parking garages.

SECTION 140.7 – REQUIREMENTS FOR OUTDOOR LIGHTING

EXCEPTION 6 and 8 to Subsection 140.7(a): The edits will remove an exception for ATM lighting, lighting for tunnels, and lighting for bridges.

Subsection 140.7(d)1A: The edits will add bridge(s) and tunnel(s) to the general hardscape lighting allowance calculation instructions.

Tables 140.7-A & B: The tables will be modified with new LPA values to reduce energy consumption by using LED light sources as the new baseline for calculations. Further, language will be added to establish an LPA for ATM locations, and bridges and tunnels will be included in the allowance list.

Market Analysis and Regulatory Impact Assessment

The industry as a whole is participating in the change to LED light sources. Manufacturers are actively funding R&D efforts for the LED market, putting most of their R&D funds into LED product development. (TRC 2014) As a result, manufacturers are already supporting this change and are working to be well positioned for this market shift.

This proposal is cost effective over the period of analysis. Overall this proposal increases the wealth of the State of California. California consumers and businesses save more money on energy than they do for financing the efficiency measure. As a result this leaves more money available for discretionary and investment purposes.

The expected impacts of the proposed code change on various stakeholders are summarized below:

- **Impact on builders:** The proposed measures will have little to no impact on builders.
- **Impact on building designers:** The proposed code change is not expected to significantly impact building designers.
- **Impact on occupational safety and health:** The proposed code change does not alter any existing federal, state, or local regulations pertaining to safety and health, including rules enforced by California Division of Occupational Safety and Health. All existing health and safety rules will remain in place. Complying with the proposed code changes is not anticipated to have any impact on the safety or health occupants or those involved with the construction, commissioning, and ongoing maintenance of the building.
- **Impact on building owners and occupants:** Over the 15-year evaluation period the energy cost savings from this measure are higher than the incremental costs. The building owners and occupants who pay energy bills are expected to benefit from cost savings over the life of the building.
- **Impact on equipment retailers (including manufacturers and distributors):** No impact anticipated.
- **Impact on energy consultants:** The proposed code change is not expected to significantly impact energy consultants.
- **Impact on building inspectors:** As compared to the overall code enforcement effort, this measure has negligible impact on the effort required to enforce the building codes.
- **Statewide Employment Impacts:** The proposed changes to Title 24 are expected to result in positive job growth as noted below in Section 3.5. The particular measures proposed in this report are not expected to have an appreciable impact on employment in California.
- **Impacts on the creation or elimination of businesses in California:** The proposed measure is not expected to have an appreciable impact on California businesses.
- **Impacts on the potential advantages or disadvantages to California businesses:** In general California businesses would benefit from an overall reduction in energy costs. This could help California businesses gain competitive advantage over businesses operating in other states or countries and increase in investment in California. This particular measure is not expected to have an appreciable impact on any specific California business.
- **Impacts on the potential increase or decrease of investments in California:** As described in Section 3.5 of this report, the California Air Resources Board (CARB) economic analysis of greenhouse gas reduction strategies for the State of California indicates that higher levels of energy efficiency and 33 percent Renewable Portfolio Standard (RPS) will increase investment in California by about 3 percent in 2020 compared to 20% RPS and lower levels of energy efficiency. After reviewing the CARB analysis, the Statewide CASE Team concluded that the majority of the increased investment of the more aggressive strategy is attributed to the benefits of efficiency

(CARB 2010b Figures 7a and 10a). The specific code change proposal presented in this report is not expected to have an appreciable impact on investments in California.

- **Impacts on incentives for innovations in products, materials or processes:** Updating Title 24 Standards could encourage innovation through the adoption of new technologies to better manage energy usage and achieve energy savings. It is not anticipated that this measure will have a significant impact on innovation.
- **Impacts on the State General Fund, Special Funds and local government:** The proposed measure is not expected to have an appreciable impact on the State General Fund, Special Funds, or local government funds.
- **Cost of enforcement to State Government and local governments:** All revisions to Title 24 will result in changes to Title 24 compliance determinations. State and local code officials will be required to learn how buildings can comply with the new provisions included in the 2016 Standards, however the Statewide CASE Team anticipates that the cost of training is part of the regular training activities that occur every time the code is updated. These proposed changes would not affect the complexity of the code significantly. Therefore, on-going costs are not expected to change significantly.
- **Impacts on migrant workers; persons by age group, race, or religion:** This proposal and all measures adopted by CEC into Title 24, part 6 do not advantage or discriminate in regards to race, religion or age group.
- **Impact on Homeowners (including potential first time home owners):** The proposal does not impact residential buildings. There is no expected impact on homeowners.
- **Impact on Renters:** The energy cost savings from the proposed measures might be passed on to tenants.
- **Impact on Commuters:** This proposal and all measures adopted by CEC into Title 24, Part 6 are not expected to have an impact on commuters.

Statewide Energy Impacts

Table 2 shows the estimated energy savings over the first twelve months of implementation of the Nonresidential Outdoor Lighting Power Allowance measure.

Table 2: Estimated First Year Energy Savings

	First Year Statewide Savings			TDV Dollar Savings (\$ Millions)
	Electricity Savings (GWh)	Power Demand Reduction (MW)	Natural Gas Savings (MMtherms)	
TOTAL	44.3	N/A	N/A	73.5

Section 4.7.1 discusses the methodology and Section 5.1.1 shows the results for the per unit energy impact analysis.

Cost-effectiveness

The per unit results of the Cost-effectiveness Analyses are presented in **Table 3**. The TDV Energy Costs Savings are the present valued energy cost savings over the 15 year period of analysis using CEC’s TDV methodology. The Total Incremental Cost represents the incremental initial construction and maintenance costs of the proposed measure relative to existing conditions (current minimally compliant construction practice). Costs incurred in the future (such as periodic maintenance costs or replacement costs) are discounted by a 3 percent real discount rate, per CEC’s LCC Methodology. The Benefit to Cost (B/C) Ratio is the incremental TDV Energy Costs Savings divided by the Total Incremental Costs. When the B/C ratio is greater than 1.0, the added cost of the measure is more than offset by the discounted energy cost savings and the measure is deemed to be cost effective.

Table 3: Cost-effectiveness Summary¹ – Statewide Weighted Average Across Lighting Zones for all Measure Line-Items

Climate Zone	Units	Benefit: TDV Energy Cost Savings ² (2017 PV\$)	Cost: Total Incremental Cost ³ (2017 PV\$)	Change in Lifecycle Cost ⁴ (2017 PV\$)	Benefit to Cost Ratio ⁵
Outdoor Lighting LPA (Entire Measure)	Per Square Foot	0.41	0.11	-0.41	3.8

1. Relative to existing conditions. All cost values presented in 2017 dollars. “Hospital” building category exclude from cost and savings projections.
2. Present value of TDV cost savings equals TDV electricity savings plus TDV natural gas savings; $\Delta\text{TDV\$} = \Delta\text{TDV\$E} + \Delta\text{TDV\$G}$.
3. Total incremental cost equals incremental construction cost (post adoption) plus present value of incremental maintenance cost; $\Delta\text{C} = \Delta\text{CI}_{\text{PA}} + \Delta\text{CM}$.
4. Negative values indicate the measure is cost-effective. Change in lifecycle cost equals cost premium minus TDV energy cost savings; $\Delta\text{LCC} = \Delta\text{C} - \Delta\text{TDV\$}$
5. The benefit to cost ratio is the TDV energy costs savings divided by the total incremental costs; $\text{B/C} = \Delta\text{TDV\$} \div \Delta\text{C}$. The measure is cost effective if the B/C ratio is greater than 1.0.

Section 4.8 discusses the methodology and Section 5.2 shows the results of the Cost Effectiveness Analysis

Greenhouse Gas and Water Related Impacts

For more a detailed and extensive analysis of the possible environmental impacts from the implementation of the proposed measure, please refer to Section 5.3 of this report.

Greenhouse Gas Impacts

Table 4 presents the estimated avoided greenhouse gas (GHG) emissions of the proposed code change for the first year the standards are in effect. Assumptions used in developing the GHG savings are provided in Section 4.9.1 on page 30 of this report.

Table 4: Estimated Statewide Greenhouse Gas Emissions Impacts

	Avoided GHG Emissions (MTCO₂e/yr)
TOTAL	15,650

Section 4.9.1 discusses the methodology and Section 5.3.1 shows the results of the greenhouse gas emission impacts analysis.

Water Use and Water Quality Impacts

The proposed measure is not expected to have any impacts on water use or water quality, excluding positive impacts that may occur at power plants due to reduced energy consumption.

Acceptance Testing

The proposed measure is not expected to have any impacts on acceptance testing.

1. INTRODUCTION

The Codes and Standards Enhancement (CASE) initiative presents recommendations to support California Energy Commission's (CEC) efforts to update California's Building Energy Efficiency Standards (Title 24) to include new requirements or to upgrade existing requirements for various technologies. The four California Investor Owned Utilities (IOUs) – Pacific Gas and Electric Company, San Diego Gas and Electric, Southern California Edison and Southern California Gas Company – and Los Angeles Department of Water and Power (LADWP) sponsored this effort. The program goal is to prepare and submit proposals that will result in cost-effective enhancements to energy efficiency in buildings. This report and the code change proposal presented herein is a part of the effort to develop technical and cost-effectiveness information for proposed regulations on building energy efficient design practices and technologies. The overall goal of this CASE Report is to propose a code change for the Nonresidential Outdoor Lighting Power Allowances. The report contains pertinent information that justifies the code change.

Section 2 of this CASE Report provides a description of the measure, how the measure came about, and how the measure helps achieve the state's zero net energy (ZNE) goals. This section presents how the Statewide CASE Team envisions the proposed code change would be enforced and the expected compliance rates. This section also summarized key issues that were addressed during the CASE development process, including issues discussed during a public stakeholder meeting that the Statewide CASE Team hosted in May 2014.

Section 3 presents the market analysis, including a review of the current market structure, a discussion of product availability, and the useful life and persistence of the proposed measure. This section offers an overview of how the proposed standard will impact various stakeholders including builders, building designers, building occupants, equipment retailers (including manufacturers and distributors), energy consultants, and building inspectors. Finally, this section presents estimates of how the proposed change will impact statewide employment.

Section 4 describes the methodology and approach the Statewide CASE Team used to estimate energy, demand, costs, and environmental impacts. Key assumptions used in the analyses can also be found in Section 4.

Results from the energy, demand, costs, and environmental impacts analysis are presented in Section 5. The Statewide CASE Team calculated energy, demand, and environmental impacts using two metrics: (1) per unit, and (2) statewide impacts during the first year buildings complying with the 2016 Title 24 Standards are in operation. Time Dependent Valuation (TDV) energy impacts, which accounts for the higher value of peak savings, are presented for the first year both per unit and statewide. The incremental costs, relative to existing conditions are presented as are present value of year TDV energy cost savings and the overall cost impacts over the year period of analysis.

The report concludes with specific recommendations for language for the Standards, Appendices, Alternate Calculation Method (ACM) Reference Manual and Compliance Forms.

2. MEASURE DESCRIPTION

2.1 Measure Overview

2.1.1 Measure Description

The Outdoor Lighting Power Allowance (LPA) values in Title 24 are subject to change as new technologies (in particular, light source technologies that increase lamp efficacy) become available to the market. As a result, the LPA values have continued to slowly move downward over time in response to these technological advancements, most recently for Pulse-Start Metal Halide (PSMH) technology.

LED light source technology is advancing rapidly, and the raw lamp efficacy of LED light sources are rapidly improving beyond that of both PSMH (the current baseline standard), and High Pressure Sodium (HPS) light sources. The lumen package efficacy is anticipated to exceed PSMH and HPS in several years. Further, the efficiency of LED luminaires is typically significantly higher than either PSMH or HPS luminaires. LED luminaires will exceed combined HID source luminaire efficacy sometime in late 2014 or 2015. (DOE 2013) Finally, LED luminaires can deliver light more uniformly to the target area, which will result in further savings opportunities.

In addition, LED light source technology has a variety of operational advantages over either PSMH or HPS, including:

- much longer life expectancy (in some cases beyond 100,000 hours)
- better lumen maintenance at a given age of operation
- very good dimming efficacy curves
- a large range of dimming capability (down to 10% in most cases)
- rapid level changes that accommodates sensor integration
- instant re-strike for On-Off-On switching capability
- preservation of source color characteristics over full dimming range

As a result, LED is rapidly claiming a large portion of the exterior lighting market, and the market adoption of LED is anticipated to accelerate as the cost of LED products continues to decrease.

This measure intends to replace PSMH light sources with LED as the basis for the calculation of Lighting Power Allowances (LPA) for all exterior applications where it is technically feasible to do so.

At no point in this LPA adjustment will the lighting design criteria be changed. This basis of design has been established by the Illumination Engineering Society (IES) in a variety of sources and mapped as part of the previous Title 24 Outdoor Lighting Case Studies (CASE 2007). This matrix of design criteria was reviewed to ensure that no specific recommendations have changed, and therefore, no changes are needed to the illuminance criterion that establishes the LPA values.

Further, two specific applications have been identified that require attention. There currently is no allowance mechanism for lighting associated with ATM locations in Outdoor Lighting. This lighting is currently exempted from the code through an exception in 140.7(a). ASHRAE 90.1-2013 includes an allowance for this, and it is possible to establish a reasonable allowance for ATM locations and insert this allowance as a line-item into the tables of LPA values.

The other application requires some clarification in the language, but will require no additional LPA values established. This is lighting for tunnels and other covered pathways that would not normally be interpreted as Non-Sales Canopy applications. In this circumstance, the proposal is to add language including them in the Non-Sales Canopy category.

2.1.2 Measure History

Outdoor lighting was first introduced into Title 24 in the 2005 code cycle. At that time, the outdoor lighting realm was predominately based upon probe-start Metal Halide (MH) and HPS light sources for large area lighting, fluorescent and compact fluorescent for smaller lumen package products, and very small amounts of other light source types under certain circumstances.

While HPS light sources are commonly used for roadway applications, when a white light source is desired (as is common for retail applications), MH lamps have been the only viable option for many years. This established MH as the de facto baseline technology for most Lighting Power Allowance (LPA) calculations because it is approximately 15% less efficacious than HPS under comparable circumstances. As a result, MH has been used as the light source technology for the simulations used to generate the LPA values established in Tables 140.7-A and 140.7-B.

Due to the enactment of the Energy Independence and Security Act (EISA) in 2007, MH lamps and ballasts were removed as a new luminaire option, so the MH lamp baseline shifted to PSMH lamps. These were employed in Title 24-2013, but the changes were subtle due to certain lamp and design interactions that reduced their apparent impact.

In approximately 2008, LED light sources started to become available, offering an alternative to MH or PSMH as a white light source. As LED technology has advanced, the quality of the light, the cost of the luminaires, the efficacy of the LED chips, and the rated life of the LED chips have all improved significantly.

A study by the US-DOE found that LED chips have improved in efficacy at a rate of approximately 10% per year recently, and this efficacy improvement is projected to continue for the next five years or more before slowing down. (DOE 2013) At the same time, the cost per kilolumen of the LED package has decreased by approximately 30% in 2012, another 50% is expected through 2015, and another 50% (to 25% of today's cost) by 2018 (DOE 2013).

In the past, while LED technology has been a viable alternative to MH sources, it was at a cost premium that was hard to justify with the associated energy savings. In almost all metrics, (availability, cost of initial purchase, efficacy, and ongoing maintenance cost), this premium will be eliminated for most applications in time for the next cycle of Title 24 to take effect (currently scheduled for Jan. 1, 2017).

As a result, by 2017, LED light sources will have become the white light source of choice for almost all outdoor lighting applications, and will be both a major advancement in energy efficiency, and also a very cost effective design solution for the building industry to employ.

Using LED as a baseline is anticipated to result in an approximately 40% reduction in the LPA values in Tables 140.7-A & B. The full impact of a switch to LED as the basis of design is not a simple efficacy gain comparison for the general lighting applications; the LED products produce better illumination with better uniformity and lower waste from “spill light” than similar MH products due to more carefully directed light distribution. As a result, the impact is greater than a simple luminaire efficacy calculation may predict.

This measure provides a methodology to calculate the anticipated cost and efficacy implications of LED lighting products in advance of the timeframe of the Standard effective date. This is necessary because LED technology is advancing at a very rapid pace. The most appropriate LPA values are calculated based on reasonable predictions of where LED efficacy will be at the time of adoption, not on current performance of LED lighting products, which would place the LPA values approximately three years behind the LED efficacy curve.

This measure is proposed because the lighting market is rapidly advancing, and most of the current LPA values in Section 140.6 have not been reviewed and reduced since the 2008 revisions. In the future, the prevalence of LED in the market will make the LPA values easily achievable if they remain at current levels, causing Title 24 to lose savings opportunities due to inaction.

The move towards LED in the lighting industry is a fundamental shift towards electronics. However, this move is happening independent of codes and standards development. It is important that Title 24 keep in stride with this shift if it is to remain relevant as an energy code that challenges the building industry to higher levels of performance.

At this time, the shift to LED as the baseline is designated for Nonresidential Outdoor lighting only, and no other portions of Title 24.

2.1.3 Existing Standards

Nonresidential Outdoor LPA is regulated in Section 140.7 of the Standards. This measure will not change the regulation infrastructure, but will change the values that are established as the permissible performance for outdoor lighting applications in Tables 140.7-A & B.

2.1.4 Alignment with Zero Net Energy Goals

The Statewide CASE Team and the CEC are committed to achieving California’s zero-net-energy (ZNE) goal. This measure will help achieve ZNE goals by reducing the connected power and energy consumption of outdoor lighting associated with new construction. This measure will also set the foundation for future revisions that will help ensure ZNE goals are achieved. In particular, this measure could lead directly to the following changes in the 2019 and 2022 revision cycles:

- Possible further reductions in outdoor LPA values in Tables 140.7-A and 140.7-B as the LED technology advances.
- As an enabling technology, LED will permit more advanced lighting controls and controls strategies to be employed, saving on hours of operation.

2.1.5 Relationship to Other Title 24 Measures

This measure does not specifically overlap with any other current measure directly. However, there is a Nonresidential Outdoor Lighting Controls measure that will be impacted by the LPA values that are established in this CASE.

2.2 Summary of Changes to Code Documents

The sections below provide a summary of how Title 24 documents will be modified by the proposed change. See Section 6 of this report for detailed proposed revisions to code language.

2.2.1 Catalogue of Proposed Changes

Scope

Table 5 identifies the scope of the code change proposal. This measure will impact the following areas (marked by a “Yes”).

Table 5: Scope of Code Change Proposal

Mandatory	Prescriptive	Performance	Compliance Option	Trade-Off	Modeling Algorithms	Forms
Yes	Yes	No	No	No	No	No

Standards

The proposed code change will modify the sections of the California Building Energy Efficiency Standards (Title 24, Part 6) identified in Table 6.

Table 6: Sections of Standards Impacted by Proposed Code Change

Title 24, Part 6 Section Number	Section Title	Mandatory (M) Prescriptive (Ps) Performance (Pm)	Modify Existing (E) New Section (N)
10-114	Determination of Outdoor Lighting Zones and Administrative Rules for Use	M	E
140.6	Prescriptive Requirements for Indoor Lighting	Ps	E
140.7	Requirements for Outdoor Lighting	Ps	E

Appendices

The proposed code change is not anticipated to modify any sections of the appendices.

Nonresidential Alternative Calculation Method (ACM) Reference Manual

The proposed code change is not anticipated to modify the Nonresidential Alternative Calculation Method References.

Simulation Engine Adaptations

The proposed code change can be modeled using the current simulation engine. Changes to the simulation engine are not necessary.

2.2.2 Standards Change Summary

This proposal would modify the following sections of the Building Energy Efficiency standards as shown below. See *Section 6.1 Standards* of this report for the detailed proposed revisions to the standards language.

Changes in Mandatory Requirements

The changes focus on Tables 10-114-A, where the Lighting Zone definitions are described, and add the new Lighting Zone 0 into the table.

TABLE 10-114-A – LIGHTING ZONE CHARACTERISTICS AND RULES FOR AMENDMENTS BY LOCAL JURISDICTIONS

The edits will add the description of Lighting Zone 0 to the table, and more accurately describe the ambient illumination using terminology that correlates with the Illumination Engineering Society.

Changes in Prescriptive Requirements

There is a change in Section 140.6 (Indoor Lighting) to address ATM machines in Parking Garage situations.

The changes focus on Tables 140.7-A & B, where the LPA values for outdoor lighting are presented. All of these values are reduced based on the calculations of light source technology improvements.

SECTION 140.6 – PRESCRIPTIVE REQUIREMENTS FOR INDOOR LIGHTING

Subsection 140.6(a)3: Will have the exception for ATM lighting removed.

Table 140.6-C: Will add an allowance for ATM lighting in parking garages.

SECTION 140.7 – REQUIREMENTS FOR OUTDOOR LIGHTING

EXCEPTION 6 and 8 to Subsection 140.7(a): The edits will remove an exception for ATM lighting, lighting for tunnels, and lighting for bridges.

Subsection 140.7(d)1A: The edits will add bridge(s) and tunnel(s) to the general hardscape lighting allowance calculation instructions.

Tables 140.7-A & B: The tables will be modified with new LPA values to reduce energy consumption by using LED light sources as the new baseline for calculations. Further, language will be added to establish an LPA for ATM locations, and bridges and tunnels will be included in the allowance list.

2.2.3 Standards Reference Appendices Change Summary

The proposed code change will not modify the appendices of the Standards.

2.2.4 Nonresidential Alternative Calculation Method (ACM) Reference Manual Change Summary

The proposed code change will not modify the ACM Reference Manuals.

2.2.5 Compliance Forms Change Summary

The proposed code change will not modify the Compliance Forms.

2.2.6 Simulation Engine Adaptations

The simulation engine is not anticipated to be affected by this measure.

2.2.7 Other Areas Affected

There are anticipated to be no other areas affected by this measure.

2.3 Code Implementation

2.3.1 Verifying Code Compliance

The existing code enforcement methods will remain in effect. No new compliance documents will be required, and no additional field verification or acceptance tests will be required.

2.3.2 Code Implementation

The code compliance methods currently employed by designers and builders will remain the same with this new measure. Title 24 is currently regulating LPA for Outdoor Lighting in a manner that is compatible with the changes intended with this measure. The building industry is accustomed to using the LPA limits approach that has been established in the previous versions of Title 24, and this measure maintains this infrastructure.

This measure does not add significant expense to the design or construction process.

This measure makes no changes in the inspection process.

There is no anticipated resistance to this measure from the building industry beyond the normal reluctance to lower LPA values. However, this change reflects a significant change in the lighting LPA values associated with a new technology that is considerably higher in efficacy than the previous baseline technology (PSMH). As a result, there is a need to educate the stakeholders so they understand the impacts of the measure, how the changes were calculated, and what the impacts will be on the lighting industry in the State.

While the impacts are intended to be minimized through the naturally occurring shift to LED technology, there will be some that may cause hesitancy within the stakeholders. Statewide CASE Team effort is required to make the stakeholders comfortable with the new paradigm associated with designing based on LED light sources.

2.3.3 Acceptance Testing

There are no new acceptance testing burdens created by this measure.

2.4 Issues Addressed During CASE Development Process

The Statewide CASE Team solicited feedback from a variety of stakeholders when developing the code change proposal presented in this report. In addition to personal outreach to key stakeholders, the Statewide CASE Team conducted a public stakeholder meeting to discuss the

overall concept of this proposal. The details and final analysis results of this proposal have not been fully presented to stakeholders due to the compressed CEC schedule, and a further complication with potential revision to the lighting design criteria that should be applied for the measure (IES RP-20).

The issues that have been addressed to date during development of the code change proposal are summarized below.

The IES is in the process of producing a new Recommended Practice (RP-20) that addresses parking lot and parking garage lighting design criteria. This may apply to the general hardscape lighting criteria that should be applied in the LPA calculations. At this point, the new document is not available for review and has not been approved, so it is impossible to gauge precisely what the impact of the new design criteria will be, but preliminary reports indicate that it will considerably increase light levels to meet the new criteria.

Since the document is not finalized, and because the Title 24 update process must continue on its schedule to meet the CEC's deadlines for the public process, the Statewide CASE Team has not made changes to the design criteria. However, if the new IES document does increase the energy consumption required to meet the criteria, the recommendation of the Statewide CASE Team may be to disregard the new RP-20 document and consider different sources for design criteria.

This issue is complicated by the lack of a public comment period associated with the development of this Recommended Practice (RP) document. Some RP documents and committees follow ANSI standards and include a comment period while others (RP-20 included) do not. It is the opinion of the Statewide CASE Team that this process is flawed, and that the IES must make corrective action to address this inconsistency. These documents are being presented to the building industry as the primary design 'standard', and while not legally binding, the criteria established by these documents are considered by many to be the metric for 'good practice'. As a result, there is strong pressure to accommodate the criteria established in the documents.

Unfortunately, the criteria also have the result that they impact the energy consumption of lighting systems throughout the United States, and energy codes that are moving towards lower energy consumption may be negatively affected by a change in criteria that was implemented without full consideration of the wide-ranging impacts of the changes by the small group of people on the committee. Documents produced by the IES that impact energy consumption should go through a rigorous review to ensure that the science is correct and the design criteria is reasonable to balance the need for energy efficiency and the potential benefits and drawbacks associated with increased light levels driven by a desire for higher visual performance.

3. MARKET ANALYSIS

The Statewide CASE Team performed a market analysis with the goals of identifying current technology availability, current product availability, and market trends. The Statewide CASE Team considered how the proposed standard may impact the market in general and individual market players. The Statewide CASE Team gathered information about the incremental cost of

complying with the proposed measure. Estimates of market size and measure applicability were identified through research and outreach with key stakeholders including utility program staff, CEC, and a wide range of industry players who were invited to participate in a stakeholder meeting the utility team sponsored in 2014. Some of the resources the Statewide CASE Team used to complete this task include:

- Interviews with manufacturers on outlook of technology development going forward.
- Interviews with specifiers and sales representatives and previous research on market penetration of current technology advancements.
- Review of recent market research and further interviews with market research authors and sources of ongoing projections on modifications of the market outlook.
- Modeling of current and projected impacts of trends in technology advancements on market pricing, market share, efficacy, energy savings opportunities, cost effectiveness.

3.1 Market Structure

Multiple manufacturers are producing LED lighting products for outdoor applications, including parking lot lighting, pedestrian poles, bollards, building-mounted area lights, and canopy lights. There are no concerns regarding availability of products as there are currently many available from many manufacturers.

Further, LED has become the only light source that is receiving substantial market research and development money, from both the Federal Government (through DOE research support), and independently by manufacturers working on the implementation of LED in their product lines.

3.2 Market Availability and Current Practices

The industry as a whole is anticipating the change to LED light sources. Manufacturers are actively funding R&D efforts for the LED market, putting most of their R&D funds into LED product development. (TRC 2014) As a result, manufacturers are already anticipating this change and are working to be well positioned for this market shift.

This shift is occurring rapidly in the industry, with the most rapid move to LED occurring in lighting products that are small, low wattage, with directional light distributions, and in outdoor lighting products. These categories are the most naturally-suited for LED light sources and have shown the earliest adoption of the design standard. LED has almost completely taken the market share of some types of outdoor lighting products, and many manufacturers expect this to be mostly complete in all outdoor lighting product categories by 2017 (TRC 2014).

3.3 Useful Life, Persistence, and Maintenance

The useful life of LED luminaires exceeds the 15 year measure duration considerably, and is expected to persist longer than incumbent lighting solutions in most cases. Maintenance with LED lighting products is expected to be decreased because the long life of the LED chips will remove the need for the normal lamp failure maintenance that is regularly associated with PSMH and other incumbent sources.

The methodology the Statewide CASE Team used to determine the costs associated with incremental maintenance costs, relative to existing conditions, is presented in Section 4.8.1. The incremental maintenance costs of the proposed code change are presented in Section 5.2.1.

3.4 Market Impacts and Economic Assessments

3.4.1 Impact on Builders

No substantial impacts are anticipated.

3.4.2 Impact on Building Designers

No substantial impacts are anticipated.

3.4.3 Impact on Occupational Safety and Health

The proposed code change does not alter any existing federal, state, or local regulations pertaining to safety and health, including rules enforced by the California Department of Occupational Safety and Health (Cal/OSHA). All existing health and safety rules will remain in place. Complying with the proposed code change is not anticipated to have any impact on the safety or health occupants or those involved with the construction, commissioning, and ongoing maintenance of the building.

3.4.4 Impact on Building Owners and Occupants

Over the 15-year evaluation period the energy cost savings from this measure are higher than the incremental costs. The building owners and occupants who pay energy bills are expected to benefit from cost savings over the life of the building.

3.4.5 Impact on Retailers (including manufacturers and distributors)

The proposed code change is not expected to have a significant impact on retailers.

3.4.6 Impact on Energy Consultants

The proposed code change is not expected to significantly impact energy consultants.

3.4.7 Impact on Building Inspectors

As compared to the overall code enforcement effort, this measure has negligible impact on the effort required to enforce the building codes.

3.4.8 Impact on Statewide Employment

The proposed changes to Title 24 are expected to result in positive job growth as noted below in Section 3.5. The particular measures proposed in this report are not expected to have an appreciable impact on employment in California.

3.5 Economic Impacts

The proposed Title 24 code changes, including this measure, are expected to increase job creation, income, and investment in California. As a result of the proposed code changes, it is

anticipated that less money will be sent out of state to fund energy imports, and local spending is expected to increase due to higher disposable incomes due to reduced energy costs.¹

These economic impacts of energy efficiency are documented in several resources including the California Air Resources Board's (CARB) Updated Economic Analysis of California's Climate Change Scoping Plan, which compares the economic impacts of several scenario cases (CARB, 2010b). CARB include one case (Case 1) with a 33% renewable portfolio standard (RPS) and higher levels of energy efficiency compared to an alternative case (Case 4) with a 20% RPS and lower levels of energy efficiency. Gross state production (GSP)², personal income, and labor demand were between 0.6% and 1.1% higher in the case with the higher RPS and more energy efficiency (CARB 2010b, Table 26). While CARB's analysis does not report the benefits of energy efficiency and the RPS separately, we expect that the benefits of the package of measures are primarily due to energy efficiency. Energy efficiency measures are expected to reduce costs by \$2,133 million annually (CARB 2008, pC-117) whereas the RPS implementation is expected to cost \$1,782 million annually, not including the benefits of GHG and air pollution reduction (CARB 2008, pC-130).

Macro-economic analysis of past energy efficiency programs and forward-looking analysis of energy efficiency policies and investments similarly show the benefits to California's economy of investments in energy efficiency (Roland-Holst 2008; UC Berkeley 2011).

This measure is not anticipated to have a large economic impact on the industry because it functions as a reduction in LPA allowances in the current code infrastructure. In most cases, the greatest impact will be a change in the light source technology of luminaires that are specified. There may be a reduction in the amounts of lighting equipment specified as well, but the varying methods of compliance with the reduced LPA values does not dictate that reduces equipment specifications will occur. In most cases, the wattage of the equipment specified will be reduced, but the quantities may not be greatly impacted.

3.5.1 Creation or Elimination of Jobs

CARB's economic analysis of higher levels of energy efficiency and 33% RPS implementation estimates that this scenario would result in a 1.1% increase in statewide labor demand in 2020 compared to 20% RPS and lower levels of energy efficiency (CARB 2010b, Tables 26 and 27). CARB's economic analysis also estimates a 1.3% increase in small business employment levels in 2020 (CARB 2010b, Table 32).

3.5.2 Creation or Elimination of Businesses within California

CARB's economic analysis of higher levels of energy efficiency and 33% RPS implementation (as described above) estimates that this scenario would result in 0.6% additional GSP in 2020 compared to 20% RPS and lower levels of energy efficiency (CARB 2010b, Table ES-2). We expect that higher GSP will drive additional business creation in California. In particular, local

¹ Energy efficiency measures may result in reduced power plant construction, both in-state and out-of-state. These plants tend to be highly capital-intensive and often rely on equipment produced out of state, thus we expect that displaced power plant spending will be more than off-set from job growth in other sectors in California.

² GSP is the sum of all value added by industries within the state plus taxes on production and imports.

small businesses that spend a much larger proportion of revenue on energy than other businesses (CARB 2010b, Figures 13 and 14) should disproportionately benefit from lower energy costs due to energy efficiency standards. Increased labor demand, as noted earlier, is another indication of business creation.

Table 7 below shows California industries that are expected to receive the economic benefit of the proposed Title 24 code changes. It is anticipated that these industries will expand due to an increase in funding as a result of energy efficiency improvements. The list of industries is based on the industries that the University of California, Berkeley identified as being impacted by energy efficiency programs (UC Berkeley 2011 Table 3.8).³

This list provided below is not specific to one individual code change proposal; rather it is an approximation of the industries that may receive benefit from the 2016 Title 24 code changes.

³ Table 3.8 of the UC Berkeley report includes industries that will receive benefits of a wide variety of efficiency interventions, including Title 24 Standards and efficiency programs. The authors of the UC Berkeley report did not know in 2011 which Title 24 measures would be considered for the 2016 adoption cycle, so the UC Berkeley report was likely conservative in their approximations of industries impacted by Title 24. The Statewide CASE Team believes that industries impacted by utilities efficiency programs is a more realistic and reasonable proxy for industries potentially affected by upcoming Title 24 Standards. Therefore, the table provided in this CASE Report includes the industries that are listed as benefiting from Title 24 and utility energy efficiency programs.

Table 7: Industries Receiving Energy Efficiency Related Investment, by North American Industry Classification System (NAICS) Code

Industry	NAICS Code
Residential Building Construction	2361
Nonresidential Building Construction	2362
Roofing Contractors	238160
Electrical Contractors	23821
Plumbing, Heating, and Air-Conditioning Contractors	23822
Boiler and Pipe Insulation Installation	23829
Insulation Contractors	23831
Window and Door Installation	23835
Asphalt Paving, Roofing, and Saturated Materials	32412
Manufacturing	32412
Other Nonmetallic Mineral Product Manufacturing	3279
Industrial Machinery Manufacturing	3332
Ventilation, Heating, Air-Conditioning, & Commercial Refrigeration Equipment Manufacturing	3334
Computer and Peripheral Equipment Manufacturing	3341
Communications Equipment Manufacturing	3342
Electric Lighting Equipment Manufacturing	3351
Household Appliance Manufacturing	3352
Other Major Household Appliance Manufacturing	335228
Used Household and Office Goods Moving	484210
Engineering Services	541330
Building Inspection Services	541350
Environmental Consulting Services	541620
Other Scientific and Technical Consulting Services	541690
Advertising and Related Services	5418
Corporate, Subsidiary, and Regional Managing Offices	551114
Office Administrative Services	5611
Commercial & Industrial Machinery & Equipment (exc. Auto. & Electronic) Repair & Maintenance	811310

3.5.3 Competitive Advantages or Disadvantages for Businesses within California

California businesses would benefit from an overall reduction in energy costs. This could help California businesses gain competitive advantage over businesses operating in other states or countries and an increase in investment in California, as noted below.

3.5.4 Increase or Decrease of Investments in the State of California

CARB’s economic analysis indicate that higher levels of energy efficiency and 33% RPS will increase investment in California by about 3% in 2020 compared to 20% RPS and lower levels of energy efficiency (CARB 2010b Figures 7a and 10a).

3.5.5 Incentives for Innovation in Products, Materials, or Processes

Updating Title 24 Standards will encourage innovation through the adoption of new technologies to better manage energy usage and achieve energy savings. Significant impact on product innovation is not expected through these proposed changes, as they are primarily clarifications to improve compliance.

3.5.6 Effects on the State General Fund, State Special Funds and Local Governments

The Statewide CASE Team expects positive overall impacts on state and local government revenues due to higher GSP and personal income resulting in higher tax revenues, as noted earlier. Higher property valuations due to energy efficiency enhancements may also result in positive local property tax revenues. The Statewide CASE Team has not obtained specific data to quantify potential revenue benefits for this measure.

3.5.6.1 Cost of Enforcement

There are no projected impediments to, or incentives for, innovation that would result from the proposed measures.

Cost to the State

State government already has budget for code development, education, and compliance enforcement. While state government will be allocating resources to update the Title 24 Standards, including updating education and compliance materials and responding to questions about the revised standards, these activities are already covered by existing state budgets. The costs to state government are small when compared to the overall costs savings and policy benefits associated with the code change proposals.

Cost to Local Governments

All revisions to Title 24 will result in changes to Title 24 compliance determinations. Local governments will need to train permitting staff on the revised Title 24 Standards. While this retraining is an expense to local governments, it is not a new cost associated with the 2016 code change cycle. The building code is updated on a triennial basis, and local governments plan and budget for retraining every time the code is updated. There are numerous resources available to local governments to support compliance training that can help mitigate the cost of retraining. For example, utilities offer compliance training such as “Decoding” talks to provide training and materials to local permitting departments. As noted earlier, although retraining is a cost of the revised standards, Title 24 energy efficiency standards are expected to increase economic growth and income with positive impacts on local revenue.

3.5.6.2 Impacts on Specific Persons

The proposed changes to Title 24 are not expected to have a differential impact on any of the following groups relative to the state population as a whole:

- Migrant Workers
- Persons by age
- Persons by race

- Persons by religion
- Commuters

Renters will typically benefit from lower energy bills if they pay energy bills directly.

4. METHODOLOGY

This section describes the methodology and approach the Statewide CASE Team used to estimate energy, demand, costs, and environmental impacts. The Statewide CASE Team calculated the impacts of the proposed code change by comparing existing conditions to the conditions if the proposed code change is adopted. This section of the CASE Report goes into more detail on the assumptions about the existing and proposed conditions, prototype buildings, and the methodology used to estimate energy, demand, cost, and environmental impacts.

4.1 Existing Conditions

To assess the energy, demand, costs, and environmental impacts, the Statewide CASE Team compared current design practices to design practices that would comply with the proposed requirements.

There is an existing Title 24 standard that covers the building system in question, so the existing conditions assume a building complies with the 2013 Title 24 Standards, which primarily uses PSMH as the light source technology baseline for the LPA calculations. Refer to Section 2.2 and 2.3 for more information on the standard practice of design in the industry.

4.2 Proposed Conditions

The proposed conditions are defined as the design conditions that will comply with the proposed code changes. Specifically, the proposed changes will reduce the LPA for Nonresidential Outdoor Lighting based on meeting the same (or currently relevant) design criteria using LED light sources wherever technically feasible.

4.3 Calculation Methodology

There are two different lighting calculations represented in the results, and the method used is dependent on the application. In situations where the performance criterion (other than ‘average illuminance’) is the primary basis for the calculations, a full set of simulations have been performed to produce the resultant recommendations. This is due to the fact that these conditions are primarily driven by lighting (and visual) performance requirements rather than the amount of light in the space. This is a much more time consuming set of calculations, and involves the application of a variety of different lighting products and design scenarios to test the various variables to ensure reasonable possibility to achieve the target design criteria.

The second method is an efficacy adjustment of the typical luminaires that are applied to the lighting application. This method applies to all of the conditions where the criteria is driven more by the amount of light than a specific geometry-based criterion (like ‘minimum vertical illuminance’, for example). In these cases, the incumbent light sources, including compact

fluorescent (CFL), linear fluorescent, and PSMH, were compared to comparable output LED products available now and adjusted for efficacy in 2017, to produce an LPA reduction for that application. These are all special applications, and will be layered on top of the general allowances. Table 8, Table 9, and Table 10 show a sample of the analysis that was conducted to produce the recommendations.

Table 8: Sample of Calculations for Building Entrance Baseline Scenario

Building Entrance Calculations NO CANOPY T-24 2016

Per DOE, 141% increase in luminaire LPW by January 2017

Area											Weighting				Weighted LPW			
2008 Basis of Design											LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Ballast	Luminaire	Initial Lamp Lumens	Maintained Lamp Lumens	System Watts	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	LPW								
18	CFL	Electronic	Type 'A'	1,150	990	20	802	690	0.861	35	0.20	0.10	0.05	0.00	7	3	2	0
26	CFL	Electronic	Type 'A'	1,800	1,548	28	1,193	1,026	0.860	37	0.25	0.15	0.05	0.05	9	5	2	2
32	CFL	Electronic	Type 'A'	2,400	2,064	35	1,674	1,440	0.860	41	0.25	0.20	0.15	0.10	10	8	6	4
42	CFL	Electronic	Type 'A'	3,200	2,752	46	2,232	1,920	0.860	42	0.15	0.25	0.25	0.10	6	10	10	4
50	MH	Pulse Start	Type 'B'	3,450	1,600	67	2,905	1,347	0.464	20	0.10	0.15	0.15	0.05	2	3	3	1
70	MH	Pulse Start	Type 'B'	5,600	3,300	92	4,715	2,778	0.589	30	0.05	0.10	0.20	0.10	2	3	6	3
100	MH	Pulse Start	Type 'B'	8,500	4,675	129	7,157	3,936	0.550	31	0.00	0.05	0.10	0.30	0	2	3	9
150	MH	Pulse Start	Type 'B'	14,000	11,000	190	11,998	9,427	0.786	50	0.00	0.00	0.05	0.30	0	0	2	15
											1.00	1.00	1.00	1.00	36	35	35	38

Wall Pack											Weighting				Weighted LPW			
2008 Basis of Design											LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Ballast	Luminaire	Initial Lamp Lumens	Maintained Lamp Lumens	System Watts	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	LPW								
18	CFL	Electronic	Type 'A'	1,150	990	20	802	690	0.861	35	0.20	0.10	0.05	0.00	7	3	2	0
26	CFL	Electronic	Type 'A'	1,800	1,548	28	1,193	1,026	0.860	37	0.25	0.15	0.05	0.05	9	5	2	2
32	CFL	Electronic	Type 'A'	2,400	2,064	35	1,674	1,440	0.860	41	0.25	0.20	0.15	0.10	10	8	6	4
42	CFL	Electronic	Type 'A'	3,200	2,752	46	2,232	1,920	0.860	42	0.15	0.25	0.25	0.10	6	10	10	4
50	MH	Pulse Start	Type 'C'	3,450	1,600	67	1,578	732	0.464	11	0.10	0.15	0.15	0.05	1	2	2	1
70	MH	Pulse Start	Type 'C'	5,600	3,300	92	2,561	1,509	0.589	16	0.05	0.10	0.20	0.10	1	2	3	2
100	MH	Pulse Start	Type 'C'	8,500	4,675	129	3,887	2,138	0.550	17	0.00	0.05	0.10	0.30	0	1	2	5
150	MH	Pulse Start	Type 'C'	14,000	11,000	190	6,401	5,029	0.786	26	0.00	0.00	0.05	0.30	0	0	1	8
											1.00	1.00	1.00	1.00	35	32	28	25

AVERAGE:											35	33	31	32
-----------------	--	--	--	--	--	--	--	--	--	--	-----------	-----------	-----------	-----------

An example of this calculation is given for the 18 Watt CFL (first row of the area table) in Table 8. The weighted lumens per watt (LPW) for LZ 3 is given by:

$$\text{Weighted LPW} = \text{Maintained Luminaire Lumens} \times \text{Weighting Factor} / \text{Input Watts}$$

$$\text{Weighted LPW (LZ3)} = 690 \times 0.05 / 20 = 1.7 \text{ (rounded to 2 in the table for space reasons).}$$

The weighted LPW values are added up for all other lamps types to provide an average weighted value of LPW for all lamps types that might be used for a given application in a given Lighting Zone.

A similar calculation is conducted in Table 9 for LED light sources. Table 9 includes the system lumens per watt (luminous efficacy) for LED systems in 2014 and the projected lumens per watt for 2017. Appendix B provides the rationale behind the projections of increasing luminous efficacy over the next 3 years. In Table 9, the column labelled “LPW” refers to the luminous efficacy of LED lighting system in 2017. The “LPW diff” column indicates the difference between the luminous efficacies for the first row of luminaires in Table 8 with the first row of luminaires in Table 9.

Table 9: Sample of Calculations for Building Entrance LED Scenario

Building Entrance Calculations NO CANOPY T-24 2016 LED Results

Area									Weighting				Weighted LPW			
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED Type 'A'	1,110	852	0.768	30	21	40	6	16%	0.20	0.10	0.05	0.00	8	4	2	0
LED Type 'A'	1,110	852	0.768	30	21	40	3	9%	0.25	0.15	0.05	0.05	10	6	2	2
LED Type 'B'	1,674	1,172	0.700	27	19	61	20	49%	0.25	0.20	0.15	0.10	15	12	9	6
LED Type 'B'	2,059	1,441	0.700	27	19	75	34	80%	0.15	0.25	0.25	0.10	11	19	19	8
LED Type 'C'	3,139	2,969	0.946	34	24	122	102	507%	0.10	0.15	0.15	0.05	12	18	18	6
LED Type 'C'	4,709	4,455	0.946	51	36	124	93	309%	0.05	0.10	0.20	0.10	6	12	25	12
LED Type 'C'	6,727	6,364	0.946	77	55	117	86	282%	0.00	0.05	0.10	0.30	0	6	12	35
LED Type 'C'	12,552	11,874	0.946	139	99	120	71	143%	0.00	0.00	0.05	0.30	0	0	6	36
									1.00	1.00	1.00	1.00	63	78	93	105

Wall Pack									Weighting				Weighted LPW			
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED Type 'D'	734	514	0.700	9	6	81	47	136%	0.20	0.10	0.05	0.00	24	16	8	0
LED Type 'D'	1,278	895	0.700	16	11	78	41	112%	0.25	0.15	0.05	0.05	19	12	4	4
LED Type 'E'	1,927	1,709	0.887	24	17	100	59	144%	0.25	0.20	0.15	0.10	25	20	15	10
LED Type 'F'	2,712	2,406	0.887	27	19	126	84	201%	0.15	0.25	0.25	0.10	19	31	31	13
LED Type 'E'	1,927	1,709	0.887	24	17	100	89	819%	0.10	0.15	0.15	0.05	10	15	15	5
LED Type 'F'	2,712	2,406	0.887	27	19	126	109	666%	0.05	0.10	0.20	0.10	6	13	25	13
LED Type 'E'	3,839	3,405	0.887	47	33	102	86	516%	0.00	0.05	0.10	0.30	0	5	10	31
LED Type 'G'	6,587	6,231	0.946	74	53	118	92	346%	0.00	0.00	0.05	0.30	0	0	6	35
									1.00	1.00	1.00	1.00	104	112	115	110

AVERAGE:									84	95	104	108
-----------------	--	--	--	--	--	--	--	--	-----------	-----------	------------	------------

Note that the range of typical luminaires that were modeled provides a range of design solutions that may be found in typical installations. However, there is a wattage suitability issue to these luminaires that is being addressed by the weighting factors that are found to the right side of the tables.

The weighting factors account for the lighting zones where these products are mostly likely to be employed, based on the design criteria that was established for the respective Lighting Zones. Higher wattage luminaires are weighted more heavily toward LZ3 and LZ4, where they are much more likely to be specified.

The weighting produces an adjustment where multiple luminaire types and wattages are factored into the calculations to ensure that a representative sampling of the available luminaire stock is considered.

Table 10: Sample of Calculation of Building Entrance Efficacy Adjustments

Building Entrances NO CANOPY Recommendations						
		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	30	60	90	90	W
	LPW	35	33	31	32	lm/W
2016	LPW	84	95	104	108	lm/W
	Change	13	21	27	26	Limit of Reduction
	Proposed	15	25	35	45	W

In all of these calculation sheets, the limits of the *possible* adjustment are presented (Limit of Reduction), and the *proposed* adjustment for Title 24 is also shown. In many cases the reductions are not nearly as aggressive as the LED light source calculations find to be technically possible. As this is the first opportunity to base Title 24 requirements on LED light sources, the Statewide CASE Team used a conservative approach. This approach provides a less significant reduction than may ultimately be possible, but the lighting design industry must become comfortable with the changing paradigm that LEDs represent before more aggressive LPA reductions can be implemented.

As an example in Table 10, Lighting Zone 3 currently has a lighting power allowance of 90 Watts per entrance. From our lighting model we estimate that this corresponds to an overall lighting system luminous efficacy of 31 lumens per Watt as shown above; the details how this 31 lm/W was calculated is shown in Table 8. The actual value is 31.4, rounded to 31 for space purposes. As shown in Table 10, the proposed system efficacy for LED entrance lighting systems is 104 lumens per watt for LZ3 (103.8 rounded to 104). From this information we can calculate the overall lumens per entrance delivered by CFLs or metal halide lighting using the current LPA and from this calculate the minimum amount of watts to provide the same amount for lumens by an LED system.

$$\text{Current Lumens (LZ3)} = \text{Current Allowance [Watts]} \times \text{Current System Efficacy [lm/W]}$$

$$\text{Current Allowed Lumens (LZ3)} = 90 \text{ W} \times 31.4 \text{ lm/W} = 2826 \text{ lumens}$$

$$\text{Minimum Proposed Watts (LZ3)} = \text{Current Allowed Lumens} / \text{Proposed System Efficacy}$$

$$\text{Minimum Proposed Watts (LZ3)} = 2826 \text{ Lumens} / 103.8 \text{ Lm/W} = 27.2 \text{ Watts per entrance}$$

Though 27.2 Watts per entrance is the lowest possible wattage allowance that could be proposed, this proposal is conservative and allows higher lighting wattage allowances. In this case the proposed lighting power allowance for LZ3 is 35 lumens per watt – 30% higher than the minimum wattage that could be technically justified, but still achieving a reduction of 62% of lighting power as compared to the current allowance of 90 Watts per entrance.

Appendix C contains these calculations for all outdoor lighting applications evaluated.

4.4 Prototype Building Sites

This measure applies only to exterior lighting conditions, so the CEC building prototypes are not applicable. Instead, the Statewide CASE Team established nine building site prototypes to model representative site conditions; varying from an efficient (square) site with a simple building footprint and hardscape layout to more complex, less ideal site conditions. These prototypes enabled the Statewide CASE Team to compare LPA values in practical lighting layout conditions that represent the reasonable spectrum of conditions that may be encountered during a design project.

Further details on these sites are available in Appendix D.

Table 11 presents the details of the prototype sites used in the analysis.

Table 11: Prototype Sites used for Energy Impact Analysis

	Possible Occupancy Type	Hardscape Area (Square Feet)	Hardscape Perimeter (Feet)	Perimeter to Area %	Notes
Prototype A	Office / Retail	501,626	6,794	1.4%	Long skinny site, big building
Prototype B	Retail	471,726	5,131	1.1%	Square site, irregular building
Prototype C	Retail	42,828	3,052	7.1%	Irregular site, campus buildings
Prototype D	Retail	28,500	960	3.4%	Long skinny site, small building
Prototype E	Retail / Office / Industrial	21,000	760	3.6%	Square site, small square building
Prototype F	Retail / Office / Industrial	61,798	1,940	3.1%	Irregular site, long square building
Prototype G	Retail / Office / Industrial	21,797	1,408	6.5%	Long skinny site, irregular building
Prototype H	Retail / Office / Industrial	11,040	1,042	9.4%	Square site, large square building
Prototype J	Retail / Office / Industrial	34,735	2,593	7.5%	Irregular site, large irregular building

Additionally, one idealized site was calculated, which represents the best possible conditions likely to occur in normal nonresidential properties. This is a relatively large square site, with no building. These characteristics make it likely to produce as efficient a site as possible for lighting purposes.

Table 12: Additional Ideal Prototype Site used for Energy Impact Analysis

	Possible Occupancy Type	Hardscape Area (Square Feet)	Hardscape Perimeter (Feet)	Perimeter to Area %	Notes
Prototype K	Parking	250,000	2,000	0.8%	Ideal square site

The Statewide CASE Team developed a basic lighting and electrical layout to use with three additional sites to conduct cost effectiveness calculations. This is a much more detailed calculation of the lighting and electrical design necessary to meet the design criteria. The sites vary in size and complexity to represent the range of conditions that are typically found on sites. This provided the information needed for pricing exercises to estimate incremental costs.

Further details on these sites are also available in Appendix D. Table 13 below, presents the details of the three prototype sites used for cost evaluation analysis.

Table 13: Prototype Sites used for Cost Impact Analysis

	Site Description	Site Hardscape Area (Square Feet)	Hardscape Perimeter (Feet)	Perimeter to Area Percentage	Notes
Prototype Large	Large parking (only)	195,119	1,896	1.0%	'Efficient' site conditions
Prototype Medium	Med. parking with building	34,480	982	2.9%	Typical small retail location
Prototype Small	Small parking with building	14,622	588	4.0%	Typical small gas station

4.5 Climate Dependent

This lighting measure is not climate dependent in its specific direct energy impacts, but is climate dependent when considering the impacts of the reductions in TDV.

4.6 Time Dependent Valuation

The TDV (Time Dependent Valuation) of savings is a normalized format for comparing electricity and natural gas savings that takes into account the cost of electricity and natural gas consumed during different times of the day and year. The TDV values are based on long term discounted costs (30 years for all residential measures and nonresidential envelope measures and 15 years for all other nonresidential measures). In this case, the period of analysis used is 15 years. The TDV cost impacts are presented in 2017 present value dollars. The TDV energy estimates are based on present-valued cost savings but are normalized in terms of “TDV kBTUs” so that the savings are evaluated in terms of energy units and measures with different periods of analysis can be combined into a single value.

CEC derived the 2016 TDV values that were used in the analyses for this report (CE 2014). The TDV energy impacts are presented in Section 5.1 of this report, and the statewide TDV cost impacts are presented in Section 5.2.

4.7 Energy Impacts Methodology

The Statewide CASE Team calculated per unit impacts and statewide impacts associated with all new construction during the first year buildings complying with the 2016 Title 24 Standards.

This analysis defined the effective wattage allowance that accommodates a reasonable cross-section of the sites that may occur in the State. The effective wattage allowance combines the Initial Wattage Allowance, the Area Wattage Allowance, and the Linear Wattage Allowance into a single value that can characterize the impacts in a single, per square foot value, and can be scaled up for statewide calculations.

The Statewide CASE Team estimated the energy impact calculation by first estimating the Outdoor LPA values for component applications, and then extrapolating the estimates to the entire state through CEC building construction forecasts with a translation for the square footage of hardscape associated with typical nonresidential construction.

Appendix E contains seven lighting schedules that are weighted and applied to each of the lighting applications evaluated. Thus each lighting application has a differing number of full load hours that accounts for the different schedules for how long lights are on and, for hardscape areas which have bi-level motion controlled lighting, the hours which some of the lights are dimmed down due to no movement in the surrounding area.

4.7.1 Per Unit Energy Impacts Methodology

The Statewide CASE Team estimated the electricity savings associated with the proposed code change. The energy savings were calculated on a per square foot basis.

The energy savings for this measure will result from reductions in LPA allowances. Therefore, the primary basis for calculating energy savings is a spreadsheet-based analysis that takes into account a variety of variables:

- Reductions in LPA values within Tables 140.7 A & B
- Impacted area of LPA reduction (for some situations where the area is not explicitly defined)
- Occupancy and use profiles for various outdoor applications
- Prototype sites employed for effective wattage/square foot reduction calculations.

Analysis Tools

The analysis is completed using the outdoor lighting application types, and predicted through the TDV calculation based on energy use curves sourced through the ACM and industry knowledge of typical hours of operation for nonresidential buildings in conjunction with the assumptions listed below.

Key Assumptions

CEC provided a number of key assumptions to be used in the energy impacts analysis (CEC 2014). Some of the assumptions included in CEC’s Lifecycle Cost Methodology Guidelines (LCC Methodology) include hours of operation, weather data, and prototype building design. The key assumptions used in the per unit energy impacts analysis that are not already included in the assumptions provided in the LCC Methodology are presented in Table 14.

Table 14: Key assumptions for per unit Energy Impacts Analysis

Parameter	Assumption	Source	Notes
Light source efficacy projections	LED products are rapidly improving	(DOE 2013) and manufacturer interviews	The efficacy increase is modeled in the supporting documents in Appendix B.

4.7.2 Statewide Energy Impacts Methodology

Outdoor nonresidential construction is not included in the construction forecasts, so the impact of the various lighting measures must be predicted based on other metrics that rely on indoor construction square footage as the basis of measurement. Assumptions for how the individual line items of the measure are calculated to the statewide impacts are presented below.

Translation of Lighting Zones to Statewide Impacts

The definition of the Lighting Zones is tied to the US Census (2010), and is related to the classification of land mass designated as Urban or Rural, which is the demarcation line between Lighting Zone 2 (rural) and Lighting Zone 3 (urban).

Table 15: Lighting Zone Area and Likely Construction Activity within the Respective Lighting Zones in the State

Lighting Zone	Percent of Land Mass (Source: 2010 US Census)	Percent of Construction Activity (Estimate)
LZ0	9	0
LZ1	1	0.1
LZ2	85	9.9
LZ3	5	90
LZ4	0	0

Note that the Census data only provides information on land mass in LZ0, LZ1, and LZ2 as a single group, and similarly, LZ3 and LZ4 as another group. LZ4 has not been employed in the state by any jurisdiction, and LZ2 represents the preponderance of the state area outside designated State and National parks.

At least 90% of electricity consumption is designated to urban areas in the Census, and as a result, the strong majority of new construction activity is also centered on the urban centers. (RLW 2002a)

The Census designations of Urban and Rural are not directly equivalent to the developed ZIP Codes in the state, which are employed for the State mapping. The Census data uses larger blocks for the mapping, so there may be are likely segments of rural land that are captured in the Urban Census designation due to the population within the larger Census block. The Urban areas in the state are growing at a higher pace than the construction forecasts might directly project.

Translation of Individual Line Items to Statewide Impacts

Since the outdoor hardscape is not estimated as part of the construction forecasts, statewide impacts must be completed by making proxies with reasonable estimates of the relationship of the line item to the potential gross square footage of indoor spaces associated with the measure.

In effect, the estimates relate the unit of the measure (square foot of hardscape, for example), with an equivalent unit of gross interior space, which can then be projected using the constructions forecasts.

Assumptions regarding how the individual line items of the measure are calculated to the statewide impacts are presented in Table 16 below.

Table 16: Proxy Assumptions for Statewide Impacts Estimate Calculations for Specific Applications

Assumptions for Statewide Estimates - Specific Applications		Applied to % of Building S.F. in Category									
		Office, LG & SM	Retail	Restaurant	Food (Grocery)	Warehouse, Ref & NR	Hotel	School	College	Other	
Lighting Allowance	Assumptions										
Building Entrances or Exits	1 per 5000 sf of building interior (20 occupants per door, 250 occ/sf)	100%	100%	100%	100%	100%	100%	100%	100%	99%	
Primary Entrances to Senior Care Facilities, Police Stations, Hospitals, Fire Stations, and Emergency Vehicle Facilities	1 per 5000 SF of gross building area (1 primary entrance per building)									1%	
Drive Up Windows	1 per 1500 SF of gross building area (2 locations per building; 1000 sf building)			30%							
Vehicle Service Station Uncovered Fuel Dispenser	1 per 100 sf of gross building area (1 fuel dispenser face per 25 sf of station building interior)									0.01%	
Automated Teller Machines	400W MH luminaire as typical standard practice, switch to 250W limit for first location, 2500 sf per ATM installation.									1%	
Outdoor Sales Frontage	0.2 LF per sf of gross building area (1 display parking space per 50 sf of building interior)									1.5%	
Hardscape Ornamental Lighting	0.1 SF per SF of gross building area	50%	50%	50%	25%		50%	25%	25%	5%	
Building Facades	30' building height, 2 floors per building (20% of applicable facades are lit)	25%	50%	50%	25%		50%	25%	25%	5%	
Outdoor Sales Lots	4 SF of sales lot per sf of gross building area (1 display parking space per 50 sf of building interior)									1.5%	
Vehicle Service Station Hardscape	11 SF per SF of gross building area									1%	
Vehicle Service Station Canopies	1.2 SF of canopy per SF of gross building area									1%	
Sales Canopies	0.1 SF of canopy per SF of gross building area									5%	
Non-sales Canopies	0.1 SF of canopy per SF of gross building area	25%	25%	25%	25%		25%	25%	25%	5%	
Guard Stations	0.00043 sf per SF of gross building area (1 12x18 guard station per 500,000 sf of total construction)	100%				100%			100%	100%	
Student Pick-up/Drop-off zone	0.0173 sf per SF of gross building area (1 12x72 drop off per 50,000 sf of total construction)							100%			
Outdoor Dining	1 sf per 5 sf of gross building area (20% of typical building sf)		2.5%	50%	2.5%						
Special Security Lighting for Retail Parking and Pedestrian Hardscape	1 SF per 100 SF gross building SF (1% of hardscape)		100%	100%	100%					50%	

Most measure line items only apply to certain building types (retail or small office, for example), and this is taken into account as well.

The general hardscape values are based in part on the requirements for parking spaces in building development codes in the Los Angeles, San Diego and Bay areas. These requirements produce a net impact of approximately one square foot of hardscape for each square foot of

gross building area developed. An urban development may have much less than this (relying on on-street parking, for example), but suburban sites are much more likely to have higher values, and the majority of construction is estimated to be in the lower density regions of the State as they still have available room for new construction.

Table 17 below provides assumed ratio of building square footage per parking space and the resulting ratio of hardscape area to new building area in the statewide construction forecasts, using 250 square feet as the basic unit of area per parking space. For more detailed information on the method used to derive this, refer to Appendix G at the end of the report.

Table 17: Proxy Assumptions for Statewide Impacts Estimate Calculations for General Hardscape

Assumptions for Statewide Estimates - General Hardscape		Area Multipliers for Construction S.F.
General Hardscape	Assumptions	
for Large Office, Small Office, Food, Restaurant, College	1 parking space per 250 sf of gross building area	1
for Hotel, Retail, School, Other	1 parking space per 360 sf of gross building area	0.7
for NR Warehouse, Ref. Warehouse	1 parking space per 830 sf of gross building area	0.3

First Year Statewide Impacts

The Statewide CASE Team estimated statewide impacts for the first year of construction complying with the 2016 Title 24 Standards by multiplying per unit savings estimates by statewide construction forecasts that have been translated to estimate associated outdoor hardscape area.

There are several aspects of the statewide estimates that add complexity to the calculation. These are:

1. Construction estimates of the square footage of outdoor hardscape are not included in statewide construction forecasts, and therefore must be estimated by the use of a proxy.
2. The construction forecasts do not predict construction activity based on the Lighting Zones, as defined in Title 24, and therefore another translation must be performed to predict the statewide impacts based on the area of each individual Lighting Zone, and modified by anticipated construction activity weighted for each Lighting Zone.
3. The actual amount of lighting employed on the hardscape is not clearly known. There is evidence that it may be somewhat less than a fully lighted condition in some cases (RLW 2002). The Statewide CASE Team analysis adjusted the full allowance downward to accommodate sites that are not fully lighted.

The CEC Demand Analysis Office provided the Statewide CASE Team with the nonresidential new construction forecast for 2017, broken out by building type and forecast climate zones (FCZ). The Statewide CASE Team translated this data to building climate zones (BCZ) using the same weighting of FCZ to BCZ as the previous code update cycle (2013), as presented in

Table 19. The projected nonresidential new construction forecast is presented in Table 20. Table 18 provides a definition of the various space types used in the forecast.

Table 18: Description of Space Types used in the Nonresidential New Construction Forecast

OFF-SMALL	Offices less than 30,000 ft ²
OFF-LRG	Offices larger than 30,000 ft ²
REST	Any facility that serves food
RETAIL	Retail stores and shopping centers
FOOD	Any service facility that sells food and or liquor
NWHSE	Nonrefrigerated warehouses
RWHSE	Refrigerated Warehouses
SCHOOL	Schools K-12, not including colleges
COLLEGE	Colleges, universities, community colleges
HOSP	Hospitals and other health-related facilities
HOTEL	Hotels and motels
MISC	All other space types that do not fit another category

Table 19. Translation from FCZ to BCZ

Source: CEC Demand Analysis Office

		Building Standards Climate Zones (BCZ)																Grand Total	
		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16		
Forecast Climate Zones (FCZ)	1	22.5%	20.6%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	9.8%	33.1%	0.2%	0.0%	0.0%	13.8%	100%	
	2	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	22.0%	75.7%	0.0%	0.0%	0.0%	2.3%	100%	
	3	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	21.0%	22.8%	54.5%	0.0%	0.0%	1.8%	100%	
	4	0.2%	13.7%	8.4%	46.0%	8.9%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	22.8%	0.0%	0.0%	0.0%	0.0%	100%	
	5	0.0%	4.2%	89.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	6.6%	0.0%	0.0%	0.0%	0.0%	100%	
	6	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%	100%	
	7	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	75.8%	7.1%	0.0%	17.1%	100%	
	8	0.0%	0.0%	0.0%	0.0%	0.0%	40.4%	0.0%	51.1%	8.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.5%	100%
	9	0.0%	0.0%	0.0%	0.0%	0.0%	7.0%	0.0%	24.5%	57.9%	0.0%	0.0%	0.0%	0.0%	6.7%	0.0%	4.0%	100%	
	10	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	74.9%	0.0%	0.0%	0.0%	12.3%	7.9%	4.9%	100%	
	11	0.0%	0.0%	0.0%	0.0%	0.0%	33.0%	0.0%	24.8%	42.2%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100%
	12	0.0%	0.0%	0.0%	0.0%	0.0%	0.9%	0.0%	20.2%	75.2%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	3.7%	100%
	13	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	69.6%	0.0%	0.0%	28.8%	0.0%	0.0%	0.0%	1.6%	0.1%	0.0%	100%	
	14	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100%
	15	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	99.9%	0.0%	100%	
	16	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100%
	17	3.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	97.1%	100%

Table 20: Estimated New Nonresidential Construction in 2017 by Climate Zone and Building Type (Million Square Feet)

Source: CEC Demand Analysis Office

Climate Zone	New Construction in 2017 (Million Square Feet)												TOTAL
	OFF-SMALL	OFF-LRG	REST	RETAIL	FOOD	NWHSE	RWHSE	SCHOOL	COLLEGE	HOSP	HOTEL	MISC	
1	0.058	0.069	0.016	0.041	0.014	0.040	0.002	0.046	0.018	0.028	0.031	0.094	0.457
2	0.227	1.140	0.088	0.630	0.163	0.327	0.031	0.244	0.163	0.200	0.350	0.742	4.306
3	0.728	4.952	0.408	2.913	0.677	2.518	0.183	1.000	0.625	0.729	1.400	3.894	20.026
4	0.484	2.935	0.190	1.586	0.413	0.595	0.071	0.541	0.408	0.490	0.890	1.641	10.245
5	0.094	0.570	0.037	0.308	0.080	0.116	0.014	0.105	0.079	0.095	0.173	0.319	1.990
6	0.811	2.264	0.825	3.072	0.756	2.649	0.122	0.659	0.649	0.508	0.571	4.144	17.030
7	0.959	1.253	0.300	1.635	0.502	1.004	0.013	0.772	0.448	0.325	1.059	3.077	11.347
8	1.078	3.186	1.106	4.241	1.034	3.588	0.162	0.856	0.931	0.773	0.872	5.860	23.686
9	0.971	5.675	0.916	3.975	0.937	3.287	0.119	0.600	1.095	1.127	1.329	5.376	25.408
10	1.372	1.496	0.707	2.995	0.839	2.630	0.074	0.883	0.580	0.528	1.056	8.010	21.170
11	0.333	0.629	0.088	0.770	0.268	0.875	0.089	0.504	0.156	0.239	0.197	0.737	4.885
12	1.710	4.721	0.502	3.656	1.014	3.157	0.202	1.687	0.678	1.048	1.480	3.637	23.493
13	0.668	0.817	0.205	1.606	0.544	1.706	0.286	1.401	0.390	0.520	0.359	1.884	10.387
14	0.224	0.431	0.138	0.609	0.162	0.527	0.025	0.156	0.128	0.115	0.185	1.472	4.171
15	0.349	0.289	0.096	0.675	0.238	0.761	0.022	0.192	0.098	0.133	0.204	1.123	4.180
16	0.199	0.394	0.106	0.506	0.142	0.449	0.042	0.205	0.122	0.125	0.144	0.931	3.367
TOTAL	10.264	30.821	5.729	29.218	7.784	24.228	1.457	9.852	6.570	6.983	10.301	42.941	186.148

4.8 Cost-effectiveness Methodology

This measure proposes a mandatory requirement. As such, a lifecycle cost analysis is required to demonstrate that the measure is cost-effective over the 15 year period of analysis.

CEC's procedures for calculating lifecycle cost-effectiveness are documented in LCC Methodology (CEC 2014). The Statewide CASE Team followed these guidelines when developing the Cost-effectiveness Analysis for this measure. CEC's guidance dictated which costs were included in the analysis. Incremental equipment and maintenance costs over the 15 year period of analysis were included. The TDV energy cost savings from electricity savings were considered. Each of these components is discussed in more detail below.

Design costs were not included.

4.8.1 Incremental Cost Methodology

The Statewide CASE Team estimated the incremental cost of LED lighting products based on current costs (sourced from sales representatives for manufacturers) and reductions in the cost per kilolumen of LED light source technology as detailed in a report to the DOE from Navigant (Navigant 2012). These estimates are reinforced using cost projections from another DOE study that provided cost estimates of actual luminaire product categories (DOE 2013).

The Statewide CASE Team estimated costs for non-volatile products (poles, foundations, etc.) based on a mix of manufacturer's sales representative price quotes and general pricing experience through multiple construction projects. Costs for commodity items and labor (conductors, conduit, trenching, installation or equipment, etc.) are based on RS Means estimates collected during June 2014.

The Statewide CASE Team compared prices for three installation scenarios, which are the detailed project installation cost comparison examples described in Appendix F below.

Incremental Construction Cost Methodology

As requested by CEC, the Statewide CASE Team estimated the Current Incremental Construction Costs and Post-adoption Incremental Construction Costs. The Current Incremental Construction Cost (ΔCI_C) represents the cost of the incremental cost of the measure if a building meeting the proposed standard were built today. The Post-adoption Incremental Construction Cost (ΔCI_{PA}) represents the anticipated cost assuming full market penetration of the measure as a result of the new Standards, resulting in possible reduction in unit costs as manufacturing practices improve over time and with increased production volume of qualifying products the year the Standard becomes effective.

For the general hardscape allowance, the Statewide CASE Team designed a lighting system to meet criteria for the same site conditions using an incumbent light source technology (PSMH) and the new baseline (LED). These two systems are optimized to efficiently meet lighting design criteria, the electrical needs of the system, and physical issues (pole heights, foundations, etc.).

Finally, the Statewide CASE Team estimated costs for the two systems using projected costs of LED in 2017 and current costs for PSMH products. This approach was applied to three

different sites to produce a reasonable estimate of the impact on a variety of site conditions. The cost difference between these scenarios provides the incremental cost of this measure.

For the specific lighting allowances in Table 140.7-B, the LED light source is unlikely to be able to substantially change the designs because there are other factors that determine the equipment locations and quantities. In these circumstances, a luminaire cannot be compared directly with other system changes being considered (an incumbent technology luminaire compared to an LED luminaire with no impacts on wiring, etc.). This simplifies the calculations, but will underestimate the positive impacts of the reduced wattage of the luminaires. Key assumptions used to derive cost are presented in Table 21.

Table 21: Key Assumptions for per unit Incremental Construction Cost

Parameter	Assumption	Source	Notes
Product Cost projections	LED costs are dropping rapidly	(DOE 2013) and manufacturer interviews for confirmation	The cost of lighting products in 2017 is modeled in the supporting documents in Appendix B.

Incremental Maintenance Cost Methodology

Maintenance costs associated with LED lighting products are generally a reduction from the incumbent technology. The LCC analysis uses a 15 year life cycle, during which no maintenance is expected for any of the LED lighting equipment because the products are still within their life expectancy at that time (approximately 65,000 hours of operation). As a result, the maintenance impacts result in savings related to the elimination of typical cyclic maintenance associated with the lighting equipment (primarily lamp and ballast replacement with failure). This varies by lamp type and wattage, so the Statewide CASE Team used a reasonable cross-section of incumbent lamps to calculate maintenance costs for incumbent and LED systems.

4.8.2 Cost Savings Methodology

Energy Cost Savings Methodology

The PV of the energy savings were calculated using the method described in the LCC Methodology (CEC 2014). In short, the hourly energy savings estimates for the first year of building operation were multiplied by the 2016 TDV cost values to arrive at the PV of the cost savings over the 15 year period of analysis. This measure is not climate sensitive, so the hourly energy cost savings were calculated using the population-weighted TDV values.

Other Cost Savings Methodology

Other than maintenance cost savings, this measure does not have any non-energy cost savings.

4.8.3 Cost-effectiveness Methodology

The Statewide CASE Team calculated the cost-effectiveness using the LCC Methodology (CEC 2014). According to CEC’s definitions, a measure is cost effective if it reduces overall lifecycle cost from the current base case (existing conditions). The LCC Methodology clarifies that absolute lifecycle cost of the proposed measure does not need to be calculated. Rather, it is necessary to calculate the change in lifecycle cost from the existing conditions to the proposed conditions.

If the change in lifecycle cost is negative, the measure is cost-effective, meaning that the present value of TDV energy savings is greater than the cost premium.

The Planning Benefit to Cost (B/C) Ratio is another metric that can be used to evaluate cost-effectiveness. The B/C Ratio is calculated by dividing the total present value TDV energy cost savings (the benefit) by the present value of the total incremental cost (the cost). If the B/C Ratio is greater than 1.0 (i.e. the present valued benefits are greater than the present valued costs over the period of analysis), then the measure is cost effective.

4.9 Environmental Impacts Methodology

4.9.1 Greenhouse Gas Emissions Impacts Methodology

Greenhouse Gas Emissions Impacts Methodology

The Statewide CASE Team calculated avoided GHG emissions assuming an emission factor of 353 metric tons of carbon dioxide equivalents (MTCO₂e) per GWh of electricity savings. As described in more detail in Appendix A, the electricity emission factor represents savings from avoided electricity generation and accounts for the GHG impacts if the state meets the Renewable Portfolio Standard (RPS) goal of 33 percent renewable electricity generation by 2020. Avoided GHG emissions from natural gas savings were calculated using an emission factor of 5,303 MTCO₂e/million therms (U.S. EPA 2011).

4.9.2 Water Use Impacts Methodology

There are no impacts on water use or water quality.

4.9.3 Material Impacts Methodology (Optional)

The Statewide CASE Team did not develop estimates of material impacts.

4.9.4 Other Impacts Methodology

There are no other impacts from the proposed code change.

5. ANALYSIS AND RESULTS

Results from the energy, demand, cost, and environmental impacts analyses are presented in this section. The reduction in LPA values is approximately 40% for the general allowances applied to the general hardscape.

5.1 Energy Impacts Results

Lighting Recommendations Table

Table 22 below, represents the complete set of recommendations of the LPA values for the outdoor lighting applications in Section 140.7. All of the values represented in Tables 140.7-A and 140.7-B are included below.

Table 22: Outdoor Lighting LPA Recommendations Table

Allowance		Units	2013				2016 Proposed			
			Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4	Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4
General Hardscape Allowance	Area Wattage Allowance (AWA)	W/s	0.035	0.045	0.090	0.115	0.020	0.030	0.040	0.050
	Linear Wattage Allowance (LWA)	W/lf	0.25	0.45	0.60	0.85	0.15	0.25	0.35	0.45
Allowance per Application	Initial Wattage Allowance (IWA)	W	340	510	770	1030	340	450	520	640
	Building Entrances or Exits	W	30	60	90	90	15	25	35	45
	Primary Entrances to Senior Care Facilities, Police Stations, Hospitals, Fire Stations, and Emergency Vehicle Facilities.	W	45	80	120	130	20	40	60	80
	Drive Up Windows	W	40	75	125	200	30	40	60	100
	Vehicle Service Station Uncovered Fuel Dispenser.	W	120	175	185	330	80	100	140	160
	Automated Teller Machines	W	Not Included				250 W for first ATM plus 70 W per add'l ATM			
Allowance per Unit Length	Outdoor Sales Frontage	W/lf	No allowance	22.5	36	45	No allowance	15	25	30
Allowance per Hardscape Area	Hardscape Ornamental Lighting	W/sf	No allowance	0.020	0.040	0.060	No allowance	0.015	0.030	0.045
Allowance per Specific Area	Building Facades	W/sf	No allowance	0.18	0.35	0.50	No allowance	0.15	0.25	0.35
	Outdoor Sales Lots	W/sf	0.164	0.555	0.758	1.285	0.100	0.250	0.500	1.000
	Vehicle Service Station Hardscape	W/sf	0.014	0.155	0.308	0.485	0.010	0.100	0.150	0.200
	Vehicle Service Station Canopies	W/sf	0.514	1.005	1.300	2.200	0.400	0.700	0.900	1.200
	Sales Canopies	W/sf	No allowance	0.655	0.908	1.135	No allowance	0.500	0.800	1.000
	Non-sales Canopies	W/sf	0.084	0.205	0.408	0.585	0.080	0.160	0.300	0.400
	Guard Stations	W/sf	0.154	0.355	0.708	0.985	0.100	0.300	0.500	0.750
	Student Pick-up/Drop-off zone	W/sf	No allowance	0.15	0.45	No allowance	No allowance	0.10	0.25	No allowance
	Outdoor Dining	W/sf	0.014	0.135	0.240	0.400	0.010	0.100	0.150	0.200
Special Security Lighting for Retail Parking and Pedestrian Hardscape	W/sf	0.007	0.009	0.019	No allowance	0.005	0.007	0.012	No allowance	

Table 23, below, represents the complete set of recommendations of the LPA values for the outdoor lighting applications in Section 140.7 and the percentage reduction for the LPA values based on this recommendation. All of the values represented in Tables 140.7-A and 140.7-B are included below.

Table 23: Outdoor Lighting LPA Recommendations Reduction Percentage Table

Allowance		Units	2016 Proposed & Reduction Percentage							
			Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4	LZ1 Reduced By:	LZ2 Reduced By:	LZ3 Reduced By:	LZ3 Reduced By:
General Hardscape Allowance	Area Wattage Allowance (AWA)	W/s	0.020	0.030	0.040	0.050	43%	33%	56%	57%
	Linear Wattage Allowance (LWA)	W/lf	0.15	0.25	0.35	0.45	40%	44%	42%	47%
	Initial Wattage Allowance (IWA)	W	340	450	520	640	No Change	12%	32%	38%
Allowance per Application	Building Entrances or Exits.	W	15	25	35	45	50%	58%	61%	50%
	Primary Entrances to Senior Care Facilities, Police Stations, Hospitals, Fire Stations, and Emergency Vehicle Facilities.	W	20	40	60	80	56%	50%	50%	38%
	Drive Up Windows.	W	30	40	60	100	25%	47%	52%	50%
	Vehicle Service Station Uncovered Fuel Dispenser.	W	80	100	140	160	33%	43%	24%	52%
	Automated Teller Machines.	W	250 W for first ATM plus 70 W per add'l ATM				New Allowance			
Allowance per Unit Length	Outdoor Sales Frontage.	W/lf	No allowance	15	25	30	No Change	33%	31%	33%
Allowance per Hardscape Area	Hardscape Ornamental Lighting.	W/sf	No allowance	0.015	0.030	0.045	No Change	25%	25%	25%
Allowance per Specific Area	Building Facades.	W/sf	No allowance	0.15	0.25	0.35	No Change	17%	29%	30%
	Outdoor Sales Lots.	W/sf	0.100	0.250	0.500	1.000	39%	55%	34%	22%
	Vehicle Service Station Hardscape.	W/sf	0.010	0.100	0.150	0.200	29%	35%	51%	59%
	Vehicle Service Station Canopies.	W/sf	0.400	0.700	0.900	1.200	22%	30%	31%	45%
	Sales Canopies.	W/sf	No allowance	0.500	0.800	1.000	No Change	24%	12%	12%
	Non-sales Canopies.	W/sf	0.080	0.160	0.300	0.400	5%	22%	26%	32%
	Guard Stations.	W/sf	0.100	0.300	0.500	0.750	35%	15%	29%	24%
	Student Pick-up/Drop-off zone.	W/sf	No allowance	0.10	0.25	No allowance	No Change	33%	44%	No Change
	Outdoor Dining.	W/sf	0.010	0.100	0.150	0.200	29%	26%	38%	50%
Special Security Lighting for Retail Parking and Pedestrian Hardscape.	W/sf	0.005	0.007	0.012	No allowance	29%	22%	37%	No Change	

5.1.1 Per Unit Energy Impacts Results

Table 24 below provides information on the per unit results for a comparison of the general hardscape lighting for ten different prototypical sites, comparing the results from an incumbent technology approach to an LED light source approach.

The sites include nine different site layouts, with a range of sizes and building complexity. One additional site is included that represents an ‘ideal’ site; the most efficient site that can be produced in a rectangular shape. For more details on the sites, refer to Appendix D at the end of the report.

This analysis establishes an effective wattage allowance that accommodates a reasonable cross-section of the sites that may occur in the State. The effective wattage allowance combines the Initial Wattage Allowance, the Area Wattage Allowance, and the Linear Wattage Allowance values found in Table 140.7-A of the Code into a single value that can

characterize the impacts in a per square foot value of hardscape and can be scaled up for statewide calculations.

Table 24: Effective Power Density Impacts per Square Foot of General Hardscape

Lighting Zone	Per Unit Lighting Power Density		
	Average of Prototypes, 2013 Standard	Average of Prototypes, Proposed 2016 Values	Power Density Reduction (W/sf)
LZ1	0.056	0.037	0.019
LZ2	0.080	0.053	0.026
LZ3	0.139	0.068	0.072
LZ4	0.183	0.089	0.094

Note that the Lighting Zone is not the same as a Climate Zone. Lighting Zones are related primarily to population density, and are tied to the 2010 US Census. The correlation of Lighting Zones to Climates Zones and the resulting statewide impacts will be made in the next section.

Per unit energy and demand impacts for the general hardscape of the proposed measure are presented in Table 25. These are off-peak loads, so peak demand is not anticipated to be affected.

This measure is not anticipated to produce any peak energy demand savings, based on the nature of the nighttime operation of outdoor lighting systems. Therefore demand savings in this measure are assigned the ‘N/A’ designation.

Table 25: Energy Impacts per Square Foot – General Hardscape

Lighting Zone	Per Unit First Year Savings ¹			Per Unit TDV Savings ²
	Electricity Savings ³ (kWh/yr)	Demand Savings (kW)	Natural Gas Savings (Therms/yr)	TDV Electricity Savings ⁴ (2017 \$)
LZ1	0.076	N/A	N/A	0.13
LZ2	0.10	N/A	N/A	0.17
LZ3	0.28	N/A	N/A	0.47
LZ4	0.37	N/A	N/A	0.62

1. Savings from one square foot for the first year the site is in operation.
2. TDV energy savings for one square foot over the 15 year period of analysis.
3. Site electricity savings. Does not include TDV of electricity savings.
4. Calculated using CEC’s 2016 TDV factors and methodology. Includes savings from electricity.

The energy impacts per unit for the specific applications found in Table 140.7-B of the Code are presented for Lighting Zones 1 – 4 in Table 26, Table 27, Table 28 and Table 29, respectively.

Table 26: Energy Impacts per Unit – Other Line Items LZ1

Lighting Application	Per Unit First Year Savings ¹				Per Unit TDV Savings ²
	Units	Electricity Savings ³ (kWh/yr)	Demand Savings (kW)	Natural Gas Savings (Therms/yr)	TDV Electricity Cost Savings ⁴ (2017 \$/unit)
Building Entrances	Each	70	N/A	N/A	105
Primary Entrances	Each	117	N/A	N/A	176
Drive Up Windows	Each	34	N/A	N/A	61
Vehicle Service Uncovered Fuel Dispenser	Each Pump Face	197	N/A	N/A	295
ATM Machine	Each	728	N/A	N/A	1,244
Outdoor Sales Frontage	Per linear foot	N/A	N/A	N/A	N/A
Hardscape Ornamental Lighting	Per Square Foot	N/A	N/A	N/A	N/A
Building Facades	Per Square Foot	N/A	N/A	N/A	N/A
Outdoor Sales Lots	Per Square Foot	0.22	N/A	N/A	0.39
Vehicle Service Station Hardscape	Per Square Foot	0.02	N/A	N/A	0.03
Vehicle Service Station Canopies	Per Square Foot	0.45	N/A	N/A	0.72
Sales Canopies	Per Square Foot	N/A	N/A	N/A	N/A
Non-sales Canopies	Per Square Foot	0.02	N/A	N/A	0.03
Guard Stations	Per Square Foot	0.25	N/A	N/A	0.38
Student Pick-up/Drop-off Zone	Per Square Foot	N/A	N/A	N/A	N/A
Outdoor Dining	Per Square Foot	0.01	N/A	N/A	0.01
Special Security Lighting for Retail	Per Square Foot	0.01	N/A	N/A	0.01

1. Savings from one unit for the first year the site is in operation.
2. TDV energy savings for one unit over the 15 year period of analysis.
3. Site electricity savings. Does not include TDV of electricity savings.
4. Calculated using CEC’s 2016 TDV factors and methodology. Includes savings from electricity.

Table 27: Energy Impacts per Unit – Other Line Items LZ2

Lighting Application	Per Unit First Year Savings ¹				Per Unit TDV Savings ²
	Units	Electricity Savings ³ (kWh/yr)	Demand Savings (kW)	Natural Gas Savings (Therms/yr)	TDV Electricity Cost Savings ⁴ (2017 \$/unit)
Building Entrances	Each	164	N/A	N/A	164
Primary Entrances	Each	188	N/A	N/A	281
Drive Up Windows	Each	120	N/A	N/A	214
Vehicle Service Uncovered Fuel Dispenser	Each Pump Face	352	N/A	N/A	527
ATM Machine	Each	728	N/A	N/A	1,244
Outdoor Sales Frontage	Per linear foot	15	N/A	N/A	23
Hardscape Ornamental Lighting	Per Square Foot	0.01	N/A	N/A	0.02
Building Facades	Per Square Foot	0.14	N/A	N/A	0.21
Outdoor Sales Lots	Per Square Foot	1.1	N/A	N/A	1.87
Vehicle Service Station Hardscape	Per Square Foot	0.27	N/A	N/A	0.46
Vehicle Service Station Canopies	Per Square Foot	1.2	N/A	N/A	1.92
Sales Canopies	Per Square Foot	0.53	N/A	N/A	0.95
Non-sales Canopies	Per Square Foot	0.21	N/A	N/A	0.32
Guard Stations	Per Square Foot	0.26	N/A	N/A	0.39
Student Pick-up/Drop-off Zone	Per Square Foot	0.08	N/A	N/A	0.13
Outdoor Dining	Per Square Foot	0.06	N/A	N/A	0.09
Special Security Lighting for Retail	Per Square Foot	0.01	N/A	N/A	0.01

1. Savings from one unit for the first year the site is in operation.
2. TDV energy savings for one unit over the 15 year period of analysis.
3. Site electricity savings. Does not include TDV of electricity savings.
4. Calculated using CEC’s 2016 TDV factors and methodology. Includes savings from electricity.

Table 28: Energy Impacts per Unit – Other Line Items LZ3

Lighting Application	Per Unit First Year Savings ¹				Per Unit TDV Savings ²
	Units	Electricity Savings ³ (kWh/yr)	Demand Savings (kW)	Natural Gas Savings (Therms/yr)	TDV Electricity Cost Savings ⁴ (2017 \$/unit)
Building Entrances	Each	257	N/A	N/A	386
Primary Entrances	Each	281	N/A	N/A	422
Drive Up Windows	Each	223	N/A	N/A	399
Vehicle Service Uncovered Fuel Dispenser	Each Pump Face	211	N/A	N/A	316
ATM Machine	Each	728	N/A	N/A	1,244
Outdoor Sales Frontage	Per linear foot	21	N/A	N/A	34
Hardscape Ornamental Lighting	Per Square Foot	0.02	N/A	N/A	0.03
Building Facades	Per Square Foot	0.34	N/A	N/A	0.61
Outdoor Sales Lots	Per Square Foot	0.89	N/A	N/A	1.58
Vehicle Service Station Hardscape	Per Square Foot	0.65	N/A	N/A	1.13
Vehicle Service Station Canopies	Per Square Foot	1.6	N/A	N/A	2.52
Sales Canopies	Per Square Foot	0.37	N/A	N/A	0.66
Non-sales Canopies	Per Square Foot	0.51	N/A	N/A	0.76
Guard Stations	Per Square Foot	0.98	N/A	N/A	1.46
Student Pick-up/Drop-off Zone	Per Square Foot	0.31	N/A	N/A	0.50
Outdoor Dining	Per Square Foot	0.14	N/A	N/A	0.23
Special Security Lighting for Retail	Per Square Foot	0.03	N/A	N/A	0.05

1. Savings from one unit for the first year the site is in operation.
2. TDV energy savings for one unit for the first year the site is in operation.
3. Site electricity savings. Does not include TDV of electricity savings.
4. Calculated using CEC’s 2016 TDV factors and methodology. Includes savings from electricity.

Table 29: Energy Impacts per Unit – Other Line Items LZ4

Lighting Application	Per Unit First Year Savings ¹				Per Unit TDV Savings ²
	Units	Electricity Savings ³ (kWh/yr)	Demand Savings (kW)	Natural Gas Savings (Therms/yr)	TDV Electricity Cost Savings ⁴ (2017 \$/unit)
Building Entrances	Each	211	N/A	N/A	316
Primary Entrances	Each	57	N/A	N/A	351
Drive Up Windows	Each	343	N/A	N/A	614
Vehicle Service Uncovered Fuel Dispenser	Each Pump Face	797	N/A	N/A	1,195
ATM Machine	Each	728	N/A	N/A	1,244
Outdoor Sales Frontage	Per linear foot	29.0	N/A	N/A	46
Hardscape Ornamental Lighting	Per Square Foot	0.03	N/A	N/A	0.05
Building Facades	Per Square Foot	0.51	N/A	N/A	0.92
Outdoor Sales Lots	Per Square Foot	0.98	N/A	N/A	1.75
Vehicle Service Station Hardscape	Per Square Foot	1.18	N/A	N/A	2.03
Vehicle Service Station Canopies	Per Square Foot	3.9	N/A	N/A	6.29
Sales Canopies	Per Square Foot	0.46	N/A	N/A	0.83
Non-sales Canopies	Per Square Foot	0.87	N/A	N/A	1.30
Guard Stations	Per Square Foot	1.1	N/A	N/A	1.65
Student Pick-up/Drop-off Zone	Per Square Foot	N/A	N/A	N/A	N/A
Outdoor Dining	Per Square Foot	0.31	N/A	N/A	0.50
Special Security Lighting for Retail	Per Square Foot	N/A	N/A	N/A	N/A

1. Savings from one unit for the first year the site is in operation.
2. TDV energy savings for one unit for the first year the site is in operation.
3. Site electricity savings. Does not include TDV of electricity savings.
4. Calculated using CEC’s 2016 TDV factors and methodology. Includes savings from electricity.

5.1.2 Statewide Energy Impacts Results

First Year Statewide Energy Impacts

The statewide energy impacts of the proposed measure are presented in Table 30. During the first year buildings complying with the 2016 Title 24 Standards are in operation, the proposed measure is expected to reduce annual statewide electricity use by 44.3 GWh. These are primarily off-peak loads, so there is no expected peak demand savings. Since these light sources are outdoors there are no interaction effects with air conditioning or heating loads.

Table 30: Statewide Energy Impacts

	First Year Statewide Savings ¹			TDV Savings ²
	Electricity Savings ³ (GWh)	Demand Reduction (MW)	Natural Gas Savings (MMtherms)	TDV Electricity Cost Savings ⁴ (Million \$)
TOTAL	44.3	N/A	N/A	73.5

^{1.} First year savings from all buildings built statewide during the first year the 2016 Standards are in effect.

^{2.} First year TDV savings from all buildings built statewide during the first year the 2016 Standards are in effect.

^{3.} Site electricity savings.

^{4.} Calculated using CEC's 2016 TDV factors and methodology.

All assumptions and calculations used to derive per unit and statewide energy and demand savings are presented in Section 4.7 of this report.

5.2 Cost-effectiveness Results

5.2.1 Incremental Cost Results

Incremental Construction Cost Results

As shown in Appendix F, by 2017, many of the proposed lighting systems are likely to cost less than the incumbent PSMH lighting systems. This is considering cost forecasts for LED products, which estimate an approximate 30% reduction in luminaire costs by 2017 (DOE 2013).

Incremental Maintenance Cost Results

The maintenance requirements associated with the code change proposal, relative to existing conditions, are described qualitatively in Section 3.3 of this report.

For the sake of the calculations, luminaire maintenance is not being considered in the comparative analysis. The incumbent systems all have higher maintenance costs compared to LED, and the very long life of LED makes them effectively last for the full duration of the 15 year life cycle without requiring maintenance. This produces a conservative life cycle comparison analysis, but the cost effectiveness is sufficiently high to be satisfactory even with this conservative position.

5.2.2 Cost Savings Results

Energy Cost Savings Results

The per unit TDV energy cost savings over the 15 year period of analysis are presented in Table 32. This measure is not climate zone dependent, so the information is presented as an average for the State. The energy and energy cost savings per unit per lighting zone is presented in Section 5.1.1. Table 32 contains the per unit energy cost savings averaged across all climate zones according to the weighting described in Table 31 below.

Table 31: Lighting Zone Area Weighting Factors

Lighting Zone	Energy Impact Weight (%)
LZ0	0
LZ1	0.1
LZ2	9.9
LZ3	90
LZ4	0

Note that Lighting Zone 0 (LZ0) is not currently defined in the existing Title 24 Building Standards. The Statewide CASE Team proposes this addition to the code to keep it aligned with the IES lighting zone definitions. LZ0 is specifically intended for undeveloped spaces in parks, and therefore has no substantial energy impact on the statewide values. As previously noted, LZ4 is also a lighting zone that must be requested from the CEC, and no municipality has chosen to do that yet, so this is also negligible at this point.

Table 32: Weighted TDV Energy Cost Savings Over 15 Years - Per Unit

Climate Zone	Units	TDV Electricity Cost Savings (2017 PV \$)	TDV Natural Gas Cost Savings (2017 PV \$)	Total TDV Energy Cost Savings (2017 PV \$)
General Hardscape	Per Square Foot	0.44	N/A	0.44
Building Entrances	Each	372.54	N/A	372.54
Primary Entrances	Each	407.74	N/A	407.74
Drive Up Windows	Each	380.43	N/A	380.43
Vehicle Service Uncovered Fuel Dispenser	Each Pump Face	337.29	N/A	337.29
ATM Machine	Each	1,244.42	N/A	1,244.42
Outdoor Sales Frontage	Per linear foot	32.70	N/A	32.70
Hardscape Ornamental Lighting	Per Square Foot	N/A	N/A	N/A
Building Facades	Per Square Foot	0.57	N/A	0.57
Outdoor Sales Lots	Per Square Foot	1.61	N/A	1.61
Vehicle Service Station Hardscape	Per Square Foot	1.06	N/A	1.06
Vehicle Service Station Canopies	Per Square Foot	2.46	N/A	2.46
Sales Canopies	Per Square Foot	0.69	N/A	0.69
Non-sales Canopies	Per Square Foot	0.71	N/A	0.71
Guard Stations	Per Square Foot	1.36	N/A	1.36
Student Pick-up/Drop-off Zone	Per Square Foot	0.47	N/A	0.47
Outdoor Dining	Per Square Foot	0.21	N/A	0.21
Special Security Lighting for Retail	Per Square Foot	0.05	N/A	0.05

Other Cost Savings Results

Many of the proposed lighting systems are likely to cost less than the incumbent PSMH lighting systems. This is especially true when considering cost forecasts for LED products,

which estimate an approximate 30% reduction in luminaire costs by 2017 (DOE 2013). Refer to Appendix F at the end of the report for a comparison of the General Hardscape Costing exercise. However, this analysis conservatively assumes zero cost difference between the existing and proposed conditions in circumstances when the installed cost is lower.

5.2.3 Cost-effectiveness Results

The General Hardscape cost effectiveness is shown per lighting zone in Table 33, as this is the largest component of the measure as a whole.

Table 33: Per Unit Cost-effectiveness Summary – General Hardscape by Lighting Zone

Lighting Zone	Benefit: TDV Energy Cost Savings (2017 PV\$/sf)	Cost: Total Incremental First Cost and Maintenance Cost (2017 PV\$)	Change in Lifecycle Cost (2017 PV\$/sf)	Benefit to Cost (B/C) Ratio
LZ1	0.13	None or Lower	-0.13	Infinite
LZ2	0.17	None or Lower	-0.17	Infinite
LZ3	0.47	None or Lower	-0.47	Infinite
LZ4	0.62	None or Lower	-0.62	Infinite

Results for per unit lifecycle cost-effectiveness analysis are presented below in Table 34.

Table 34: Cost-effectiveness Summary¹ – Statewide Weighted Average Across Lighting Zones for all Measure Line-Items

Climate Zone	Units	Benefit: TDV Energy Cost Savings ² (2017 PV\$)	Cost: Total Incremental Cost ³ (2017 PV\$)	Change in Lifecycle Cost ⁴ (2017 PV\$)	Benefit to Cost Ratio ⁵
Outdoor Lighting LPA (Entire Measure)	Per Square Foot	0.41	0.11	-0.41	3.8

1. Relative to existing conditions. All cost values presented in 2017 dollars. “Hospital” building category exclude from cost and savings projections.
2. Present value of TDV cost savings equals TDV electricity savings plus TDV natural gas savings; $\Delta\text{TDV}\$ = \Delta\text{TDV}\$\text{E} + \Delta\text{TDV}\G .
3. Total incremental cost equals incremental construction cost (post adoption) plus present value of incremental maintenance cost; $\Delta\text{C} = \Delta\text{C}_{\text{I}_{\text{PA}}} + \Delta\text{C}_{\text{M}}$.
4. Negative values indicate the measure is cost-effective. Change in lifecycle cost equals cost premium minus TDV energy cost savings; $\Delta\text{LCC} = \Delta\text{C} - \Delta\text{TDV}\$$
5. The benefit to cost ratio is the TDV energy costs savings divided by the total incremental costs; $\text{B/C} = \Delta\text{TDV}\$ \div \Delta\text{C}$. The measure is cost effective if the B/C ratio is greater than 1.0.

Given data regarding the new construction forecast for 2017, the Statewide CASE Team estimates that that lifecycle cost savings (over 15 years) of all buildings constructed during the first year the 2016 Standards are in effect will be \$73.5 million.

5.3 Environmental Impacts Results

5.3.1 Greenhouse Gas Emissions Results

Table 35 presents the estimated first year avoided GHG emissions of the proposed code change. During the first year the 2016 Standards are in effect the proposed measure will result in avoided GHG emissions. The monetary value of avoided GHG emissions is included in TDV cost factors (TDV \$) for each hour of the year and thus included in the Cost-effectiveness Analysis presented in this report.

Table 35: Statewide Greenhouse Gas Emissions Impacts

	Avoided GHG Emissions¹ (MTCO₂e/yr)
TOTAL	15,650

^{1.} First year savings from buildings built in 2017; assumes 353 MTCO₂e/GWh.

^{2.} Monetary value of carbon is included in cost effectiveness analysis; assumes \$/ MTCO₂e consistent with 2016 TDV.

5.3.2 Water Use and Water Quality Impacts

Impacts on water use and water quality are presented in Table 36.

Table 36: Impacts of Water Use and Water Quality

	On-Site Water Savings¹ (gallons/yr)	Embedded Energy Savings² (kWh/yr)	Impact on Water Quality Material Increase (I), Decrease (D), or No Change (NC) compared to existing conditions			
			Mineralization (calcium, boron, and salts)	Algae or Bacterial Buildup	Corrosives as a Result of PH Change	Others
Impact (I, D, or NC)	NC	NC	NC	NC	NC	NC
Per Unit Impacts	N/A	N/A	N/A	N/A	N/A	N/A
Statewide Impacts (first year)	N/A	N/A	N/A	N/A	N/A	N/A
Comment on reasons for your impact assessment	N/A	N/A	N/A	N/A	N/A	N/A

^{1.} Does not include water savings at power plant

^{2.} Assumes embedded energy factor of 10,045 kWh per million gallons of water.

5.3.3 Material Impacts Results

The impacts of the proposed code change on material use were not evaluated.

5.3.4 Other Impacts Results

There are no other impacts anticipated from this measure.

6. PROPOSED LANGUAGE

The proposed changes to the Standards, Reference Appendices, and the ACM Reference Manuals are provided below. Changes to the 2013 documents are marked with underlining (new language) and ~~strikethroughs~~ (deletions).

6.1 Standards

Section 100.1 will be modified to add LZ0 to the definition of Outdoor Lighting Zone.

Table 10-114 A will be modified to add LZ0 to the table and redefine the Lighting Zone ambient illumination description to align with the IES definitions.

Table 130.2-A and –B will be modified to add LZ0 to the tables.

Section 140.7(a) will be modified to remove the exception for ATM lighting and also to remove tunnels and bridges from exceptions.

Tables 140.7-A and 140.7-B will be revised with new LPA values for all of the items within the table and an additional section regarding ATM Machine Lighting.

Section 140.6(a)3 will be revised to remove ATM lighting from the exception.

Table 140.6-C will be revised to add a note to the Parking Garage allowance for a specific ATM allowance.

Section 100.1 Definitions and Rules of Construction will be modified in the following manner:

OUTDOOR LIGHTING ZONE is a geographic area designated by the California Energy Commission in accordance with Part 1, Section 10-114, that determines requirements for outdoor lighting, including lighting power densities and specific control, equipment or performance requirements. Lighting zones are numbered LZ0, LZ1, LZ2, LZ3 and LZ4.

Table 130.2-A will be modified in the following manner:

TABLE 130.2-A Uplight Ratings (Maximum Zonal Lumens)

Secondary Solid Angle	Maximum Zonal Lumens per Outdoor Lighting Zone				
	<u>LZ 0</u>	OLZ 1	OLZ 2	OLZ 3	OLZ 4
Uplight High (UH) 100 to 180 degrees	<u>0</u>	10	50	500	1,000
Uplight Low (UL) 90 to <100 degrees	<u>0</u>	10	50	500	1,000

Table 130.2-B will be modified in the following manner:

TABLE 130.2-B Glare Ratings (Maximum Zonal Lumens)

Glare Rating for Asymmetrical Luminaire Types (Type I, Type II, Type III, Type IV)					
Secondary Solid Angle	Maximum Zonal Lumens per Outdoor Lighting Zone				
	<u>LZ 0</u>	OLZ 1	OLZ 2	OLZ 3	OLZ 4
Forward Very High (FVH) 80 to 90 degrees	<u>10</u>	100	225	500	750
Backlight Very High (BVH) 80 to 90 degrees	<u>10</u>	100	225	500	750

Forward High (FH) 60 to <80 degrees	<u>660</u>	1,800	5,000	7,500	12,000
Backlight High (BH) 60 to <80 degrees	<u>110</u>	500	1,000	2,500	5,000
Glare Rating for Quadrilateral Symmetrical Luminaire Types (Type V, Type V Square)					
Secondary Solid Angle	Maximum Zonal Lumens per Outdoor Lighting Zone				
	<u>LZ 0</u>	\ominus LZ 1	\ominus LZ 2	\odot LZ 3	\ominus LZ 4
Forward Very High (FVH) 80 to 90 degrees	<u>10</u>	100	225	500	750
Backlight Very High (BVH) 80 to 90 degrees	<u>10</u>	100	225	500	750
Forward High (FH) 60 to <80 degrees	<u>660</u>	1,800	5,000	7,500	12,000
Backlight High (BH) 60 to <80 degrees	<u>660</u>	1,800	5,000	7,500	12,000

Table 10-114-A will be modified in the following manner:

TABLE 10-114-A LIGHTING ZONE CHARACTERISTICS AND RULES FOR AMENDMENTS BY LOCAL JURISDICTIONS

Zone	Ambient Illumination	State wide Default Location	Moving Up to Higher Zones	Moving Down to Lower Zones
<u>LZ0</u>	<u>Very Low</u>	<u>Undeveloped areas of government designated parks, recreation areas, and wildlife preserves.</u>	<u>Undeveloped portions of government designated park, recreation area, wildlife preserve, can be designated as LZ1 or LZ2 if they are contained within a higher zone.</u>	<u>Not applicable.</u>
LZ1	<u>Dark Low</u>	<u>Developed portions of</u> government designated parks, recreation areas, and wildlife preserves. Those that are wholly contained within a higher lighting zone may be considered by the local government as part of that lighting zone.	<u>Developed portions of a</u> government designated park, recreation area, wildlife preserve, <u>or portions thereof,</u> can be designated as LZ2 or LZ3 if they are contained within such a zone.	Not applicable.
LZ2	<u>Low Moderate</u>	Rural areas, as defined by the 2010 U.S. Census.	Special districts within a default LZ2 zone may be designated as LZ3 or LZ4 by a local jurisdiction. Examples include special commercial districts or areas with special security considerations located within a rural area.	Special districts and government designated parks within a default LZ2 zone may be designated as LZ1 by the local jurisdiction for lower illumination standards, without any size limits.
LZ3	<u>Medium Moderately High</u>	Urban areas, as defined by the 2010 U.S. Census.	Special districts within a default LZ3 may be designated as a LZ4 by local jurisdiction for high intensity nighttime use, such as entertainment or commercial districts or areas with special security considerations requiring very high light levels.	Special districts and government designated parks within a default LZ3 zone may be designated as LZ1 or LZ2 by the local jurisdiction, without any size limits.
LZ4	High	None.	Not applicable.	Not applicable.

Section 140.7(a) will be modified in the following manner:

- (a) An outdoor lighting installation complies with this section if it meets the requirements in Subsections (b) and (c), and the actual outdoor lighting power installed is no greater than the allowed outdoor lighting power calculated under Subsection (d). The allowed outdoor lighting shall be calculated according to Outdoor Lighting Zone in Title 24, Part 1, Section 10-114.

EXCEPTIONS to Section 140.7(a): When more than 50 percent of the light from a luminaire falls within one or more of the following applications, the lighting power for that luminaire shall be exempt from Section 140.7:

1. Temporary outdoor lighting.
2. Lighting required and regulated by the Federal Aviation Administration, and the Coast Guard.
3. Lighting for public streets, roadways, highways, and traffic signage lighting, including lighting for driveway entrances occurring in the public right-of-way.
4. Lighting for sports and athletic fields, and children's playgrounds.
5. Lighting for industrial sites, including but not limited to, rail yards, maritime shipyards and docks, piers and marinas, chemical and petroleum processing plants, and aviation facilities.
- ~~6. Lighting specifically for Automated Teller Machines as required by California Financial Code Section 13040, or required by law through a local ordinance.~~
- ~~76.~~ Lighting of public monuments.
- ~~87.~~ Lighting of signs complying with the requirements of Sections 130.3 and 140.8.
- ~~98.~~ Lighting of ~~tunnels, bridges~~, stairs, wheelchair elevator lifts for American with Disabilities Act (ADA) compliance, and ramps that are other than parking garage ramps.
- ~~109.~~ Landscape lighting.
- ~~110.~~ In theme parks: outdoor lighting only for themes and special effects.
- ~~121.~~ Lighting for outdoor theatrical and other outdoor live performances, provided that these lighting systems are additions to area lighting systems and are controlled by a multiscene or theatrical cross-fade control station accessible only to authorized operators.
- ~~1312.~~ Outdoor lighting systems for qualified historic buildings, as defined in the California Historic Building Code (Title 24, Part 8), if they consist solely of historic lighting components or replicas of historic lighting components. If lighting systems for qualified historic buildings contain some historic lighting components or replicas of historic components, combined with other lighting components, only those historic or historic replica components are exempt. All other outdoor lighting systems for qualified historic buildings shall comply with Section 140.7.

Section 140.7(d)1A will be modified in the following manner:

1. **General Hardscape Lighting Allowance.** Determine the general hardscape lighting power allowances as follows:
 - A. The general hardscape area of a site shall include parking lot(s), roadway(s), driveway(s), sidewalk(s), walkway(s), bikeway(s), plaza(s), ~~bridges(s), tunnel(s)~~, and other improved area(s) that are illuminated. In plan view of the site, determine the illuminated hardscape area, which is defined as any hardscape area that is within a square pattern around each luminaire or pole that is ten times the luminaire mounting height with the luminaire in the middle of the pattern, less any areas that are within a building, beyond the hardscape area, beyond property lines, or obstructed by a structure. The illuminated hardscape area shall include portions of planters and landscaped areas that are within the lighting application and are less than or equal to 10 feet wide in the short

dimensions and are enclosed by hardscape or other improvement on at least three sides. Multiply the illuminated hardscape area by the Area Wattage Allowance (AWA) from TABLE 140.7-A for the appropriate Lighting Zone.

Table 140.7-A will be modified in the following manner:

TABLE 140.7-A GENERAL HARDSCAPE LIGHTING POWER ALLOWANCE

Type of Power Allowance	Lighting Zone 0	Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4
Area Wattage Allowance (AWA)	<i>See Note #1 Below</i>	0.035 <u>0.020</u> W/ft ²	0.045 <u>0.030</u> W/ft ²	0.090 <u>0.040</u> W/ft ²	0.115 <u>0.050</u> W/ft ²
Linear Wattage Allowance (LWA)		0.25 <u>0.15</u> W/lf	0.45 <u>0.25</u> W/lf	0.60 <u>0.35</u> W/lf	0.85 <u>0.45</u> W/lf
Initial Wattage Allowance (IWA)		340 W	510 <u>450</u> W	770 <u>520</u> W	1030 <u>640</u> W

Note #1: Lighting Zone 0: Continuous lighting is explicitly prohibited in Lighting Zone 0. Therefore, a single luminaire of 15 Watts or less may be installed at the entrance to a parking area, trail head, fee payment kiosk, outhouse, or toilet facility, as required to provide safe navigation of the site infrastructure. Luminaires shall meet the maximum zonal lumen limits of LZ0 for Uplight and Glare in Tables 130.2-A and 130.2-B to comply with this zone.

Table 140.7-B will be modified in the following manner:

TABLE 140.7-B ADDITIONAL LIGHTING POWER ALLOWANCE FOR SPECIFIC APPLICATIONS All area and distance measurements in plan view unless otherwise noted.

Lighting Application	Lighting Zone 0	Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4
WATTAGE ALLOWANCE PER APPLICATION. Use all that apply as appropriate.					
Building Entrances or Exits. Allowance per door. Luminaires qualifying for this allowance shall be within 20 feet of the door.	<i>See Note #1 Below</i>	30 <u>15</u> watts	60 <u>25</u> watts	90 <u>35</u> watts	90 <u>45</u> watts
Primary Entrances to Senior Care Facilities, Police Stations, Hospitals, Fire Stations, and Emergency Vehicle Facilities. Allowance per primary entrance(s) only. Primary entrances shall provide access for the general public and shall not be used exclusively for staff or service personnel. This allowance shall be in addition to the building entrance or exit allowance above. Luminaires qualifying for this allowance shall be within 100 feet of the primary entrance.	<i>No Allowance</i>	45 <u>20</u> watts	80 <u>40</u> watts	120 <u>60</u> watts	130 <u>80</u> watts
Drive Up Windows. Allowance per customer service location. Luminaires qualifying for this allowance shall be within 2 mounting heights of the sill of the window.	<i>No Allowance</i>	40 <u>30</u> watts	75 <u>40</u> watts	125 <u>60</u> watts	200 <u>100</u> watts
Vehicle Service Station Uncovered Fuel Dispenser. Allowance per fueling dispenser. Luminaires qualifying for this allowance shall be within 2 mounting heights of the dispenser.	<i>No Allowance</i>	120 <u>80</u> watts	175 <u>100</u> watts	185 <u>140</u> watts	330 <u>160</u> watts
ATM Machine Lighting. Allowance per ATM machine. Luminaires qualifying for this allowance shall be within 50 feet of the dispenser.	<i>No Allowance</i>	<u>250 watts for first ATM machine, 70 watts for each additional ATM machine</u>			
WATTAGE ALLOWANCE PER UNIT LENGTH (w/linear ft). May be used for one or two frontage side(s) per site.					
Outdoor Sales Frontage. Allowance for frontage immediately adjacent to the principal viewing location(s) and unobstructed for its viewing length. A corner sales lot may include two adjacent sides provided that a different principal viewing location exists for each side. Luminaires qualifying for this allowance shall be located between the principal viewing location and the frontage outdoor sales area.	<i>No Allowance</i>	No Allowance	22 <u>5-15</u> W/linear ft	36 <u>25</u> W/linear ft	45 <u>30</u> W/linear ft
WATTAGE ALLOWANCE PER HARDSCAPE AREA (W/ft ²). May be used for any illuminated hardscape area on the site.					
Hardscape Ornamental Lighting. Allowance for the total site illuminated hardscape area. Luminaires qualifying for this allowance shall be rated for 100 watts or less as determined in accordance with Section 130.0(d), and shall be post-top luminaires, lanterns, pendant luminaires, or chandeliers.	<i>No Allowance</i>	No Allowance	0.02 <u>0.015</u> W/ft ²	0.04 <u>0.03</u> W/ft ²	0.06 <u>0.045</u> W/ft ²
WATTAGE ALLOWANCE PER SPECIFIC AREA (W/ft ²). Use as appropriate provided that none of the following specific applications shall be used for the same area.					
Building Facades. Only areas of building façade that are illuminated shall qualify for this allowance. Luminaires qualifying for this allowance shall be aimed at the façade and shall be capable of illuminating it without obstruction or interference by permanent building features or other objects.	<i>No Allowance</i>	No Allowance	0.18 <u>0.15</u> W/ft ²	0.35 <u>0.25</u> W/ft ²	0.50 <u>0.35</u> W/ft ²

Outdoor Sales Lots. Allowance for uncovered sales lots used exclusively for the display of vehicles or other merchandise for sale. Driveways, parking lots or other non-sales areas shall be considered hardscape areas even if these areas are completely surrounded by sales lot on all sides. Luminaires qualifying for this allowance shall be within 5 mounting heights of the sales lot area.	<u>No Allowance</u>	0.164 <u>0.100</u> W/ft ²	0.555 <u>0.250</u> W/ft ²	0.758 <u>0.500</u> W/ft ²	1.285 <u>1.000</u> W/ft ²
Vehicle Service Station Hardscape. Allowance for the total illuminated hardscape area less area of buildings, under canopies, off property, or obstructed by signs or structures. Luminaires qualifying for this allowance shall be illuminating the hardscape area and shall not be within a building, below a canopy, beyond property lines, or obstructed by a sign or other structure.	<u>No Allowance</u>	0.014 <u>0.010</u> W/ft ²	0.155 <u>0.100</u> W/ft ²	0.308 <u>0.150</u> W/ft ²	0.485 <u>0.200</u> W/ft ²
Vehicle Service Station Canopies. Allowance for the total area within the drip line of the canopy. Luminaires qualifying for this allowance shall be located under the canopy.	<u>No Allowance</u>	0.514 <u>0.400</u> W/ft ²	1.005 <u>0.700</u> W/ft ²	1.300 <u>0.900</u> W/ft ²	2.200 <u>1.200</u> W/ft ²
Sales Canopies. Allowance for the total area within the drip line of the canopy. Luminaires qualifying for this allowance shall be located under the canopy.	<u>No Allowance</u>	No Allowance	0.655 <u>0.500</u> W/ft ²	0.908 <u>0.800</u> W/ft ²	1.135 <u>1.000</u> W/ft ²
Non-sales Canopies and Tunnels. Allowance for the total area within the drip line of the canopy or inside the tunnel. Luminaires qualifying for this allowance shall be located under the canopy or tunnel.	<u>No Allowance</u>	0.084 <u>0.080</u> W/ft ²	0.205 <u>0.160</u> W/ft ²	0.408 <u>0.300</u> W/ft ²	0.585 <u>0.400</u> W/ft ²
Guard Stations. Allowance up to 1,000 square feet per vehicle lane. Guard stations provide access to secure areas controlled by security personnel who stop and may inspect vehicles and vehicle occupants, including identification, documentation, vehicle license plates, and vehicle contents. Qualifying luminaires shall be within 2 mounting heights of a vehicle lane or the guardhouse.	<u>No Allowance</u>	0.154 <u>0.100</u> W/ft ²	0.355 <u>0.300</u> W/ft ²	0.708 <u>0.500</u> W/ft ²	0.985 <u>0.750</u> W/ft ²
Lighting Application	<u>Lighting Zone 0</u>	Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4
Student Pick-up/Drop-off zone. Allowance for the area of the student pick-up/drop-off zone, with or without canopy, for preschool through 12th grade school campuses. A student pick-up/drop off zone is a curbside, controlled traffic area on a school campus where students are picked-up and dropped off from vehicles. The allowed area shall be the smaller of the actual width or 25 feet, times the smaller of the actual length or 250 feet. Qualifying luminaires shall be within 2 mounting heights of the student pick-up/drop-off zone.	<u>No Allowance</u>	No Allowance	0.12 <u>0.10</u> W/ft ²	0.45 <u>0.25</u> W/ft ²	No Allowance
Outdoor Dining. Allowance for the total illuminated hardscape of outdoor dining. Outdoor dining areas are hardscape areas used to serve and consume food and beverages. Qualifying luminaires shall be within 2 mounting heights of the hardscape area of outdoor dining.	<u>No Allowance</u>	0.014 <u>0.010</u> W/ft ²	0.135 <u>0.100</u> W/ft ²	0.240 <u>0.150</u> W/ft ²	0.400 <u>0.200</u> W/ft ²
Special Security Lighting for Retail Parking and Pedestrian Hardscape. This additional allowance is for illuminated retail parking and pedestrian hardscape identified as having special security needs. This allowance shall be in addition to the building entrance or exit allowance.	<u>No Allowance</u>	0.007 <u>0.005</u> W/ft ²	0.009 <u>0.007</u> W/ft ²	0.019 <u>0.012</u> W/ft ²	No Allowance

Note #1: Lighting Zone 0: A single luminaire of 15 Watts or less may be installed at the entrance to a parking area, trail head, fee payment kiosk, outhouse, or toilet facility, as required to provide safe navigation of the site infrastructure. Luminaires shall meet the maximum zonal lumen limits of LZ0 for Uplight and Glare in Tables 130.2-A and 130.2-B to comply with this zone.

Section 140.6(a)3T will be modified in the following manner:

~~T. Lighting for automatic teller machines that are located inside parking garages.~~

Table 140.6(a)3T will be modified in the following manner:

TABLE 140.6-C AREA CATEGORY METHOD - LIGHTING POWER DENSITY VALUES (WATTS/FT²)

PRIMARY FUNCTION AREA	ALLOWED LIGHTING POWER (W/ft ²)	PRIMARY FUNCTION AREA	ALLOWED LIGHTING POWER (W/ft ²)
Auditorium Area	1.5 ³	Library Area	Reading areas
Auto Repair Area	0.9 ²		Stack areas
Beauty Salon Area	1.7	Lobby Area	Hotel lobby
Civic Meeting Place Area	1.3 ³		Main entry lobby

Classroom, Lecture, Training, Vocational Areas	⁵ 1.2	Locker/Dressing Room	0.8
Commercial and Industrial Storage Areas (conditioned and unconditioned)	0.6	Lounge Area	1.1 ³
Commercial and Industrial Storage Areas (refrigerated)	0.7	Malls and Atria	1.2 ³
Convention, Conference, Multipurpose and Meeting Center Areas	³ 1.4	Medical and Clinical Care Area	1.2
Corridor, Restroom, Stair, and Support Areas	0.6	Office Area	> 250 square feet 0.75
Dining Area	1.1 ³		≤ 250 square feet 1.0
Electrical, Mechanical, Telephone Rooms	² 0.7	Parking Garage Area	Parking Area ¹⁰ 0.14
Exercise Center, Gymnasium Areas	1.0		Dedicated Ramps 0.3
Exhibit, Museum Areas	2.0		Daylight Adaptation Zones ⁹ 0.6
Financial Transaction Area	1.2 ³	Religious Worship Area	1.5 ³
General Commercial and Industrial Work Areas	Low bay	Retail Merchandise Sales, Wholesale Showroom Areas	1.2 ^{6 and 7}
	High bay		
	Precision	Theater Area	Motion picture 0.9 ³
Grocery Sales Area	1.2 ^{6 and 7}		Performance 1.4 ³
Hotel Function Area	1.5 ³	Transportation Function Area	1.2
Kitchen, Food Preparation Areas	1.6	Videoconferencing Studio	1.2 ⁸
Laboratory Area, Scientific	1.4 ¹	Waiting Area	1.1 ³
Laundry Area	0.9	All other areas	0.6

Footnotes for this table are listed below.

FOOTNOTES FOR TABLE

140.6-C:

See Section 140.6(c)2 for an explanation of additional lighting power available for specialized task work, ornamental, precision, accent, display, decorative, and white boards and chalk boards, in accordance with the footnotes in this table. The smallest of the added lighting power listed in each footnote below, or the actual design wattage, may be added to the allowed lighting power only when using the Area Category Method of compliance.

Footnote number	Type of lighting system allowed	Maximum allowed added lighting power. (W/ft ² of task area unless otherwise noted)
1	Specialized task work	0.2 W/ft ²
2	Specialized task work	0.5 W/ft ²
3	Ornamental lighting as defined in Section 100.1 and in accordance with Section 140.6(c)2.	0.5 W/ft ²
4	Precision commercial and industrial work	1.0 W/ft ²
5	Per linear foot of white board or chalk board.	5.5 W per linear foot
6	Accent, display and feature lighting - luminaires shall be adjustable or directional	0.3 W/ft ²
7	Decorative lighting - primary function shall be decorative and shall be in addition to general illumination.	0.2 W/ft ²
8	Additional Videoconferencing Studio lighting complying with all of the requirements in Section 140.6(c)2Gvii.	1.5 W/ft ²
9	Daylight Adaptation Zones shall be no longer than 66 feet from the entrance to the parking garage	
<u>10</u>	<u>Additional allowance for ATM locations in Parking Garages. Allowance per ATM</u>	<u>200 watts for first ATM location, 50 watts for each additional ATM location in a group.</u>

6.2 Reference Appendices

There are no proposed changes to the Reference Appendices.

6.3 ACM Reference Manual

There are no proposed changes to the ACM Reference Manual.

6.4 Compliance Manuals

There are no proposed changes to the compliance manuals.

6.5 Compliance Forms

There are no proposed changes to the compliance forms.

7. REFERENCES AND OTHER RESEARCH

- [CARB] California Air Resources Board. 2010. “Proposed Regulation for a California Renewable Electricity Standard Staff Report: Initial Statement of Reasons Appendix D.” <http://www.arb.ca.gov/regact/2010/res2010/res10d.pdf>. Accessed November 12, 2013.
- ___ . 2011a. California Air Resources Board. “Appendix C: Cost Effectiveness Calculation Methodology.” March 10. http://www.arb.ca.gov/msprog/moyer/guidelines/2011gl/appc_3_10_11.pdf.
- ___ . 2011b. “Emission Reduction Offsets Transaction Cost Summary Report for 2011.” <http://www.arb.ca.gov/nsr/erco/erco.htm>.
- ___ . 2012. “Emission Reduction Offsets Transaction Cost Summary Report for 2012.” <http://www.arb.ca.gov/nsr/erco/erco.htm>.
- ___ . 2013a. “Mail-Out #MSC 13-09.” March 25. <http://www.arb.ca.gov/msprog/mailouts/msc1309/msc1309.pdf>.
- ___ . 2013b. “California Air Resources Board Quarterly Auction 3, May 2013 – Summary Results Report.” <http://www.arb.ca.gov/cc/capandtrade/auction/may-2013/results.pdf>.
- [CASE 2007] C&S Team, 2007. *Revised Report Outdoor Lighting*. PG&E, SCE, SDGE IOU Statewide CASE Team, February 2007. http://www.energy.ca.gov/title24/2008standards/prerulemaking/documents/2007-02-26-27_workshop/supporting/2007-02-15_REVISED_REPORT_OUTDOOR_LIGHTING.PDF.
- [CEC] California Energy Commission. 2014a. “Time Dependent Valuation of Energy for Developing Building Efficiency Standards: 2017 Time Dependent Valuation (TDV) Data Sources and Inputs.” July 2014. http://www.energy.ca.gov/title24/2016standards/prerulemaking/documents/2014-07-09_workshop/2016_TDV_Documents/Title24_2016_TDV_Methodology_Report%20v3.docx. Accessed July 2014.
- [DOE 2013] U.S. Department of Energy. 2013. *Solid-State Lighting Research and Development Multi-Year Program Plan*. DOE/EERE 9061. Washington, D.C.: U.S. Department of Energy.
- [LADBS2013] L.A. Department of Building and Safety. 203. *Summary of Parking Regulations*, Revised 2013.
- [MTC2012] Metropolitan Transportation Commission, 2012. *Survey of Bay Area Cities’ Parking Requirements: Summary Report, April, 2012*. http://www.mtc.ca.gov/planning/smart_growth/parking/6-12/Final_Summary_of_MTC_Parking_Survey.pdf. Accessed 2014.
- [NRC2013] National Research Council. 2013. *Assessment of Advanced Solid State Lighting*. Washington, D.C.: The National Academies Press.

- [Navigant 2012] Navigant Consulting, Inc. 2012. *Energy Savings Potential of Solid-State Lighting in General Illumination Applications*. Washington, D.C.: U.S. Department of Energy.
- [Navigant 2013] Navigant Consulting, Inc. 2013. *Adoption of Light-Emitting Diodes in Common Lighting Applications*. DOE/EE-1016. Washington, D.C.: U.S. Department of Energy.
- [PNNL 2013] Pacific Northwest National Laboratory. 2013. *SSL Pricing and Efficacy Trend Analysis for Utility Program Planning*. PNNL-22908. Washington, D.C.: U.S. Department of Energy.
- [RLW] RLW Analytics 2002. *Integrated Energy Systems Productivity and Building Science: Outdoor Lighting Baseline Assessment*.
http://www.energy.ca.gov/title24/2005standards/archive/outdoor_lighting/documents/2003-05-06_LGHT-BASELINE.PDF
- _____. 2002a. *Integrated Energy Systems Productivity and Building Science: Outdoor Lighting Baseline Assessment - Appendices*. <http://www.energy.ca.gov/2003publications/CEC-500-2003-082/CEC-500-2003-082-A-19.PDF>
- [SDMC2009] San Diego Municipal Code, 2009. *Chapter 14: General Regulations*, Revised 12-2009.
<http://puff.lbl.gov/transportation/transportation/pdf/sandiego-municipal-code-ch14.pdf>. Accessed 2014.
- [T24ACM] California Energy Commission. 2008. “Nonresidential Alternative Calculation Method (ACM) Approval Manual”. December 2008.
<http://www.energy.ca.gov/2008publications/CEC-400-2008-003/CEC-400-2008-003-CMF.PDF>. Accessed May 2014.
- [TRC 2014] TRC Energy Services. Communications with Manufacturers on the LED Market. Ongoing communications and observations from 2013 and 2014.
- [U.S. EPA] United States Environmental Protection Agency. 2011. “Emission Factors for Greenhouse Gas Inventories.”
<http://www.epa.gov/climateleadership/documents/emission-factors.pdf>. Accessed December 2, 2013.

APPENDIX A: ENVIRONMENTAL IMPACTS

METHODOLOGY

Greenhouse Gas Emissions Impacts Methodology

The avoided GHG emissions were calculated assuming an emission factor of 353 metric tons of carbon dioxide equivalents (MTCO_{2e}) per GWh of electricity savings. The Statewide CASE Team calculated air quality impacts associated with the electricity savings from the proposed measure using emission factors that indicate emissions per GWh of electricity generated.⁴ When evaluating the impact of increasing the Renewable Portfolio Standard (RPS) from 20 percent renewables by 2020 to 33 percent renewables by 2020, California Air Resources Board (CARB) published data on expected air pollution emissions for various future electricity generation scenarios (CARB 2010). The Statewide CASE Team used data from CARB's analysis to inform the air quality analysis presented in this report.

The GHG emissions factor is a projection for 2020 assuming the state will meet the 33 percent RPS goal. CARB calculated the emissions for two scenarios: (1) a high load scenario in which load continues at the same rate; and (2) a low load rate that assumes the state will successfully implement energy efficiency strategies outlined in the AB32 scoping plan thereby reducing overall electricity load in the state.

To be conservative, the Statewide CASE Team calculated the emissions factors of the incremental electricity between the low and high load scenarios. These emission factors are intended to provide a benchmark of emission reductions attributable to energy efficiency measures that could help achieve the low load scenario. The incremental emissions were calculated by dividing the difference between California emissions in the high and low generation forecasts by the difference between total electricity generated in those two scenarios. While emission rates may change over time, 2020 was considered a representative year for this measure.

Avoided GHG emissions from natural gas savings were calculated using an emission factor of 5,303 MTCO_{2e}/million therms (U.S. EPA 2011).

⁴ California power plants are subject to a GHG cap and trade program and linked offset programs until 2020 and potentially beyond.

APPENDIX B: OUTDOOR LIGHTING CALCULATIONS METHODOLOGY

General Hardscape Area Lighting Calculations Rationale

There are a number of issues that make the change to LED as the basis of design more difficult than a simple recalculation of the LPA values based on the efficacy of the LED lamps compared to PSMH lamps. Each of these items will be addressed individually. These factors include:

- The efficacy of the LED products is increasing at a rate of approximately 10% per year.
- The luminaire efficacy (the light source efficacy times the luminaire efficiency) produces a very different result than the raw lamp efficacy.
- LED lumen maintenance is not as straightforward as incumbent technology.
- The light distribution from LED products designed for outdoor hardscape lighting is very different than for incumbent PSMH products.
- The lighting design criteria for parking lots and other outdoor hardscape spaces dictates the LPA results in a manner that is sometimes non-intuitive.

LED Efficacy is Rapidly Improving

LED technology is being pushed rapidly towards higher efficacy values with every new generation of chips introduced to market. The current rate of improvement is in the range of 10% per annum, and this rate of improvement is expected to be maintained for the near future (at least for the next five years or so). Some LED products are improving faster, in particular ‘warm’ LED chips, which are generally preferred by many in the industry for aesthetic reasons.

They are also strongly preferred by some specifiers because they typically have a lower amount of light in the blue end of the spectrum where there is considerable concern regarding the interruption of human and other species circadian rhythms as a result of melatonin disruption caused by nighttime exposure to light sources rich in blue wavelengths.

As a result, the ‘warm’ LED chips (generally color temperatures lower than approximately 4100K) are considered preferable for outdoor specifications.

Because the LED chips are improving so rapidly, it is important to set the LPA values based on the performance of the chips that will be available at the time of implementation of the 2106 Title 24 Standards. To set the values based on current (2014) chip efficacy values would result in a table of LPA values that are obsolete by approximately 30% by 2017. As a result, it is important to predict the efficacy of the available lighting equipment in 2017 and establish values based on that expectation of efficacy.


Since the Standards will be in effect for three years (from January 1, 2017 until implementation of the 2019 Title 24 Standards on January 1, 2020), the LPA values will be approximately 30% too high by the end of the expected effective period of the 2016 Standards, even though the LPA values will be current at the beginning of the effective period. This makes it important that the LPA values be continually evaluated and updated at

each code cycle to ensure that the values continue to effectively work toward the overall goals of Title 24; to achieve the highest cost effective energy efficiency standards in the United States, and to work toward an achievable Zero Net Energy Goal in 2030 for Nonresidential buildings.

The DOE has produced several LED chip tracking reports in the past, and this information is cited as the primary resource for the projections of LED efficacy as we move forward in time. (DOE 2013)

Figure 1 below, provides a graphic of the projections of LED efficacy for both ‘cool’ and ‘warm’ LEDs.

Figure 1: Diagram of LED Chip Efficacy Projections

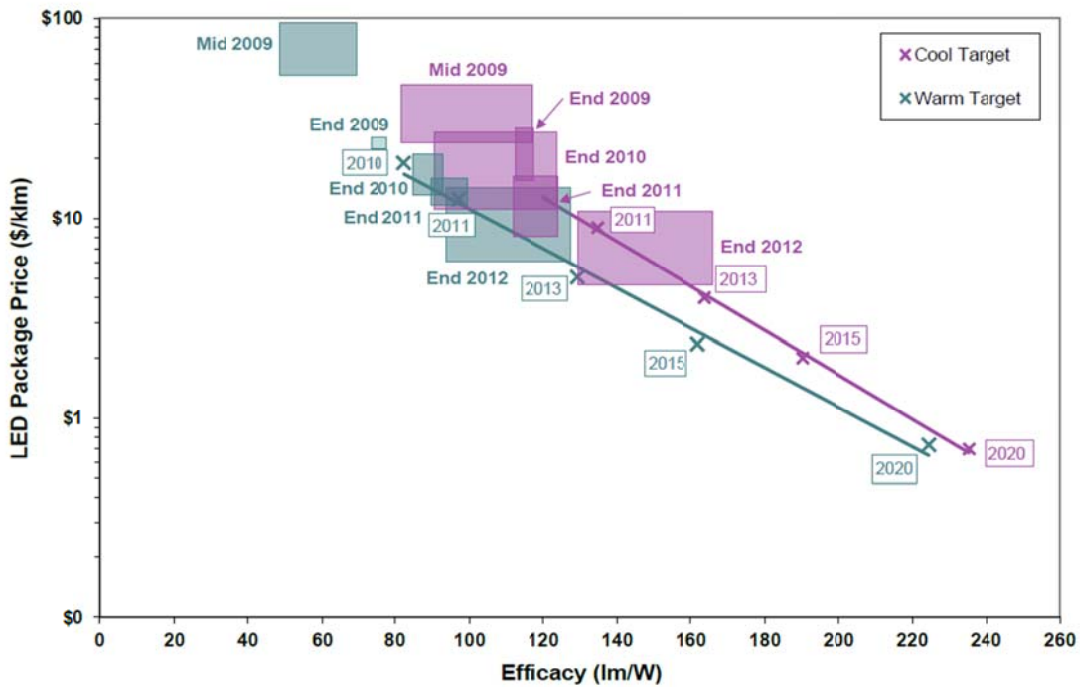

The information on the graph can be translated into the projections shown in Figure 2, year by year, so that the values can be placed at the appropriate point in time for the Title 24 Standards implementation timeframe.


Figure 2: LED Chip Efficacy and Price Projections

Metric	2012	2013	2015	2020	Goal
Cool-White Efficacy (lm/W)	150	164	190	235	266
Cool-White Price (\$/klm)	6	4	2	0.7	0.5
Warm-White Efficacy (lm/W)	113	129	162	224	266
Warm-White Price (\$/klm)	7.9	5.1	2.3	0.7	0.5

Note: Projections for cool-white packages assume CCT=4746-7040 K and CRI >70, while projections for warm-white packages assume CCT=2580-3710 K and CRI >80. All efficacy projections assume that packages are measured at 25 °C with a drive current density of 35 A/cm².

Further, the DOE produced a report in 2013 that provides information on the efficacy of luminaires. The data contained in this report deviates from the chip tracking reports because the luminaires have other variables that impact the total efficacy of the lighting equipment, including the quality of the optical materials used to redirect the light, driver losses, chip board losses, heat rejection, and other factors that all have the possibility to improve with time independent of the LED chip efficacy improvements. Figure 3 below provides information from the DOE report on specific luminaires, which helps to reinforce the projections that have been made to the year 2017 (PNNL 2013).

Figure 3: Roadway and Area Luminaire Efficacy Projections with 95% Confidence Bands.

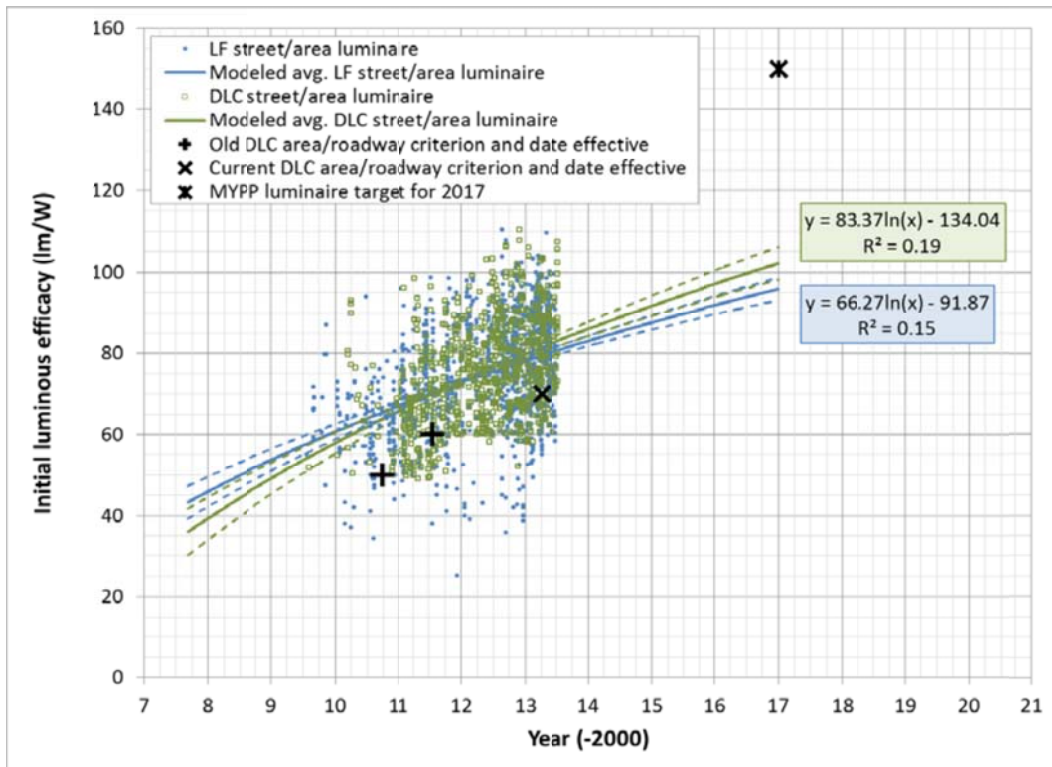

As a result, the luminaire efficacy of the products used in the calculations has been adjusted upwards to reflect the 2017 performance of LED products.

Luminaire efficacy is Different from Lamp Efficacy

The introduction of LED light sources in the lighting industry has caused the industry to reset its expectations for the way light is produced and controlled from a luminaire. With incumbent technology (HPS, PSMH, CFL, incandescent, etc.) the light is emitted from the lamp, redirected by reflectors in the luminaire, and delivered to the task location as efficiently as possible. Light from many lamp types is produced in all directions, so a considerable amount of resources is spent to redirect the light that is going in the opposite direction from that desired back toward the task area. This sometimes requires two bounces off a reflector, and then through a coverglass.


The resultant luminaire efficiency (the percentage of light output compared to the bare lamp output) is often in the 70% range, with many sources as low as about 50%, and very few as high as 80%.

As a result, a comparison of lamp efficacy between PSMH and LED will yield a false picture of the actual performance of the respective light sources. Previously, these differences were minimal when comparing MH to PSMH, for example, because both systems had the same optical limitations to deal with.

While LED lamp efficacy is not expected to exceed PSMH or even CFL lamp efficacy for several more years, the information provided through LED market research indicates that when accounting for the losses associated with the luminaires, LED is now equal to, or better than almost all other light sources available on the market in high quality luminaire products (DOE 2013).

Figure 4 below, provides the DOE projection for LED luminaire efficacy compared to HID and linear fluorescent products, and shows the clear improvement of LED in time, and that projected point where the LED luminaires will have the highest efficacy, which appears to happen in late 2014 or early 2015.

Figure 4: LED Luminaire Efficacy Projections Compared To ‘Best in Class’ HID and LFL Products

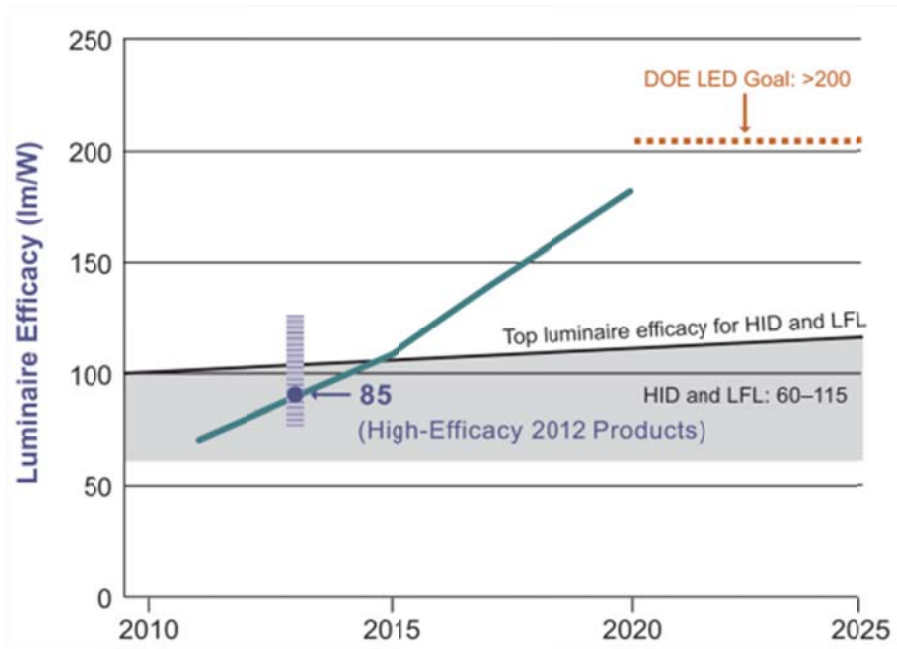

APPENDIX C: OUTDOOR LIGHTING LPA CALCULATIONS RESULTS

General Hardscape Calculations Results

Figure 5: General Hardscape Possible LPA Calculation Results LZ1-1

LZ1 Parking Lot Maximum Spacing Calculations T-24 2016									
									Average: 0.017
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 0.2fc minimum, 20:1 max:min (vertical illuminance not considered)					
2017 Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions	Avg. fc	Min. fc	Max:Min	W/sf	
15 Foot Poles									
001	146	1	T3	60	120	2.45	0.30	19.67	0.02028
001	146	1	T4	60	105	2.94	0.47	16.62	0.02317
001	146	1	T5	60	105	1.81	0.31	9.97	0.02317
002	113	1	T3	60	100	1.64	0.20	19.55	0.01883
002	113	1	T4	60	100	1.65	0.28	15.04	0.01883
002	113	1	T5	60	105	1.26	0.20	15.00	0.01794
003	197	1	T3	60	85	3.10	0.44	14.50	0.03863
003	197	1	T4	60	85	3.00	0.43	14.40	0.03863
003	197	1	T5	60	100	1.95	0.34	14.00	0.03283
004	155	1	T3	120	100	1.61	0.33	18.97	0.01292
004	155	1	T4	120	60	2.56	0.45	18.42	0.02153
004	155	1	T5	120	105	0.92	0.21	16.71	0.0123
001	146	2	T3	60	110	3.32	0.56	15.13	0.04424
001	146	2	T4	60	105	3.60	0.61	17.44	0.04635
002	113	2	T3	60	100	2.66	0.38	18.89	0.03767
002	113	2	T4	60	100	2.53	0.46	17.89	0.03767
003	197	2	T3	60	85	5.00	0.85	14.08	0.07725
003	197	2	T4	60	85	4.85	0.82	14.16	0.07725
004	155	2	T3	120	100	1.94	0.37	19.00	0.01292
004	155	2	T4	120	75	2.40	0.46	19.70	0.01722
20 Foot Poles									
001	146	1	T3	60	155	1.93	0.21	18.43	0.0157
001	146	1	T4	60	145	2.03	0.27	17.74	0.01678
001	146	1	T5	60	140	1.28	0.25	8.60	0.01738
002	113	1	T3	60	120	1.35	0.42	5.26	0.01569
002	113	1	T4	60	125	1.27	0.27	9.37	0.01507
002	113	1	T5	60	135	0.93	0.21	9.76	0.01395
003	197	1	T3	60	110	2.32	0.27	13.19	0.02985
003	197	1	T4	60	115	2.20	0.20	17.60	0.02855
003	197	1	T5	60	125	1.58	0.27	12.04	0.02627
004	155	1	T3	120	165	0.94	0.21	19.71	0.00783
004	155	1	T4	120	90	1.97	0.27	19.74	0.01435
004	155	1	T5	120	145	0.69	0.20	10.05	0.00891
001	146	2	T3	60	150	2.40	0.34	16.24	0.03244
001	146	2	T4	120	140	1.29	0.30	17.57	0.01738
002	113	2	T3	60	130	2.01	0.22	17.95	0.02897
002	113	2	T4	120	120	1.07	0.37	13.32	0.01569
003	197	2	T3	60	120	3.40	0.34	19.15	0.05472
003	197	2	T4	60	120	3.30	0.33	19.12	0.05472
004	155	2	T3	120	170	1.13	0.22	19.05	0.0152
004	155	2	T4	120	100	1.88	0.29	18.07	0.02583

Figure 6: General Hardscape Possible LPA Calculation Results LZ1-2

LZ1 Parking Lot Maximum Spacing Calculations T-24 2016									
									Average: 0.017
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 0.2fc minimum, 20:1 max:min (vertical illuminance not considered)					
Lamp	2017 Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions	Avg. fc	Min. fc	Max:Min	W/sf	
25 Foot Poles									
001	146	1	T3	60	185	1.57	0.23	12.26	0.01315
001	146	1	T4	60	180	1.45	0.24	12.58	0.01352
001	146	1	T5	60	170	0.95	0.23	6.09	0.01431
002	113	1	T3	60	155	1.03	0.23	7.70	0.01215
002	113	1	T4	60	150	0.94	0.22	7.64	0.01256
002	113	1	T5	60	165	0.68	0.21	6.57	0.01141
003	197	1	T3	60	140	1.79	0.33	8.82	0.02345
003	197	1	T4	60	140	1.74	0.32	8.81	0.02345
003	197	1	T5	60	155	1.17	0.20	11.30	0.02118
004	155	1	T3	120	190	0.83	0.20	13.10	0.0068
004	155	1	T4	120	115	1.57	0.20	19.65	0.01123
004	155	1	T5	120	170	0.57	0.20	6.95	0.0076
001	146	2	T3	60	195	1.85	0.23	19.22	0.02496
001	146	2	T4	120	170	1.07	0.22	16.86	0.01431
002	113	2	T3	60	165	1.57	0.21	14.48	0.02283
002	113	2	T4	120	150	0.85	0.21	15.19	0.01256
003	197	2	T3	60	145	2.83	0.32	15.34	0.04529
003	197	2	T4	120	140	1.42	0.24	17.04	0.02345
004	155	2	T3	120	210	0.91	0.22	12.91	0.0123
004	155	2	T4	120	130	1.43	0.21	18.29	0.01987
30 Foot Poles									
001	146	1	T3	60	220	1.22	0.21	10.43	0.01106
001	146	1	T4	60	210	1.13	0.21	11.05	0.01159
001	146	1	T5	60	200	0.72	0.22	4.64	0.01217
002	113	1	T3	60	185	0.80	0.20	6.80	0.01018
002	113	1	T4	60	175	0.79	0.21	6.71	0.01076
002	113	1	T5	60	190	0.52	0.23	4.30	0.00991
003	197	1	T3	60	170	1.40	0.21	10.71	0.01931
003	197	1	T4	60	170	1.36	0.20	10.38	0.01931
003	197	1	T5	60	180	0.89	0.26	6.27	0.01824
004	155	1	T3	120	210	0.74	0.21	10.19	0.00615
004	155	1	T4	120	130	1.31	0.21	14.48	0.00994
004	155	1	T5	120	190	0.50	0.20	4.80	0.0068
001	146	2	T3	60	230	1.44	0.20	16.85	0.02116
001	146	2	T4	120	200	0.91	0.21	13.43	0.01217
002	113	2	T3	60	190	1.27	0.22	10.82	0.01982
002	113	2	T4	120	175	0.74	0.22	9.95	0.01076
003	197	2	T3	60	180	2.15	0.23	16.61	0.03648
003	197	2	T4	120	165	1.22	0.23	12.78	0.0199
004	155	2	T3	120	245	0.78	0.21	11.81	0.01054
004	155	2	T4	120	150	1.21	0.20	15.70	0.01722

Figure 7: General Hardscape Possible LPA Calculation Results LZ1-3

LZ1 Parking Lot Maximum Spacing Calculations T-24 2016									
								Average: 0.017	
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 0.2fc minimum, 20:1 max:min (vertical illuminance not considered)					
Lamp	2017 Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions	Avg. fc	Min. fc	Max:Min	W/sf	
35 Foot Poles									
001	146	1	T3	60	250	0.99	0.20	8.90	0.00973
001	146	1	T4	60	235	0.92	0.21	8.95	0.01035
001	146	1	T5	60	225	0.56	0.21	3.76	0.01081
002	113	1	T3	60	205	0.66	0.25	4.56	0.00919
002	113	1	T4	60	195	0.65	0.22	5.32	0.00966
002	113	1	T5	60	220	0.41	0.20	3.80	0.00856
003	197	1	T3	60	195	1.15	0.20	9.55	0.01684
003	197	1	T4	60	195	1.12	0.20	9.30	0.01684
003	197	1	T5	60	205	0.73	0.25	5.20	0.01602
004	155	1	T3	120	230	0.66	0.21	7.52	0.00562
004	155	1	T4	120	150	1.09	0.20	12.30	0.00861
004	155	1	T5	120	205	0.45	0.21	3.67	0.0063
001	146	2	T3	60	260	1.19	0.20	13.80	0.01872
001	146	2	T4	120	225	0.82	0.21	10.81	0.01081
002	113	2	T3	60	220	1.03	0.20	9.80	0.01712
002	113	2	T4	120	200	0.62	0.24	6.71	0.00942
003	197	2	T3	60	200	1.83	0.27	11.85	0.03283
003	197	2	T4	120	185	1.09	0.27	8.26	0.01775
004	155	2	T3	120	270	0.64	0.20	8.45	0.00957
004	155	2	T4	120	160	1.09	0.20	13.7	0.01615

Figure 8: General Hardscape Possible LPA Calculation Results LZ2-1

LZ2 Parking Lot Maximum Spacing Calculations T-24 2016										
										Average: 0.018
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 .2fc minimum horizontal, .1fc minimum vertical at center, 20:1 max:min						
Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions	Avg. fc	Min. fc	Vert. fc	Max:Min	W/sf	
20 Foot Poles										
001	146	1	T3	60	155	1.93	0.21	0.13	18.43	0.0157
001	146	1	T4	60	145	2.03	0.27	0.13	17.74	0.01678
001	146	1	T5	60	125	1.42	0.54	0.10	3.98	0.01947
002	113	1	T3	60	115	1.43	0.49	0.13	4.57	0.01638
002	113	1	T4	60	115	1.38	0.52	0.12	4.87	0.01638
002	113	1	T5	60	115	1.08	0.63	0.12	3.25	0.01638
003	197	1	T3	60	110	2.32	0.27	0.10	13.19	0.02985
003	197	1	T4	60	105	2.40	0.59	0.13	5.97	0.03127
003	197	1	T5	60	110	1.83	0.94	0.13	3.39	0.02985
004	155	1	T3	120	165	0.94	0.21	0.15	19.71	0.00783
004	155	1	T4	120	90	1.97	0.27	0.67	19.74	0.01435
004	155	1	T5	120	145	0.69	0.20	0.18	10.05	0.00891
001	146	2	T3	60	150	2.40	0.34	0.23	16.24	0.03244
001	146	2	T4	120	140	1.29	0.30	0.20	17.57	0.01738
002	113	2	T3	60	125	2.14	0.35	0.10	11.29	0.03013
002	113	2	T4	120	120	1.07	0.37	0.11	13.32	0.01569
003	197	2	T3	60	115	3.64	0.40	0.12	17.00	0.0571
003	197	2	T4	60	115	3.54	0.39	0.12	16.90	0.0571
004	155	2	T3	120	170	1.13	0.22	0.18	19.05	0.0152
004	155	2	T4	120	100	1.88	0.29	0.69	18.07	0.02583
25 Foot Poles										
001	146	1	T3	60	185	1.57	0.23	0.10	12.26	0.01315
001	146	1	T4	60	165	1.62	0.41	0.12	7.66	0.01475
001	146	1	T5	60	155	1.07	0.44	0.10	3.18	0.0157
002	113	1	T3	60	140	1.12	0.59	0.12	2.95	0.01345
002	113	1	T4	60	135	1.07	0.54	0.11	3.19	0.01395
002	113	1	T5	60	145	0.77	0.46	0.11	3.00	0.01299
003	197	1	T3	60	130	1.93	0.54	0.11	5.39	0.02526
003	197	1	T4	60	130	1.87	0.53	0.11	5.32	0.02526
003	197	1	T5	60	135	1.33	0.74	0.11	3.05	0.02432
004	155	1	T3	120	190	0.73	0.20	0.18	13.10	0.0068
004	155	1	T4	120	115	1.57	0.20	0.82	19.65	0.01123
004	155	1	T5	120	170	0.57	0.20	0.18	6.95	0.0076
001	146	2	T3	60	195	1.85	0.23	0.11	19.22	0.02496
001	146	2	T4	120	170	1.07	0.22	0.23	16.86	0.01431
002	113	2	T3	60	150	1.80	0.46	0.11	6.54	0.02511
002	113	2	T4	120	150	0.85	0.21	0.12	15.19	0.01256
003	197	2	T3	60	140	2.88	0.56	0.10	8.71	0.0469
003	197	2	T4	120	125	1.57	0.41	0.11	9.98	0.02627
004	155	2	T3	120	210	0.91	0.22	0.16	12.91	0.0123
004	155	2	T4	120	130	1.43	0.21	0.66	18.29	0.01987

Figure 9: General Hardscape Possible LPA Calculation Results LZ2-2

LZ2 Parking Lot Maximum Spacing Calculations T-24 2016									
									Average: 0.018
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 .2fc minimum horizontal, .1fc minimum vertical at center, 20:1 max:min					
Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions	Avg. fc	Min. fc	Vert. fc	Max:Min	W/sf
30 Foot Poles									
001	146	1	T3	60	205	1.32	0.33	0.12	6.76 0.01187
001	146	1	T4	60	195	1.25	0.41	0.11	5.66 0.01248
001	146	1	T5	60	175	0.82	0.47	0.11	2.23 0.0139
002	113	1	T3	60	165	0.89	0.55	0.11	2.47 0.01141
002	113	1	T4	60	155	0.86	0.52	0.11	2.71 0.01215
002	113	1	T5	60	170	0.59	0.35	0.11	2.83 0.01108
003	197	1	T3	60	150	1.59	0.72	0.10	3.13 0.02189
003	197	1	T4	60	145	1.61	0.91	0.14	2.40 0.02264
003	197	1	T5	60	160	1.00	0.60	0.13	2.72 0.02052
004	155	1	T3	120	210	0.74	0.21	0.21	10.19 0.00615
004	155	1	T4	120	130	1.31	0.21	0.79	14.48 0.00994
004	155	1	T5	120	190	0.50	0.20	0.17	4.80 0.0068
001	146	2	T3	60	210	1.58	0.36	0.12	9.39 0.02317
001	146	2	T4	120	200	0.91	0.21	0.19	13.43 0.01217
002	113	2	T3	60	170	1.41	0.67	0.12	3.55 0.02216
002	113	2	T4	120	175	0.74	0.22	0.11	9.95 0.01076
003	197	2	T3	60	160	2.42	0.73	0.11	5.23 0.04104
003	197	2	T4	120	165	1.22	0.23	0.10	12.78 0.0199
004	155	2	T3	120	245	0.78	0.21	0.14	11.81 0.01054
004	155	2	T4	120	150	1.21	0.2	0.55	15.7 0.01722
35 Foot Poles									
001	146	1	T3	60	230	1.07	0.34	0.11	5.24 0.01058
001	146	1	T4	60	210	1.01	0.42	0.11	4.48 0.01159
001	146	1	T5	60	200	0.63	0.42	0.10	1.83 0.01217
002	113	1	T3	60	185	0.73	0.53	0.11	2.15 0.01018
002	113	1	T4	60	175	0.70	0.46	0.11	2.54 0.01076
002	113	1	T5	60	195	0.47	0.28	0.10	2.75 0.00966
003	197	1	T3	60	170	1.30	0.76	0.14	2.51 0.01931
003	197	1	T4	60	170	1.26	0.74	0.13	2.50 0.01931
003	197	1	T5	60	185	0.80	0.48	0.10	2.71 0.01775
004	155	1	T3	120	230	0.66	0.21	0.22	7.52 0.00562
004	155	1	T4	120	150	1.09	0.20	0.65	12.30 0.00861
004	155	1	T5	120	205	0.45	0.21	0.16	3.67 0.0063
001	146	2	T3	60	235	1.33	0.38	0.11	7.26 0.02071
001	146	2	T4	120	225	0.82	0.21	0.18	10.81 0.01081
002	113	2	T3	60	190	1.19	0.70	0.13	2.81 0.01982
002	113	2	T4	120	200	0.62	0.24	0.11	6.71 0.00942
003	197	2	T3	60	175	2.11	0.93	0.14	3.47 0.03752
003	197	2	T4	120	185	1.09	0.27	0.14	8.26 0.01775
004	155	2	T3	120	270	0.68	0.20	0.14	8.45 0.00957
004	155	2	T4	120	160	1.09	0.22	0.54	11.86 0.01615

Figure 10: General Hardscape Possible LPA Calculation Results LZ3-1

LZ3 Parking Lot Maximum Spacing Calculations T-24 2016										
									Average: 0.019	
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 Enhanced Security Guidelines .5fc minimum horizontal, .25fc minimum vertical at center, 15:1 max:min						
Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions		Avg. fc	Min. fc	Vert. fc	Max:Min	W/sf
20 Foot Poles										
001	146	1	T3	60	135	2.21	0.58	0.27	6.67	0.01802
001	146	1	T4	60	125	2.34	0.73	0.28	6.56	0.01947
001	146	1	T5	60	115	1.57	0.85	0.27	2.53	0.02116
002	113	1	T3	60	105	1.56	1.05	0.36	2.13	0.01794
002	113	1	T4	60	100	1.54	1.11	0.33	2.28	0.01883
002	113	1	T5	60	105	1.18	0.81	0.31	2.53	0.01794
003	197	1	T3	60	95	2.72	1.61	0.26	2.26	0.03456
003	197	1	T4	60	95	2.64	1.56	0.25	2.26	0.03456
003	197	1	T5	60	95	2.05	1.38	0.31	2.36	0.03456
004	155	1	T3	120	115	1.42	0.51	0.45	9.82	0.01123
004	155	1	T4	120	70	2.48	0.50	0.92	10.80	0.01845
004	155	1	T5	120	90	1.07	0.50	0.39	3.88	0.01435
005	187	1	T3	60	140	3.19	0.62	0.32	9.69	0.02226
005	187	1	T4	120	115	2.07	0.53	0.56	10.75	0.01355
005	187	1	T5	60	105	2.88	1.19	0.27	3.60	0.02968
001	146	2	T3	60	140	2.57	0.59	0.32	9.37	0.03476
001	146	2	T4	120	120	1.50	0.52	0.29	10.15	0.02028
002	113	2	T3	60	110	2.38	1.26	0.31	3.13	0.03424
002	113	2	T4	60	110	2.21	0.99	0.25	5.29	0.03424
003	197	2	T3	60	100	4.08	2.16	0.28	3.01	0.06567
003	197	2	T4	60	100	3.96	2.10	0.28	3.01	0.06567
004	155	1	T3	120	120	1.58	0.54	0.51	7.83	0.01076
004	155	1	T4	120	75	2.55	0.55	0.93	11.85	0.01722
005	187	1	T3	60	145	4.01	0.64	0.29	14.25	0.02149
005	187	1	T4	120	120	2.36	0.54	0.55	14.24	0.01299
25 Foot Poles										
001	146	1	T3	60	160	1.77	0.61	0.27	4.46	0.01521
001	146	1	T4	60	150	1.74	0.69	0.28	4.39	0.01622
001	146	1	T5	60	140	1.16	0.73	0.27	1.92	0.01738
002	113	1	T3	60	130	1.20	0.90	0.26	1.93	0.01449
002	113	1	T4	60	120	1.18	0.86	0.29	1.97	0.01569
002	113	1	T5	60	130	0.84	0.59	0.32	2.31	0.01449
003	197	1	T3	60	120	2.09	1.26	0.25	2.31	0.02736
003	197	1	T4	60	115	2.13	1.49	0.35	1.91	0.02855
003	197	1	T5	60	125	1.38	0.93	0.29	2.41	0.02627
004	155	1	T3	120	145	1.11	0.50	0.45	5.98	0.00891
004	155	1	T4	120	75	2.18	0.51	1.29	7.31	0.01722
004	155	1	T5	120	120	0.80	0.51	0.50	2.80	0.01076
005	187	1	T3	60	195	2.57	0.54	0.28	10.15	0.01598
005	187	1	T4	120	135	1.76	0.52	0.70	7.42	0.01154
005	187	1	T5	120	130	1.16	0.55	0.26	4.58	0.01199
001	146	2	T3	60	165	2.17	0.63	0.27	7.02	0.02949
001	146	2	T4	120	145	1.28	0.54	0.41	7.17	0.01678
002	113	2	T3	60	135	1.91	1.17	0.28	2.60	0.0279
002	113	2	T4	120	135	0.96	0.52	0.25	6.13	0.01395
003	197	2	T3	60	130	3.10	0.89	0.29	5.48	0.05051
003	197	2	T4	60	125	3.17	1.29	0.25	3.70	0.05253
004	155	1	T3	120	150	1.26	0.52	0.47	5.52	0.00861
004	155	1	T4	120	85	2.18	0.51	1.20	8.49	0.0152
005	187	1	T3	120	150	1.91	0.50	0.26	11.20	0.01039
005	187	1	T4	120	140	2.03	0.55	0.63	10.33	0.01113

Figure 11: General Hardscape Possible LPA Calculation Results LZ3-2

LZ3 Parking Lot Maximum Spacing Calculations T-24 2016										
										Average: 0.019
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 Enhanced Security Guidelines .5fc minimum horizontal, .25fc minimum vertical at center, 15:1 max:min						
Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions		Avg. fc	Min. fc	Vert. fc	Max:Min	W/sf
30 Foot Poles										
001	146	1	T3	60	185	1.46	0.59	0.26	3.78	0.01315
001	146	1	T4	60	170	1.39	0.69	0.26	3.36	0.01431
001	146	1	T5	60	160	0.89	0.68	0.27	1.50	0.01521
002	113	1	T3	60	150	0.97	0.74	0.31	1.82	0.01256
002	113	1	T4	60	140	0.93	0.65	0.27	2.12	0.01345
002	113	1	T5	60	145	0.69	0.52	0.34	1.94	0.01299
003	197	1	T3	60	140	1.70	1.26	0.27	1.79	0.02345
003	197	1	T4	60	140	1.65	1.22	0.26	1.79	0.02345
003	197	1	T5	60	145	1.12	0.75	0.30	2.19	0.02264
004	155	1	T3	120	165	0.95	0.51	0.44	4.71	0.00783
004	155	1	T4	120	80	2.02	0.54	1.47	5.93	0.01615
004	155	1	T5	120	135	0.69	0.51	0.47	2.04	0.00957
005	187	1	T3	60	195	2.17	0.54	0.27	8.37	0.01598
005	187	1	T4	120	145	1.51	0.54	0.61	5.28	0.01075
005	187	1	T5	120	150	1.00	0.50	0.35	3.62	0.01039
001	146	2	T3	60	190	1.74	0.64	0.25	5.28	0.02561
001	146	2	T4	120	165	1.12	0.51	0.49	5.63	0.01475
002	113	2	T3	60	155	1.57	1.04	0.32	2.32	0.0243
002	113	2	T4	120	140	0.90	0.51	0.56	4.31	0.01345
003	197	2	T3	60	140	2.76	1.99	0.38	1.92	0.0469
003	197	2	T4	120	135	1.48	0.80	0.30	3.68	0.02432
004	155	1	T3	120	175	1.08	0.52	0.43	4.81	0.00738
004	155	1	T4	120	95	1.89	0.51	1.34	6.98	0.0136
005	187	1	T3	120	190	1.50	0.52	0.27	7.83	0.0082
005	187	1	T4	120	160	1.75	0.59	0.54	7.53	0.00974
35 Foot Poles										
001	146	1	T3	60	205	1.21	0.61	0.25	2.93	0.01187
001	146	1	T4	60	185	1.16	0.71	0.28	2.65	0.01315
001	146	1	T5	60	175	0.72	0.66	0.28	1.20	0.0139
002	113	1	T3	60	170	0.79	0.60	0.27	1.90	0.01108
002	113	1	T4	60	155	0.79	0.54	0.29	2.17	0.01215
002	113	1	T5	60	145	0.63	0.51	0.30	1.53	0.01299
003	197	1	T3	60	160	1.38	1.12	0.28	1.71	0.02052
003	197	1	T4	60	160	1.34	1.09	0.27	1.70	0.02052
003	197	1	T5	60	165	0.90	0.61	0.29	2.13	0.0199
004	155	1	T3	120	165	0.92	0.51	0.51	3.35	0.00783
004	155	1	T4	120	90	1.72	0.53	1.49	5.00	0.01435
004	155	1	T5	120	135	0.66	0.50	0.53	1.66	0.00957
005	187	1	T3	120	190	1.18	0.53	0.47	3.58	0.0082
005	187	1	T4	120	175	1.29	0.54	0.48	4.31	0.0089
005	187	1	T5	120	165	0.91	0.51	0.42	2.80	0.00944
001	146	2	T3	60	205	1.52	0.74	0.28	3.73	0.02374
001	146	2	T4	120	180	1.00	0.54	0.53	4.13	0.01352
002	113	2	T3	60	175	1.30	0.90	0.30	2.19	0.02152
002	113	2	T4	120	150	0.83	0.52	0.60	3.12	0.01256
003	197	2	T3	60	165	2.23	1.45	0.29	2.23	0.0398
003	197	2	T4	120	175	1.15	0.50	0.25	4.46	0.01876
004	155	1	T3	120	200	0.91	0.51	0.38	3.35	0.00646
004	155	1	T4	120	105	1.62	0.53	1.4	5.34	0.0123
005	187	1	T3	120	210	1.35	0.52	0.35	5.98	0.00742
005	187	1	T4	120	185	1.51	0.51	0.39	7.57	0.00842

Figure 12: General Hardscape Possible LPA Calculation Results LZ3-3

LZ3 Parking Lot Maximum Spacing Calculations T-24 2016										
										Average: 0.019
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 Enhanced Security Guidelines .5fc minimum horizontal, .25fc minimum vertical at center, 15:1 max:min						
Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions		Avg. fc	Min. fc	Vert. fc	Max:Min	W/sf
40 Foot Poles										
001	146	1	T3	120	195	0.75	0.51	0.49	1.98	0.00624
001	146	1	T4	120	185	0.76	0.52	0.55	2.19	0.00658
001	146	1	T5	120	115	0.73	0.51	0.85	1.78	0.01058
002	113	1	T3	120	120	0.65	0.52	0.55	1.42	0.00785
002	113	1	T4	120	110	0.68	0.53	0.50	1.62	0.00856
002	113	1	T5	120	70	0.63	0.51	0.3	1.41	0.01345
003	197	1	T3	120	180	0.71	0.56	0.42	1.70	0.00912
003	197	1	T4	120	180	0.67	0.54	0.41	1.70	0.00912
003	197	1	T5	120	150	0.63	0.52	0.60	1.56	0.01094
004	155	1	T3	120	155	0.90	0.51	0.62	2.88	0.00833
004	155	1	T4	120	100	1.747	0.53	1.36	4.53	0.01292
004	155	1	T5	120	120	0.7	0.51	0.79	1.90	0.01076
005	187	1	T3	120	205	1.09	0.53	0.52	3.08	0.0076
005	187	1	T4	120	195	1.11	0.52	0.40	3.67	0.00799
005	187	1	T5	120	190	0.82	0.52	0.43	2.15	0.0082
001	146	2	T3	120	115	0.85	0.51	0.39	3.39	0.02116
001	146	2	T4	120	200	0.89	0.50	0.46	3.60	0.01217
002	113	2	T3	120	185	0.71	0.51	0.53	2.12	0.01018
002	113	2	T4	120	160	0.75	0.52	0.50	2.46	0.01177
003	197	2	T3	120	195	1.06	0.51	0.29	3.49	0.01684
003	197	2	T4	120	195	1.02	0.50	0.25	3.44	0.01684
004	155	1	T3	120	220	0.81	0.51	0.35	2.96	0.00587
004	155	1	T4	120	115	1.41	0.52	1.29	4.88	0.01123
005	187	1	T3	120	230	1.22	0.51	0.36	4.88	0.00678
005	187	1	T4	120	205	1.31	0.51	0.34	6.27	0.0076

Figure 13: General Hardscape Possible LPA Calculation Results LZ4-1

LZ4 Parking Lot Maximum Spacing Calculations T-24 2016									
									Average: 0.020
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 Enhanced Security Guidelines					
				1.0fc minimum horizontal, .25fc minimum vertical at center, 15:1 max:min					
Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions	Avg. fc	Min. fc	Vert. fc	Max:Min	W/sf
30 Foot Poles									
001	146	1	T3	60 160	1.67	1.07	0.59	2.06	0.01521
001	146	1	T4	60 150	1.58	1.04	0.58	2.24	0.01622
001	146	1	T5	60 110	1.29	1.02	1.17	1.72	0.02212
002	113	1	T3	60 120	1.21	1.08	0.87	1.26	0.01569
002	113	1	T4	60 110	1.18	1.06	0.79	1.31	0.01712
002	113	1	T5	60 80	1.14	1.02	0.71	1.25	0.02354
003	197	1	T3	60 140	1.70	1.26	0.27	1.79	0.02345
003	197	1	T4	60 140	1.65	1.22	0.26	1.79	0.02345
003	197	1	T5	60 125	1.29	1.05	0.77	1.57	0.02627
004	155	1	T3	120 100	1.47	1.04	1.04	2.20	0.01292
004	155	1	T4	60 105	2.30	1.02	1.04	4.84	0.0246
004	155	1	T5	60 110	1.35	1.01	0.75	1.68	0.02348
005	187	1	T3	120 140	1.60	1.01	0.53	2.46	0.01113
005	187	1	T4	120 130	1.76	1.13	1.47	2.46	0.01199
005	187	1	T5	120 125	1.21	1.00	0.89	1.89	0.01247
001	146	2	T3	60 170	1.95	1.03	0.48	3.29	0.02863
001	146	2	T4	120 125	1.43	1.07	1.09	2.66	0.01947
002	113	2	T3	60 155	1.07	1.04	0.32	2.32	0.0243
002	113	2	T4	60 130	1.64	1.02	0.60	2.44	0.02897
003	197	2	T3	60 140	2.76	1.99	0.38	1.92	0.0469
003	197	2	T4	120 80	2.44	1.15	0.63	3.69	0.04104
004	155	1	T3	120 125	1.45	1.06	0.88	2.42	0.01033
004	155	1	T4	120 110	2.28	1.02	0.89	4.74	0.01174
005	187	1	T3	120 150	1.89	1.01	0.58	4.04	0.01039
005	187	1	T4	120 140	2.00	1.06	1.13	4.20	0.01113
35 Foot Poles									
001	146	1	T3	60 175	1.41	1.06	0.58	1.70	0.0139
001	146	1	T4	60 160	1.33	1.03	0.52	1.83	0.01521
001	146	1	T5	60 90	1.27	1.11	0.92	1.24	0.02704
002	113	1	T3	60 100	1.31	1.10	0.71	1.35	0.01883
002	113	1	T4	60 100	1.18	1.00	0.58	1.38	0.01883
002	113	1	T5	60 70	1.04	1.01	0.56	1.05	0.0269
003	197	1	T3	60 160	1.38	1.12	0.28	1.71	0.02052
003	197	1	T4	60 160	1.34	1.09	0.27	1.70	0.02052
003	197	1	T5	60 125	1.17	1.00	0.60	1.32	0.02627
004	155	1	T3	60 160	1.43	1.00	0.50	2.85	0.01615
004	155	1	T4	60 110	1.79	1.02	0.72	3.65	0.02348
004	155	1	T5	60 80	1.50	1.05	1.23	1.83	0.03229
005	187	1	T3	120 160	1.39	1.07	0.78	1.80	0.00974
005	187	1	T4	120 150	1.48	1.01	1.04	2.28	0.01039
005	187	1	T5	120 125	1.19	1.05	1.39	1.66	0.01247
001	146	2	T3	60 190	1.62	1.01	0.43	2.74	0.02561
001	146	2	T4	120 135	1.33	1.01	1.10	2.28	0.01802
002	113	2	T3	60 165	1.38	1.01	0.46	1.96	0.02283
002	113	2	T4	60 135	1.50	1.08	0.61	1.84	0.0279
003	197	2	T3	60 165	2.23	1.45	0.29	2.23	0.0398
003	197	2	T4	120 100	1.96	1.11	1.41	2.66	0.03283
004	155	1	T3	120 135	1.30	1.01	0.88	1.87	0.00957
004	155	1	T4	120 115	1.88	1.04	0.63	3.97	0.01123
005	187	1	T3	120 170	1.66	1.03	0.75	3.04	0.00917
005	187	1	T4	120 155	1.79	1.11	0.95	3.49	0.01005

Figure 14: General Hardscape Possible LPA Calculation Results LZ4-2

LZ4 Parking Lot Maximum Spacing Calculations T-24 2016									
									Average: 0.020
Yellow is the limiting factor				Maximum Spacing to meet IESNA RP-20 Enhanced Security Guidelines 1.0fc minimum horizontal, .25fc minimum vertical at center, 15:1 max:min					
Lamp	Luminaire Wattage	# of Heads	Photometric Type	Grid Dimensions	Avg. fc	Min. fc	Vert. fc	Max:Min	W/sf
40 Foot Poles									
001	146	1	T3	60 185	1.21	1.02	0.54	1.42	0.01315
001	146	1	T4	120 80	1.42	1.05	1.05	1.58	0.01521
001	146	1	T5	60 80	1.07	1.03	0.58	1.07	0.03042
002	113	1	T3	60 100	1.15	1.04	0.51	1.24	0.01883
002	113	1	T4	60 85	1.16	1.04	0.48	1.26	0.02216
002	113	1	T5	60 40	1.1	1.05	0.39	1.11	0.04708
003	197	1	T3	120 90	1.31	1.14	0.89	1.29	0.01824
003	197	1	T4	120 90	1.27	1.10	0.86	1.30	0.01824
003	197	1	T5	60 110	1.19	1.01	0.49	1.35	0.02985
004	155	1	T3	60 150	1.36	1.02	0.66	2.16	0.01722
004	155	1	T4	60 105	1.58	1.04	0.57	2.96	0.0246
004	155	1	T5	60 70	1.36	1.04	0.86	1.60	0.0369
005	187	1	T3	120 170	1.3	1.01	0.95	1.64	0.00917
005	187	1	T4	120 160	1.33	1.03	0.83	1.83	0.00974
005	187	1	T5	120 120	1.21	1.01	1.67	1.66	0.01299
001	146	2	T3	120 145	1.22	1.00	1.07	1.76	0.01678
001	146	2	T4	120 135	1.29	1.02	1.08	1.86	0.01802
002	113	2	T3	60 170	1.25	1.03	0.50	1.65	0.02216
002	113	2	T4	60 145	1.15	1.00	0.47	1.72	0.02598
003	197	2	T3	120 130	1.56	1.02	1.29	2.08	0.02526
003	197	2	T4	120 120	1.64	1.05	1.33	2.13	0.02736
004	155	1	T3	120 110	1.43	1.06	1.23	1.68	0.01174
004	155	1	T4	120 110	1.66	1.01	0.51	2.96	0.01174
005	187	1	T3	120 180	1.55	1.05	0.85	2.39	0.00866
005	187	1	T4	120 165	1.61	1.06	0.79	3.03	0.00944

General Hardscape Effective Power Density Calculations Results

Figure 15: General Hardscape Effective LPA Calculation Results

2016 Calculations		2016 Proposed							2016 Proposed		
	eAWA		AWA	LWA	IWA	AWA	LWA	LWA		eAWA - No IWA	eAWA - With IWA
LZ1	0.017	LZ1	0.020	0.15	340	57%	60%	100%	LZ1	0.027	0.037
LZ2	0.018	LZ2	0.030	0.25	420	67%	56%	82%	LZ2	0.041	0.053
LZ3	0.020	LZ3	0.040	0.35	520	44%	58%	68%	LZ3	0.055	0.068
LZ4	0.021	LZ4	0.050	0.45	640	43%	53%	62%	LZ4	0.070	0.089
	W/sf		W/sf	W/ft	W					W/sf	W/sf

Site Description	A- Long Skinny, Big Building	B-Square, Odd Building	C- Odd, Campus Buildings	D- Long Skinny, Small Square Building	E- Square, Small Building	F- Odd, Long Square Building	G- Long Skinny, Odd Building	H- Square, Large Square Building	J- Odd, Large Odd Building	K- Perfect Square Site, No Building
Area, [sf]	501,626	471,726	42,828	28,500	21,000	61,798	21,797	11,040	34,735	250,000
Perimeter, [sf]	6,794	5,131	3,052	960	760	1,940	1,408	1,042	2,593	2,000
Perimeter to Area Ratio	1.4%	1.1%	7.1%	3.4%	3.6%	3.1%	6.5%	9.4%	7.5%	0.8%

Title 24 - 2016: No IWA

LZ1	AWA	W/sf	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020
		W	10,033	9,435	857	570	420	1,236	436	221	695	5,000
LWA	W/lf	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	
	W	1,019	770	458	144	114	291	211	156	389	300	
TOTAL	W	11,052	10,204	1,314	714	534	1,527	647	377	1,084	5,300	Mean
LPD	W/sf	0.022	0.022	0.031	0.025	0.025	0.025	0.030	0.034	0.031	0.021	0.027
%W from AWA		90.8%	92.5%	65.2%	79.8%	78.7%	80.9%	67.4%	58.6%	64.1%	94.3%	77.2%
%W from LWA		9.2%	7.5%	34.8%	20.2%	21.3%	19.1%	32.6%	41.4%	35.9%	5.7%	22.8%

LZ2	AWA	W/sf	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030	
		W	15,049	14,152	1,285	855	630	1,854	654	331	1,042	7,500
LWA	W/lf	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	
	W	1,699	1,283	763	240	190	485	352	261	648	500	
TOTAL	W	16,747	15,435	2,048	1,095	820	2,339	1,006	592	1,690	8,000	Mean
LPD	W/sf	0.033	0.033	0.048	0.038	0.039	0.038	0.046	0.054	0.049	0.032	0.041
%W from AWA		89.9%	91.7%	62.7%	78.1%	76.8%	79.3%	65.0%	56.0%	61.6%	93.8%	75.5%
%W from LWA		10.1%	8.3%	37.3%	21.9%	23.2%	20.7%	35.0%	44.0%	38.4%	6.3%	24.5%

LZ3	AWA	W/sf	0.040	0.040	0.040	0.040	0.040	0.040	0.040	0.040	0.040	
		W	20,065	18,869	1,713	1,140	840	2,472	872	442	1,389	10,000
LWA	W/lf	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	
	W	2,378	1,796	1,068	336	266	679	493	365	908	700	
TOTAL	W	22,443	20,665	2,781	1,476	1,106	3,151	1,365	806	2,297	10,700	Mean
LPD	W/sf	0.045	0.044	0.065	0.052	0.053	0.051	0.063	0.073	0.066	0.043	0.055
%W from AWA		89.4%	91.3%	61.6%	77.2%	75.9%	78.5%	63.9%	54.8%	60.5%	93.5%	74.7%
%W from LWA		10.6%	8.7%	38.4%	22.8%	24.1%	21.5%	36.1%	45.2%	39.5%	6.5%	25.3%

LZ4	AWA	W/sf	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	
		W	25,081	23,586	2,141	1,425	1,050	3,090	1,090	552	1,737	12,500
LWA	W/lf	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	
	W	3,057	2,309	1,373	432	342	873	634	469	1,167	900	
TOTAL	W	28,139	25,895	3,515	1,857	1,392	3,963	1,723	1,021	2,904	13,400	Mean
LPD	W/sf	0.056	0.055	0.082	0.065	0.066	0.064	0.079	0.092	0.084	0.054	0.070
%W from AWA		89.1%	91.1%	60.9%	76.7%	75.4%	78.0%	63.2%	54.1%	59.8%	93.3%	74.2%
%W from LWA		10.9%	8.9%	39.1%	23.3%	24.6%	22.0%	36.8%	45.9%	40.2%	6.7%	25.8%

Title 24 - 2016: With IWA

LZ1	AWA	W/sf	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	0.020	
		W	10,033	9,435	857	570	420	1,236	436	221	695	5,000
LWA	W/lf	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	
	W	1,019	770	458	144	114	291	211	156	389	300	
TOTAL	W	11,392	10,544	1,654	1,054	874	1,867	987	717	1,424	5,640	Mean
LPD	W/sf	0.023	0.022	0.039	0.037	0.042	0.030	0.045	0.065	0.041	0.023	0.037
%W from AWA		88.1%	89.5%	51.8%	54.1%	48.1%	66.2%	44.2%	30.8%	48.8%	88.7%	61.0%
%W from LWA		8.9%	7.3%	27.7%	13.7%	13.0%	15.6%	21.4%	21.8%	27.3%	5.3%	18.2%
%W from IWA		3.0%	3.2%	20.6%	32.3%	38.9%	18.2%	34.4%	47.4%	23.9%	6.0%	22.8%

LZ2	AWA	W/sf	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.030	
		W	15,049	14,152	1,285	855	630	1,854	654	331	1,042	7,500
LWA	W/lf	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	
	W	1,699	1,283	763	240	190	485	352	261	648	500	
TOTAL	W	17,167	15,855	2,468	1,515	1,240	2,759	1,426	1,012	2,110	8,420	Mean
LPD	W/sf	0.034	0.034	0.058	0.053	0.059	0.045	0.065	0.092	0.061	0.034	0.053
%W from AWA		87.7%	89.3%	52.1%	56.4%	50.8%	67.2%	45.9%	32.7%	49.4%	89.1%	62.0%
%W from LWA		9.9%	8.1%	30.9%	15.8%	15.3%	17.6%	24.7%	25.7%	30.7%	5.9%	18.5%
%W from IWA		2.4%	2.6%	17.0%	27.7%	33.9%	15.2%	28.5%	41.5%	19.9%	5.0%	19.5%

Figure 15: General Hardscape Effective LPA Calculation Results (continued)

LZ3	AWA	W/sf	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	
		W	25,081	23,586	2,141	1,425	1,050	3,090	1,090	552	1,737	12,500	
	LWA	W/lf	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	
		W	340	257	153	48	38	97	70	52	130	100	
	IWA	W	520	520	520	520	520	520	520	520	520	520	
	TOTAL	W	25,941	24,363	2,814	1,993	1,608	3,707	1,680	1,124	2,386	13,120	Mean
	LPD	W/sf	0.052	0.052	0.066	0.070	0.077	0.060	0.077	0.102	0.069	0.052	0.068
		%W from AWA	96.7%	96.8%	76.1%	71.5%	65.3%	83.4%	64.9%	49.1%	72.8%	95.3%	77.2%
		%W from LWA	1.3%	1.1%	5.4%	2.4%	2.4%	2.6%	4.2%	4.6%	5.4%	0.8%	3.0%
		%W from IWA	2.0%	2.1%	18.5%	26.1%	32.3%	14.0%	30.9%	46.3%	21.8%	4.0%	19.8%
LZ4	AWA	W/sf	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	0.050	
		W	25,081	23,586	2,141	1,425	1,050	3,090	1,090	552	1,737	12,500	
	LWA	W/lf	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	0.45	
		W	3,057	2,309	1,373	432	342	873	634	469	1,167	900	
	IWA	W	640	640	640	640	640	640	640	640	640	640	
	TOTAL	W	28,779	26,535	4,155	2,497	2,032	4,603	2,363	1,661	3,544	14,040	Mean
	LPD	W/sf	0.057	0.056	0.097	0.088	0.097	0.074	0.108	0.150	0.102	0.056	0.089
		%W from AWA	87.2%	88.9%	51.5%	57.1%	51.7%	67.1%	46.1%	33.2%	49.0%	89.0%	62.1%
		%W from LWA	10.6%	8.7%	33.1%	17.3%	16.8%	19.0%	26.8%	28.2%	32.9%	6.4%	20.0%
		%W from IWA	2.2%	2.4%	15.4%	25.6%	31.5%	13.9%	27.1%	38.5%	18.1%	4.6%	17.9%

Figure 16: General Hardscape Effective Watts Per Square Foot LPA Adjustment Results based on Nine Prototype Properties

Site Description	A- Long Skinny, Big Building	B-Square, Odd Building	C- Odd, Campus Buildings	D- Long Skinny, Small Square Building	E- Square, Small Building	F- Odd, Long Square Building	G- Long Skinny, Odd Building	H- Square, Large Square Building	J- Odd, Large Odd Building	K- Perfect Square Site, No Building	Average
Area, [sf]	501,626	471,726	42,828	28,500	21,000	61,798	21,797	11,040	34,735	250,000	
Perimeter, [sf]	6,794	5,131	3,052	960	760	1,940	1,408	1,042	2,593	2,000	
Perimeter to Area Ratio	1.4%	1.1%	7.1%	3.4%	3.6%	3.1%	6.5%	9.4%	7.5%	0.8%	
Title 24 - 2013											
LZ1	0.038	0.038	0.053	0.043	0.044	0.043	0.051	0.059	0.054	0.037	0.046
LZ2	0.051	0.050	0.077	0.060	0.061	0.059	0.074	0.087	0.079	0.049	0.065
LZ3	0.098	0.097	0.133	0.110	0.112	0.109	0.129	0.147	0.135	0.095	0.116
LZ4	0.127	0.124	0.176	0.144	0.146	0.142	0.170	0.195	0.178	0.122	0.152
Title 24 - 2016											
LZ1	0.022	0.022	0.031	0.025	0.025	0.025	0.030	0.034	0.031	0.021	0.027
LZ2	0.033	0.033	0.048	0.038	0.039	0.038	0.046	0.054	0.049	0.032	0.041
LZ3	0.045	0.044	0.065	0.052	0.053	0.051	0.063	0.073	0.066	0.043	0.055
LZ4	0.056	0.055	0.082	0.065	0.066	0.064	0.079	0.092	0.084	0.054	0.070


APPENDIX D: MODELS FOR GENERAL CALCULATIONS

Models for General Hardscape Allowance Calculations

The general site models used for the hardscape allowance calculations were employed to find the reasonable range of ratios in the hardscape area and perimeter. This is relevant because the method for establishing the general hardscape allowances does not make it possible to directly calculate the impact of a change in the allowances to a typical site without understanding what a reasonable typical site will look like.

Below in Figure 17, the general layout of the sites is provided to give an understanding of the conditions that were anticipated in the calculations.

Figure 17: Nine Site Prototypes Used to Calculate Reasonable Site Impact Calculations

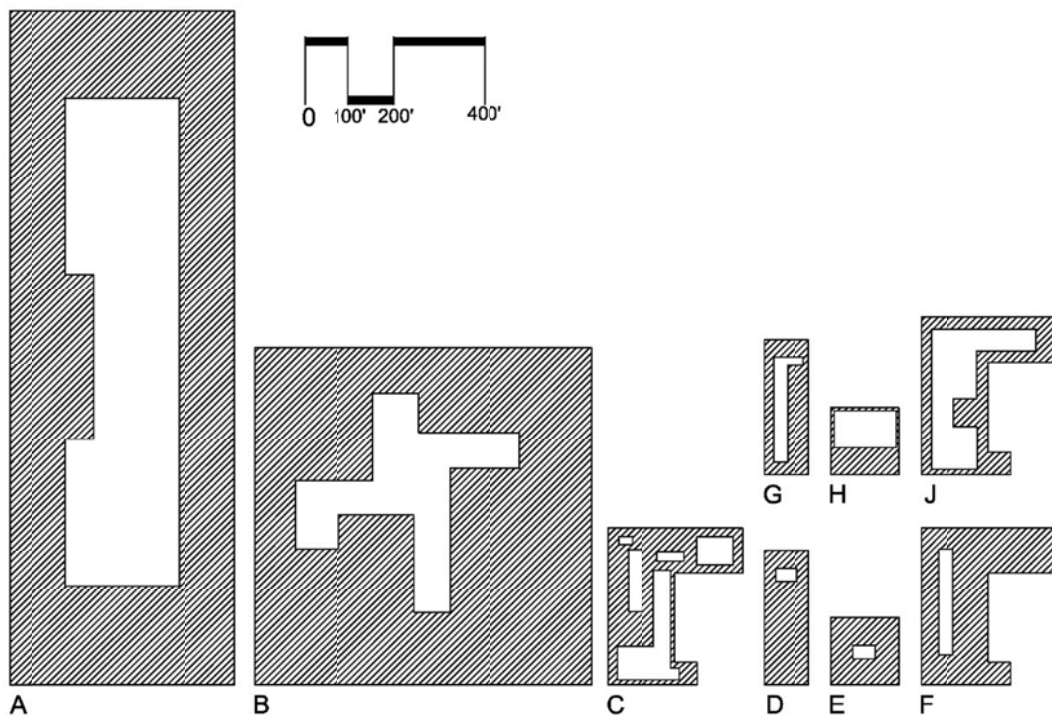

These sites vary in overall hardscape size, as can be seen in the varying amount of grey shaded area in the figures, which impacts the influence of the Initial Wattage Allowance. Further, the sites vary in both the hardscape outside perimeter complexity, and the building complexity, which both impact ratio of the perimeter to the area of the hardscape. Rectangular sites are employed because they are most common, but the proportions are modified because that also impacts the ratio of the perimeter to area.

The site with the lowest perimeter to area percentage will be a circle with no building contained within. As a site deviates farther from that ideal site, the ratio of the perimeter to the area will increase up to a point where a very complex site will have a reasonably high percentage.

The effective site calculation for the general hardscape represents an average of the nine sites shown in Figure 17. The average of these sites is used to represent a typical site for per unit and statewide impacts calculations.


Models for Cost Effectiveness Calculations

There are two methods used to make cost effectiveness calculations. The first is the complete design of a lighting system, which was employed for the general hardscape calculations. This approach is valid in a circumstance where the LED technology is a benefit not only in terms of efficacy, but also in terms of some other aspect, like pole spacing or pole height, which will have cost implications independent of the efficacy issues.

The second is a one-for-one comparison of lighting equipment. This approach was employed for the LPA values of specific applications, like the lighting at building entrances, for example. Most of these applications are unlikely to reduce the equipment quantity substantially as a result of using LED products, so the comparison was done using a one-for-one comparison.

Figure 18 below, provides the site geometry for three applications that were used to make costing comparisons for the general hardscape cost effectiveness calculations.

Figure 18: Three Site Prototypes Used to Calculate Cost Calculations for LED Lighting Systems

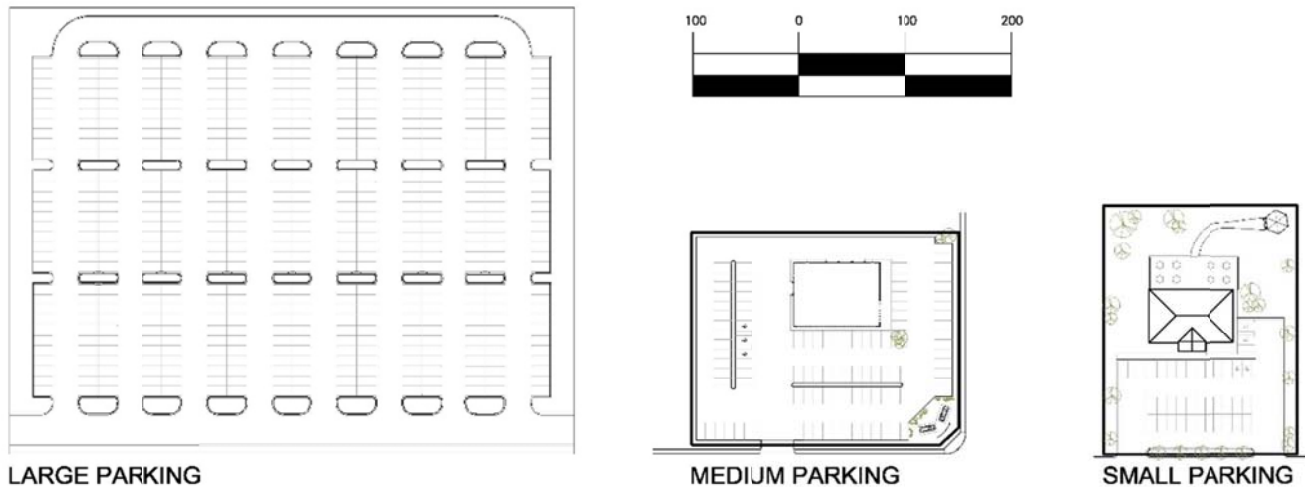

APPENDIX E: LIGHTING USE PROFILES FOR CALCULATIONS

The lighting calculations for energy consumption and TDV employ the following lighting use profiles to represent the variety of circumstances that are likely to occur in nonresidential outdoor lighting conditions.

Because the statewide estimates are built around the building types and not the specific measures (in terms of square footage projections), the use profiles for each individual measure cannot be easily applied to the whole building as a composite. Therefore, a representative use profile was developed taking into account that some lights will be turned off at different times in the night. These profiles are characteristic for the building construction categories and were applied to the statewide estimates only.

Overall Schedule Information

The schedules all include a formula to calculate the actual schedule based on the sunrise and sunset points, and therefore they change from day to day. However, it is possible to characterize them reasonably with winter and summer curves to understand the typical range of hours of operation that will occur.

General Hardscape Schedule Information

The general hardscape calculations for energy savings were made using three schedules. These are shown in Figure 19, Figure 20, and Figure 21. These are applied to the respective building types based on their characterization as nonresidential, hotel, or retail.

Figure 19: Nonresidential Outdoor Lighting Use Curve for General Hardscape (Statewide Use Estimates Only)

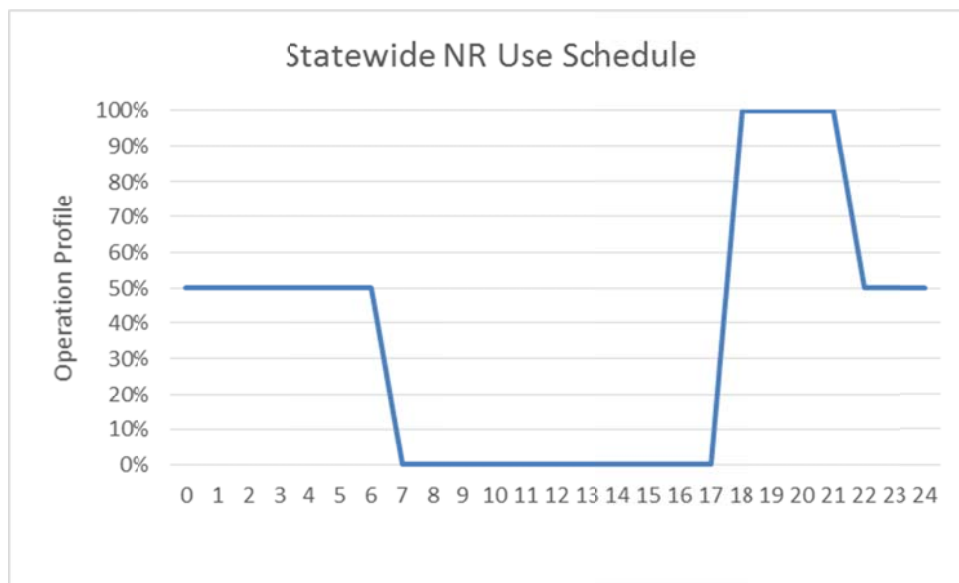


Figure 20: Hotel Outdoor Lighting Use Curve for General Hardscape (Statewide Use Estimates Only)

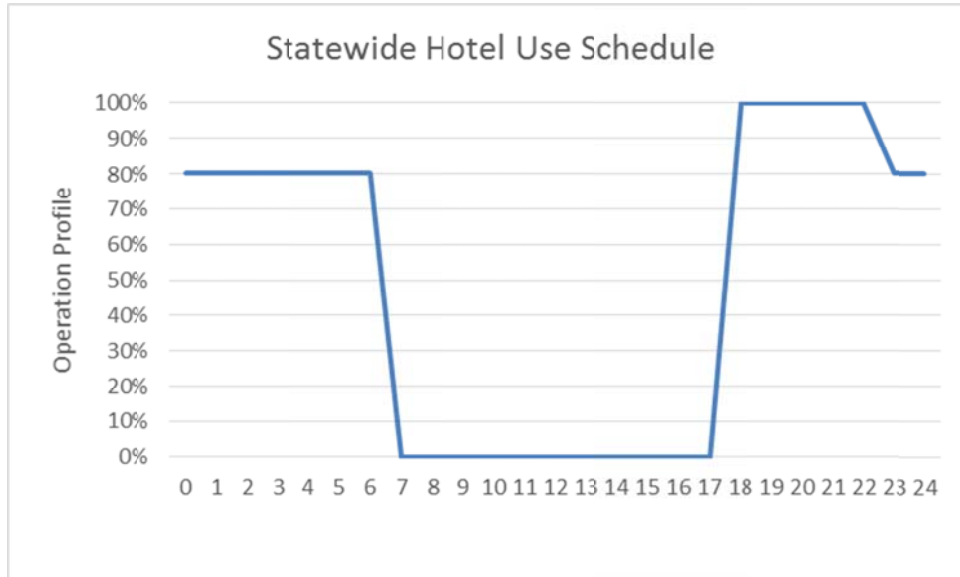


Figure 21: Retail Outdoor Lighting Use Curve for General Hardscape (Statewide Use Estimates Only)




Specific Lighting Application Schedule Information

The specific applications calculations for energy savings were made using schedules provided below. The specific lighting applications are not representative of a large site, but more narrowly focused on a small subset of lighting on a site.

Schedule A: Dusk to Dawn

This schedule is a typical dusk to dawn operation with an additional 30 minutes on each end to represent the photocell setting for higher light levels than might be typically found at the sunset/sunrise point.


Figure 22: Schedule A: Winter and Summer Curves

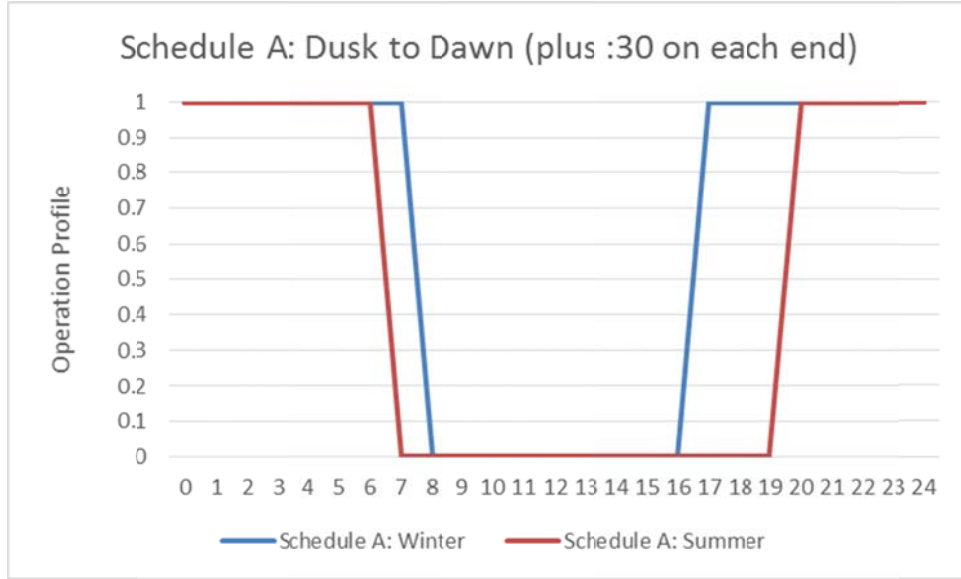

Schedule B: Dusk to 10PM

This schedule is a typical dusk to 10PM operation with an additional 30 minutes on the dusk end to represent the photocell setting for higher light levels than might be typically found at the sunset point. Figure 39 represents a typical lighting system for a retail property, and often also reflects lighting for landscape and outdoor dining conditions.


Figure 23: Schedule B: Winter and Summer Curves

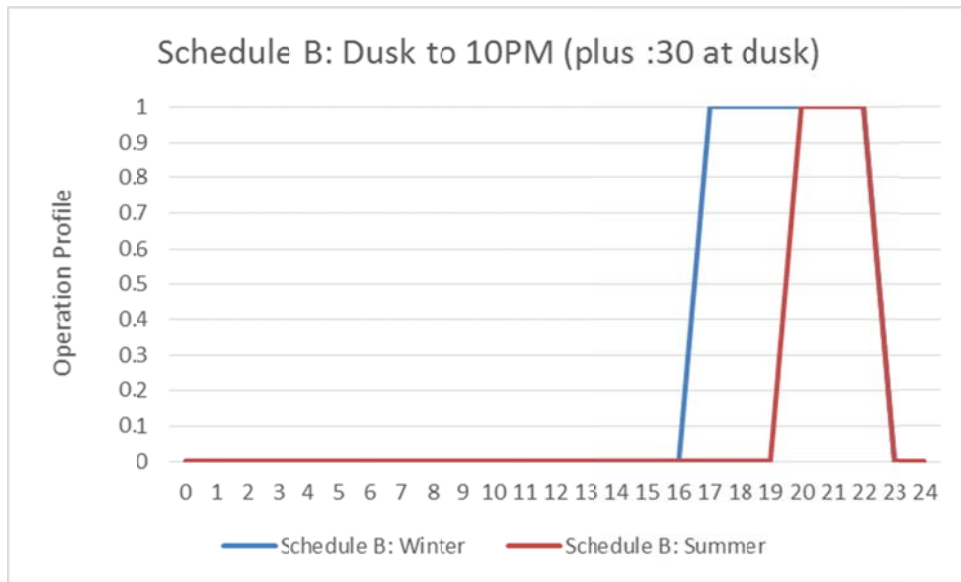

Schedule C: Dusk to Midnight

This schedule is a typical dusk to midnight operation with an additional 30 minutes on the dusk end to represent the photocell setting for higher light levels than might be typically found at the sunset point. Figure 40 represents a typical lighting system for a later-night retail property, some outdoor dining conditions.

Figure 24: Schedule C: Winter and Summer Curves

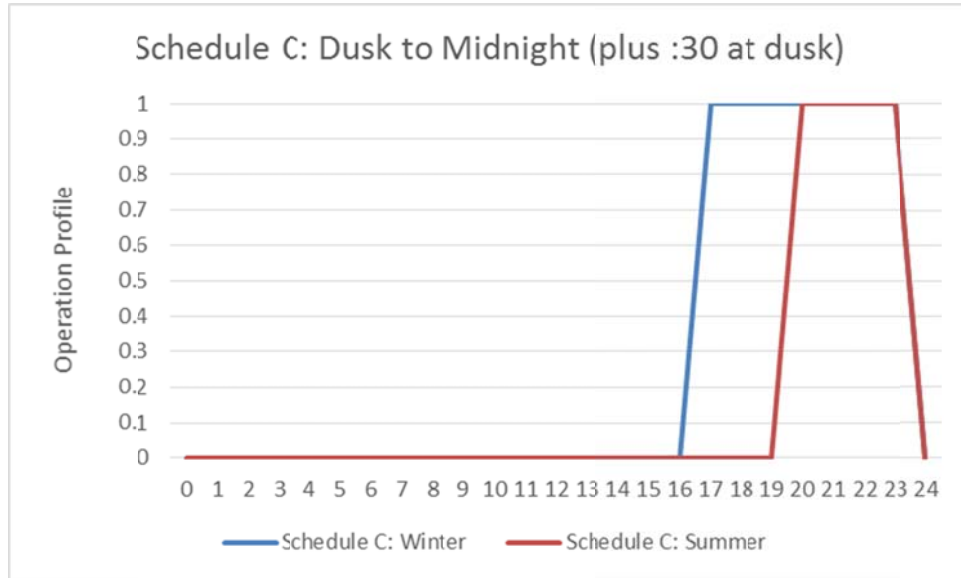

Several specific applications warranted a unique schedule based on the typical functions and hours that are anticipated in typical spaces. These are provided below.

Figure 25: General Hardscape Use Schedule

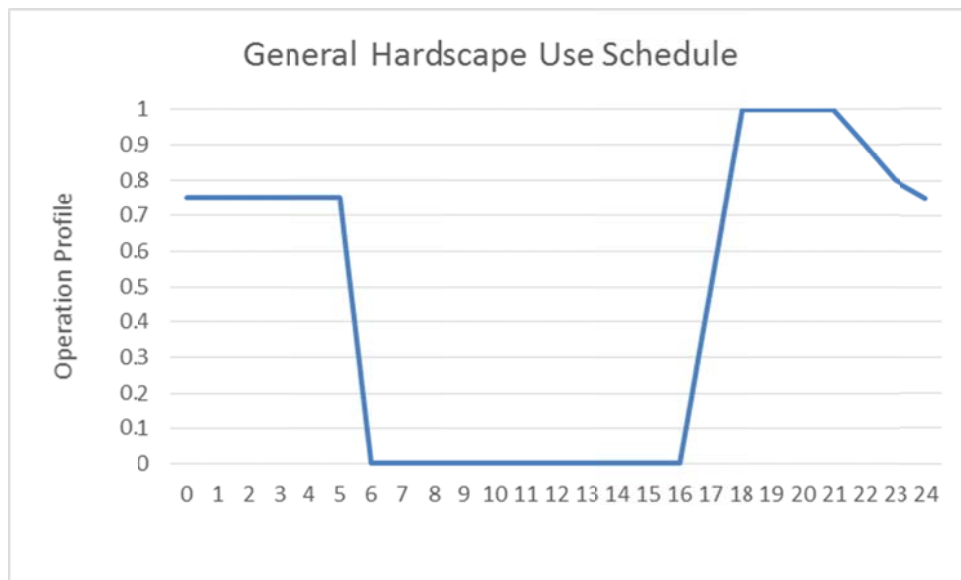


Figure 26: ATM Use Schedule

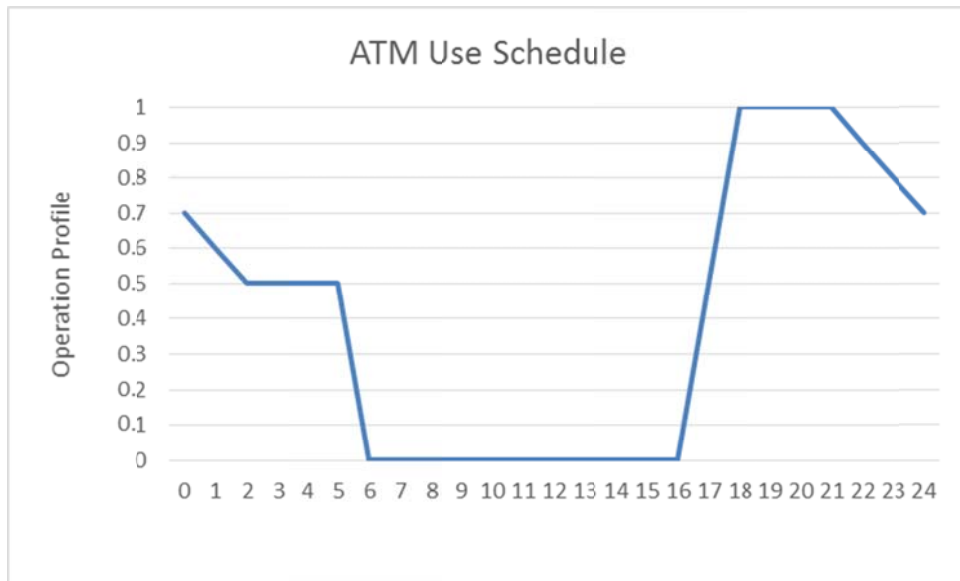


Figure 27: Retail Lighting Use Schedule

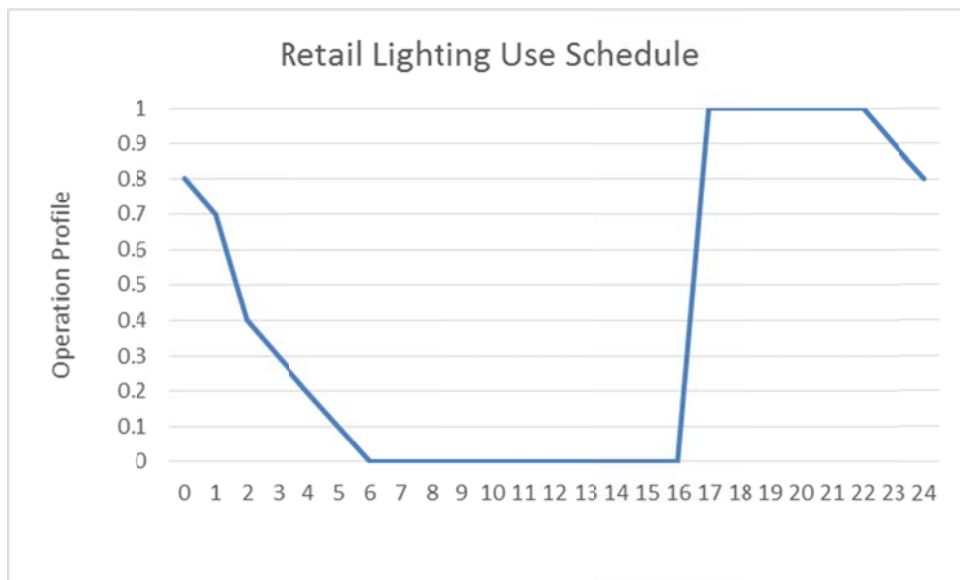


Figure 28: Service Station Canopies Use Schedule

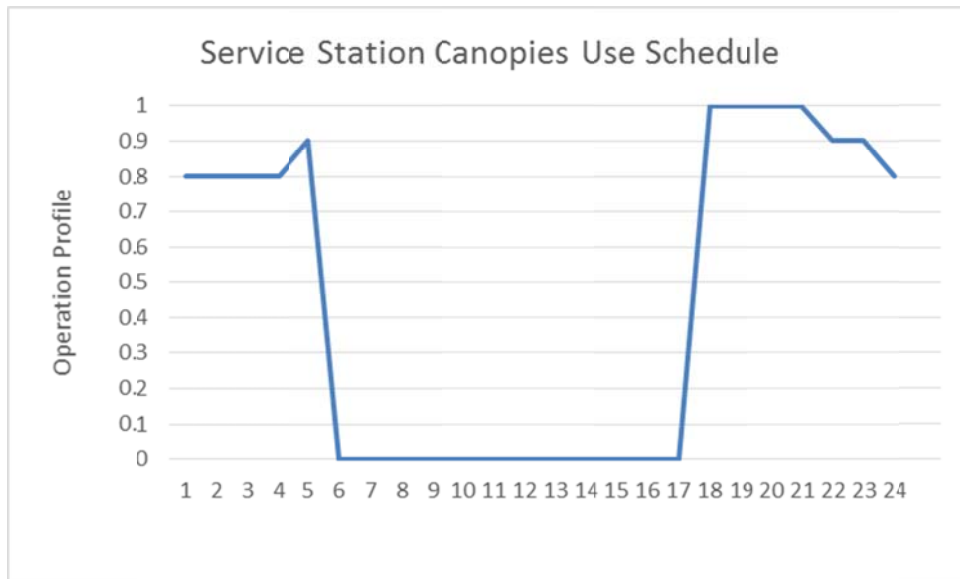


Figure 29: Service Station Hardscape Use Schedule

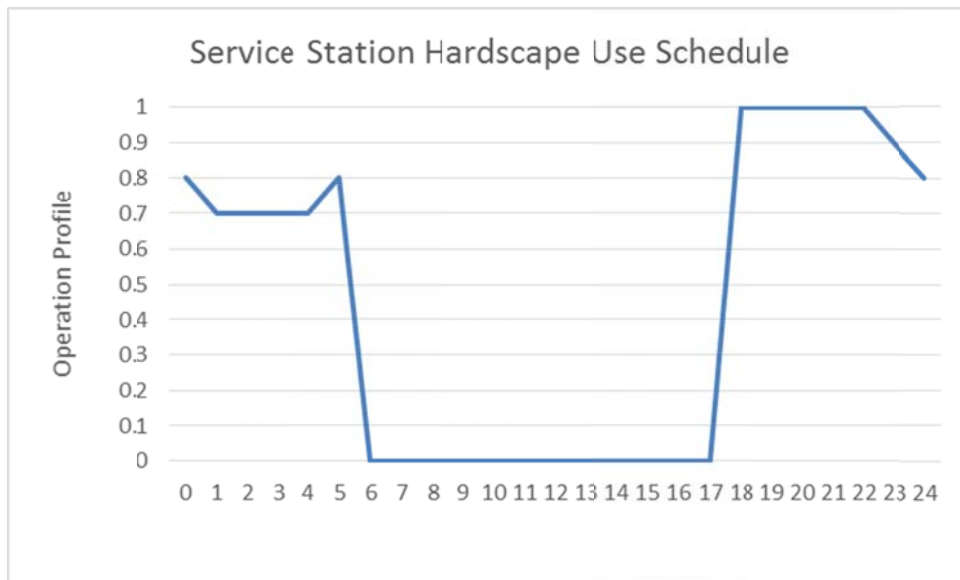


Figure 30 provides information on the various outdoor lighting applications that are designated in the LPA tables and identifies which of the above schedules are applied to these for energy consumption and cost effectiveness calculations.

Figure 30: Lighting Application Schedule Use Matrix

Lighting Application	Use Schedule Applied
General Hardscape	General Hardscape
Building Entrances	Schedule A
Primary Entrances	Schedule A
Drive Up Windows	Retail Lighting
Vehicle Service Uncovered Fuel Dispenser	Schedule A
ATM Machine	ATM
Outdoor Sales Frontage	Schedule C
Hardscape Ornamental Lighting	Schedule C
Building Facades	Retail Lighting
Outdoor Sales Lots	Retail Lighting
Vehicle Service Station Hardscape	Service Station Hardscape
Vehicle Service Station Canopies	Service Station Canopies
Sales Canopies	Retail Lighting
Non-sales Canopies	Schedule A
Guard Stations	Schedule A
Student Pick-up/Drop-off Zone	Schedule B
Outdoor Dining	Schedule B
Special Security Lighting for Retail	Schedule A

APPENDIX F: GENERAL HARDSCAPE COST EFFECTIVENESS CALCULATIONS

The tables below provide the details of the cost calculation runs for the general hardscape cost effectiveness calculations.

The information was collected by polling manufacturer representatives and producing a reasonable average for similarly-specified products, including Type III and Type IV luminaires and those with house-side shields (designated as (HS) in the Item labels).

The cost for the products is based on current pricing, and projects forward to 2017 through cost escalation. The LED products are projected forward in efficacy, with Columns 3 through 5 (lm, 2014 \$/kms, and 2017\$/klm) predicting the cost per lumen of the product based on the DOE cost projections. The result is Column 6, which shows the 2017 cost of the luminaires.

Column 7 (2017 Cost with Installation) adds the projected cost of installation based on Means cost estimations and cost escalation. The final column projects the cost of the product if the current LED technology were employed in 2017, with no cost per lumen savings due to the rapidly advancing LED technology.

Figure 31: Luminaire Costs for Construction, Based on Factory Representative Quotes and Adjusted Forward

Item	2014 Cost	lm	2014 \$/kms	2017 \$/klm**	2017 Cost***	2017 Cost with Installation*	2017 Cost without \$/Klm Reduction
PSMH, Small (HS)	\$ 887.5	--	--	--	\$ 944.59	\$ 1,086.28	\$ 1,086.28
PSMH, Small	\$ 846.0				\$ 900.43	\$ 1,035.49	\$ 1,035.49
PSMH, Large (HS)	\$ 1,161.5	--	--	--	\$ 1,236.22	\$ 1,421.66	\$ 1,421.66
PSMH, Large	\$ 1,079.0				\$ 1,148.41	\$ 1,320.68	\$ 1,320.68
LED, Small (HS)	\$ 1,068.0	4,319	\$ 247.28	\$ 173.10	\$ 859.74	\$ 988.70	\$ 1,307.21
LED, Small	\$ 1,056.0	5,129	\$ 205.89	\$ 144.12	\$ 850.08	\$ 977.59	\$ 1,292.53
LED, Medium (HS)	\$ 1,675.0	9,487	\$ 176.56	\$ 123.59	\$ 1,348.38	\$ 1,550.63	\$ 2,050.17
LED, Medium	\$ 1,663.0	10,705	\$ 155.35	\$ 108.74	\$ 1,338.72	\$ 1,539.52	\$ 2,035.48
LED, Large OPT1 (HS)	\$ 1,675.0	15,790	\$ 106.08	\$ 74.26	\$ 1,348.38	\$ 1,550.63	\$ 2,050.17
LED, Large OPT1	\$ 1,663.0	17,928	\$ 92.76	\$ 64.93	\$ 1,338.72	\$ 1,539.52	\$ 2,035.48
25ft Pole	\$ 829.0	--	--	--	\$ 882.33	\$ 1,014.68	\$ 1,014.68
30ft Pole	\$ 1,045.0	--	--	--	\$ 1,112.23	\$ 1,279.06	\$ 1,279.06
35ft Pole OPT1	\$ 1,304.0	--	--	--	\$ 1,387.89	\$ 1,596.07	\$ 1,596.07
PSMH, Wall Pack	\$ 322.0	--	--	--	\$ 342.71	\$ 394.12	\$ 394.12
LED, Large OPT2	\$ 1,366.0	11,294	\$ 120.95	\$ 84.66	\$ 1,099.63	\$ 1,264.57	\$ 1,671.96
35ft Pole OPT2	\$ 1,516.0	--	--	--	\$ 1,613.53	\$ 1,855.56	\$ 1,855.56
39ft Pole OPT2	\$ 1,874.0	--	--	--	\$ 1,994.56	\$ 2,293.74	\$ 2,293.74

Notes:

*Installation Mark-Up 0.15

**2017 LED Cost 0.3

**2017 LED Source Report_SSL Trend Analysis 2013.pdf, Executive Summary

***Retail Rate Escalation 0.021

***Retail Rate Source Title24_2013_TDV_Methodology_Report_23Feb2011.pdf, Retail Rate Escalation

Figure 32: Itemized Costs for Construction, Based on RS Means and Adjusted Forward

ITEM	2012 Means			San Francisco Adder			2012 Cost	2014 Cost	2017 Cost
	Conduit or	Fittings	Boxes	Trenching	%	2012 Sub-			
	Mat.								
1/2" EMT w/fittings and boxes	3.13	0.757	0.305		1.312	\$ 4.19	\$ 5.50	\$ 5.73	\$ 6.10
3/4" Sched 80 PVC w/box 300'	4.11	1.048	1.000	8.95	1.312	\$ 15.11	\$ 19.82	\$ 20.66	\$ 21.99
1" Sched 80 PVC w/box 300'	5.43	1.175	1.000	8.95	1.312	\$ 16.56	\$ 21.72	\$ 22.64	\$ 24.10
1 1/4" Sched 80 PVC w/box 300'	6.95	1.301	1.333	8.95	1.312	\$ 18.53	\$ 24.32	\$ 25.35	\$ 26.98
1 1/2" Sched 80 PVC w/box 300'	7.75	1.447	1.667	8.95	1.312	\$ 19.81	\$ 26.00	\$ 27.10	\$ 28.84
2" Sched 80 PVC w/box 300'	10.07	1.724	2.000	8.95	1.312	\$ 22.74	\$ 29.84	\$ 31.11	\$ 33.11
THWN #12 AWG CU	0.5185				1.312	\$ 0.52	\$ 0.68	\$ 0.71	\$ 0.75
THWN #10 AWG CU	0.63				1.312	\$ 0.63	\$ 0.83	\$ 0.86	\$ 0.92
THWN #8 AWG CU	0.85				1.312	\$ 0.85	\$ 1.12	\$ 1.16	\$ 1.24
THWN #6 AWG CU	1.21				1.312	\$ 1.21	\$ 1.59	\$ 1.65	\$ 1.76
THWN #4 AWG CU	1.68				1.312	\$ 1.68	\$ 2.20	\$ 2.30	\$ 2.45
THWN #3 AWG CU	1.965				1.312	\$ 1.97	\$ 2.58	\$ 2.69	\$ 2.86
THWN #2 AWG CU	2.345				1.312	\$ 2.35	\$ 3.08	\$ 3.21	\$ 3.41
FOUNDATIONS (Mat. & Labor)									
Foundation 25' pole CDOT	575	75		420.15	1.242	\$ 1,070.15	\$ 1,329.13	\$ 1,385.54	\$ 1,474.67
Foundation 30' pole CDOT	637	75		495	1.242	\$ 1,207.00	\$ 1,499.09	\$ 1,562.72	\$ 1,663.25
Foundation 35' pole CDOT	762	75		619	1.242	\$ 1,456.00	\$ 1,808.35	\$ 1,885.10	\$ 2,006.37
Foundation 39' pole CDOT	762	75		619	1.242	\$ 1,456.00	\$ 1,808.35	\$ 1,885.10	\$ 2,006.37
LIGHT STANDARD POLES (Labor Only)									
Light Standard 25' pole				451	1.312	\$ 451.00	\$ 591.71	\$ 616.82	\$ 656.51
Light Standard 30' pole				502.6	1.312	\$ 502.60	\$ 659.41	\$ 687.40	\$ 731.62
Light Standard 35' pole				525	1.312	\$ 525.00	\$ 688.80	\$ 718.03	\$ 764.23
Light Standard 39' pole				678	1.312	\$ 678.00	\$ 889.54	\$ 927.29	\$ 986.94
LUMINAIRES (Labor Only)									
70W PSMH, Small				33	1.312	\$ 33.00	\$ 43.30	\$ 45.13	\$ 48.04
PSMH Wallpack				33	1.312	\$ 33.00	\$ 43.30	\$ 45.13	\$ 48.04
100W PSMH, Small				39.5	1.312	\$ 39.50	\$ 51.82	\$ 54.02	\$ 57.50
150W PSMH, Small				103	1.312	\$ 103.00	\$ 135.14	\$ 140.87	\$ 149.93
400W PSMH, Large				103	1.312	\$ 103.00	\$ 135.14	\$ 140.87	\$ 149.93
LED, Small				33	1.312	\$ 33.00	\$ 43.30	\$ 45.13	\$ 48.04
LED, Medium				103	1.312	\$ 103.00	\$ 135.14	\$ 140.87	\$ 149.93
LED, Large OPT1				103	1.312	\$ 103.00	\$ 135.14	\$ 140.87	\$ 149.93
PULL BOXES (Polymer Concrete Tier22)									
11"x18"x12"Dp. Bottomless	475	375			1.312	\$ 850.00	\$ 1,115.20	\$ 1,162.53	\$ 1,237.32
PANEL BOARD ADDER									
100A-120/240V-1PH, 30-POLE	1975	500			1.312	\$ 2,475.00	\$ 3,247.20	\$ 3,385.01	\$ 3,602.78

The cost estimating process involves producing a design on each lot in order to develop the quantities of equipment needed to meet the IES design criteria for each scenario.

These lighting designs are also put through an electrical design step to predict the cost implications of the electrical supply system, since this is a substantial portion of the total cost of a parking lot lighting design. The quantity take-offs of the lighting and electrical systems are built upon the information visible in Figure 32 above and are shown in summary form in the following Tables.

Figure 33: Costing Calculations for LZ1 of Real Site Design

Small Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	7	\$ 888	\$ 1,086	\$ 7,604
Labor, Luminaire	7	\$ 45	\$ 48	\$ 336
25ft Pole	7	\$ 829	\$ 1,015	\$ 7,103
Labor, Pole	7	\$ 617	\$ 657	\$ 4,596
Foundation	7	\$ 1,386	\$ 1,475	\$ 10,323
Conduit 3/4"PVC	605	\$ 21	\$ 22	\$ 13,305
Wiring #10AWG CU	1685	\$ 1	\$ 1	\$ 1,545
Total				\$ 44,812

Small Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Small (HS)	4	\$ 1,068	\$ 989	\$ 3,955	\$ 5,229
Labor, Luminaire	4	\$ 45	\$ 48	\$ 192	\$ 192
25ft Pole	4	\$ 829	\$ 1,015	\$ 4,059	\$ 4,059
Labor, Pole	4	\$ 617	\$ 657	\$ 2,626	\$ 2,626
Foundation	4	\$ 1,386	\$ 1,475	\$ 5,899	\$ 5,899
Conduit 3/4"PVC	425	\$ 21	\$ 22	\$ 9,347	\$ 9,347
Wiring #12AWG CU	1975	\$ 1	\$ 1	\$ 1,491	\$ 1,491
Total				\$ 27,568	\$ 28,842

Medium Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	6	\$ 888	\$ 1,086	\$ 6,518
PSMH, Small	12	\$ 846	\$ 1,035	\$ 12,426
Labor, Luminaire	18	\$ 45	\$ 48	\$ 865
PSMH, Wall Pack	3	\$ 322	\$ 394	\$ 1,182
Labor, Luminaire	3	\$ 45	\$ 48	\$ 144
25ft Pole	12	\$ 829	\$ 1,015	\$ 12,176
Labor, Pole	12	\$ 617	\$ 657	\$ 7,878
Foundation	12	\$ 1,386	\$ 1,475	\$ 17,696
Conduit 1 1/2"PVC	910	\$ 27	\$ 29	\$ 26,246
Conduit 1/2"EMT	150	\$ 6	\$ 6	\$ 915
Wiring #4 AWG CU	3590	\$ 2	\$ 2	\$ 8,779
Wiring #12AWG CU	620	\$ 1	\$ 1	\$ 468
Total				\$ 95,294

Medium Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Small (HS)	3	\$ 1,068	\$ 989	\$ 2,966	\$ 3,922
LED, Small	8	\$ 1,056	\$ 978	\$ 7,821	\$ 10,340
Labor, Luminaire	11	\$ 45	\$ 48	\$ 528	\$ 528
25ft Pole	7	\$ 829	\$ 1,015	\$ 7,103	\$ 7,103
Labor, Pole	7	\$ 617	\$ 657	\$ 4,596	\$ 4,596
Foundation	7	\$ 1,386	\$ 1,475	\$ 10,323	\$ 10,323
Conduit 1"PVC	620	\$ 23	\$ 24	\$ 14,941	\$ 14,941
Wiring #8 AWG CU	3050	\$ 1	\$ 1	\$ 3,774	\$ 3,774
Total				\$ 33,336	\$ 55,526

Large Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	24	\$ 888	\$ 1,086	\$ 26,071
PSMH, Small	42	\$ 846	\$ 1,035	\$ 43,491
Labor, Luminaire	66	\$ 45	\$ 48	\$ 3,170
30ft Pole	45	\$ 1,045	\$ 1,279	\$ 57,558
Labor, Pole	45	\$ 687	\$ 732	\$ 32,923
Foundation	45	\$ 1,563	\$ 1,663	\$ 74,846
Conduit 2"PVC	3090	\$ 31	\$ 33	\$ 102,303
Wiring #4 AWG CU	15887	\$ 2	\$ 2	\$ 38,852
Total				\$ 379,214

Large Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Small	56	\$ 1,056	\$ 978	\$ 54,745	\$ 72,381
Labor, Luminaire	56	\$ 45	\$ 48	\$ 2,690	\$ 2,690
25ft Pole	35	\$ 829	\$ 1,015	\$ 35,514	\$ 35,514
Labor, Pole	35	\$ 617	\$ 657	\$ 22,978	\$ 22,978
Foundation	35	\$ 1,386	\$ 1,475	\$ 51,613	\$ 51,613
Conduit 2"PVC	2580	\$ 31	\$ 33	\$ 85,418	\$ 85,418
Wiring #6 AWG CU	13580	\$ 2	\$ 2	\$ 23,919	\$ 23,919
Total				\$ 276,877	\$ 294,514

Figure 34: Costing Calculations for LZ2 of Real Site Design

Small Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	7	\$ 888	\$ 945	\$ 6,612
Labor, Luminaire	7	\$ 45	\$ 48	\$ 336
25ft Pole	7	\$ 829	\$ 1,015	\$ 7,103
Labor, Pole	7	\$ 617	\$ 657	\$ 4,596
Foundation	7	\$ 1,386	\$ 1,475	\$ 10,323
Conduit 3/4"PVC	605	\$ 21	\$ 22	\$ 13,305
Wiring #10AWG CU	1685	\$ 1	\$ 1	\$ 1,545
Total				\$ 43,820

Small Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Small (HS)	4	\$ 1,068	\$ 989	\$ 3,955	\$ 5,229
Labor, Luminaire	4	\$ 45	\$ 48	\$ 192	\$ 192
25ft Pole	4	\$ 829	\$ 1,015	\$ 4,059	\$ 4,059
Labor, Pole	4	\$ 617	\$ 657	\$ 2,626	\$ 2,626
Foundation	4	\$ 1,386	\$ 1,475	\$ 5,899	\$ 5,899
Conduit 3/4"PVC	425	\$ 21	\$ 22	\$ 9,347	\$ 9,347
Wiring #12AWG CU	1975	\$ 1	\$ 1	\$ 1,491	\$ 1,491
Total				\$ 27,568	\$ 28,842

Medium Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	6	\$ 888	\$ 1,086	\$ 6,518
PSMH, Small	12	\$ 846	\$ 1,035	\$ 12,426
Labor, Luminaire	18	\$ 45	\$ 48	\$ 865
PSMH, Wall Pack	2	\$ 322	\$ 394	\$ 788
Labor, Luminaire	2	\$ 45	\$ 48	\$ 96
25ft Pole	12	\$ 829	\$ 1,015	\$ 12,176
Labor, Pole	12	\$ 617	\$ 657	\$ 7,878
Foundation	12	\$ 1,386	\$ 1,475	\$ 17,696
Conduit 1 1/2"PVC	910	\$ 27	\$ 29	\$ 26,246
Conduit 1/2"EMT	150	\$ 6	\$ 6	\$ 915
Wiring #4 AWG CU	3590	\$ 2	\$ 2	\$ 8,779
Wiring #12AWG CU	620	\$ 1	\$ 1	\$ 468
Total				\$ 94,852

Medium Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Small (HS)	3	\$ 1,068	\$ 989	\$ 2,966	\$ 3,922
LED, Small	8	\$ 1,056	\$ 978	\$ 7,821	\$ 10,340
Labor, Luminaire	11	\$ 45	\$ 48	\$ 528	\$ 528
25ft Pole	7	\$ 829	\$ 1,015	\$ 7,103	\$ 7,103
Labor, Pole	7	\$ 617	\$ 657	\$ 4,596	\$ 4,596
Foundation	7	\$ 1,386	\$ 1,475	\$ 10,323	\$ 10,323
Conduit 1"PVC	620	\$ 23	\$ 24	\$ 14,941	\$ 14,941
Wiring #8 AWG CU	3050	\$ 1	\$ 1	\$ 3,774	\$ 3,774
Total				\$ 33,336	\$ 55,526

Large Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	16	\$ 888	\$ 945	\$ 15,114
PSMH, Small	42	\$ 846	\$ 1,035	\$ 43,491
Labor, Luminaire	58	\$ 54	\$ 57	\$ 3,335
25ft Pole	37	\$ 829	\$ 1,015	\$ 37,543
Labor, Pole	37	\$ 617	\$ 657	\$ 24,291
Foundation	37	\$ 1,386	\$ 1,475	\$ 54,563
Conduit 2"PVC	2875	\$ 31	\$ 33	\$ 95,185
Wiring #4 AWG CU	13935	\$ 2	\$ 2	\$ 34,078
Total				\$ 307,599

Large Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Small	56	\$ 1,056	\$ 978	\$ 54,745	\$ 72,381
Labor, Luminaire	56	\$ 45	\$ 48	\$ 2,690	\$ 2,690
25ft Pole	35	\$ 829	\$ 1,015	\$ 35,514	\$ 35,514
Labor, Pole	35	\$ 617	\$ 657	\$ 22,978	\$ 22,978
Foundation	35	\$ 1,386	\$ 1,475	\$ 51,613	\$ 51,613
Conduit 2"PVC	2580	\$ 31	\$ 33	\$ 85,418	\$ 85,418
Wiring #6 AWG CU	13580	\$ 2	\$ 2	\$ 23,919	\$ 23,919
Total				\$ 276,877	\$ 294,514

Figure 35: Costing Calculations for LZ3 of Real Site Design

Small Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	7	\$ 888	\$ 1,086	\$ 7,604
Labor, Luminaire	7	\$ 141	\$ 150	\$ 1,050
30ft Pole	7	\$ 1,045	\$ 1,279	\$ 8,953
Labor, Pole	7	\$ 687	\$ 732	\$ 5,121
Foundation	7	\$ 1,563	\$ 1,663	\$ 11,643
Conduit 1"PVC	605	\$ 23	\$ 24	\$ 14,580
Wiring #8AWG CU	1685	\$ 1	\$ 1	\$ 2,085
Total				\$ 51,036

Small Parking LED

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost, \$/Klm Cost Reduction	2017 Total Cost, without \$/Klm Reduction
LED, Medium (HS)	4	\$ 1,675	\$ 1,551	\$ 6,203	\$ 8,201
Labor, Luminaire	4	\$ 54	\$ 57	\$ 230	\$ 230
30ft Pole	4	\$ 1,045	\$ 1,279	\$ 5,116	\$ 5,116
Labor, Pole	4	\$ 687	\$ 732	\$ 2,926	\$ 2,926
Foundation	4	\$ 1,563	\$ 1,663	\$ 6,653	\$ 6,653
Conduit 3/4"PVC	360	\$ 21	\$ 22	\$ 7,917	\$ 7,917
Wiring #12AWG CU	1350	\$ 1	\$ 1	\$ 1,019	\$ 1,019
Total				\$ 30,064	\$ 32,063

Medium Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	5	\$ 888	\$ 1,086	\$ 5,431
PSMH, Small	8	\$ 846	\$ 1,035	\$ 8,284
Labor, Luminaire	13	\$ 141	\$ 150	\$ 1,949
PSMH, Wall Pack	1	\$ 322	\$ 394	\$ 394
Labor, Luminaire	1	\$ 45	\$ 48	\$ 48
35ft Pole OPT1	9	\$ 1,304	\$ 1,596	\$ 14,365
Labor, Pole	9	\$ 718	\$ 764	\$ 6,878
Foundation	9	\$ 1,885	\$ 2,006	\$ 18,057
Conduit 2"PVC	760	\$ 31.11	\$ 33.11	\$ 25,162
Conduit 1/2"EMT	100	\$ 6	\$ 6	\$ 610
Wiring #2 AWG CU	2990	\$ 3	\$ 3	\$ 10,206
Wiring #12AWG CU	305	\$ 1	\$ 1	\$ 230
Total				\$ 91,615

Medium Parking LED

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost, \$/Klm Cost Reduction	2017 Total Cost, without \$/Klm Reduction
LED, Medium (HS)	4	\$ 1,675	\$ 1,551	\$ 6,203	\$ 8,201
LED, Medium	8	\$ 1,663	\$ 1,540	\$ 12,316	\$ 16,284
Labor, Luminaire	12	\$ 54	\$ 57	\$ 690	\$ 690
30ft Pole	8	\$ 1,045	\$ 1,279	\$ 10,232	\$ 10,232
Labor, Pole	8	\$ 687	\$ 732	\$ 5,853	\$ 5,853
Foundation	8	\$ 1,563	\$ 1,663	\$ 13,306	\$ 13,306
Conduit 1 1/4"PVC	635	\$ 25.35	\$ 26.98	\$ 17,132	\$ 17,132
Wiring #6 AWG CU	3250	\$ 2	\$ 2	\$ 5,724	\$ 5,724
Total				\$ 48,600	\$ 77,423

Large Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Small (HS)	16	\$ 888	\$ 945	\$ 15,114
PSMH, Small	42	\$ 846	\$ 1,035	\$ 43,491
Labor, Luminaire	58	\$ 141	\$ 150	\$ 8,696
35ft Pole OPT1	28	\$ 1,304	\$ 1,596	\$ 44,690
Labor, Pole	28	\$ 718	\$ 764	\$ 21,398
Foundation	28	\$ 1,885	\$ 2,006	\$ 56,178
Conduit 2"PVC	3055	\$ 31.11	\$ 33.11	\$ 101,144
Wiring #4 AWG CU	19220	\$ 2	\$ 2	\$ 47,003
Panel & feeder Ad	1	\$ 3,247	\$ 3,603	\$ 3,603
Total				\$ 337,714

Large Parking LED

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost, \$/Klm Cost Reduction	2017 Total Cost, without \$/Klm Reduction
LED, Large OPT1	34	\$ 1,663	\$ 1,540	\$ 52,344	\$ 69,206
Labor, Luminaire	34	\$ 141	\$ 150	\$ 5,098	\$ 5,098
35ft Pole OPT1	22	\$ 1,304	\$ 1,596	\$ 35,114	\$ 35,114
Labor, Pole	22	\$ 718	\$ 764	\$ 16,813	\$ 16,813
Foundation	22	\$ 1,885	\$ 2,006	\$ 44,140	\$ 44,140
Conduit 2"PVC	3065	\$ 31	\$ 33	\$ 101,475	\$ 101,475
Wiring #4 AWG CU	17395	\$ 2	\$ 2	\$ 42,540	\$ 42,540
Total				\$ 297,523	\$ 314,386

Figure 36: Costing Calculations for LZ4 of Real Site Design

Small Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Large (HS)	6	\$ 1,162	\$ 1,422	\$ 8,530
Labor, Luminaire	6	\$ 141	\$ 150	\$ 900
35ft Pole OPT1	6	\$ 1,304	\$ 1,596	\$ 9,576
Labor, Pole	6	\$ 718	\$ 764	\$ 4,585
Foundation	6	\$ 1,885	\$ 2,006	\$ 12,038
Conduit 1"PVC	420	\$ 23	\$ 24	\$ 10,121
Wiring #6AWG CU	1520	\$ 2	\$ 2	\$ 2,677
Total				\$ 48,428

Small Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Large OPT1 (H	6	\$ 1,675	\$ 1,551	\$ 9,304	\$ 12,301
Labor, Luminaire	6	\$ 141	\$ 150	\$ 900	\$ 900
30ft Pole	6	\$ 1,045	\$ 1,279	\$ 7,674	\$ 7,674
Labor, Pole	6	\$ 687	\$ 732	\$ 4,390	\$ 4,390
Foundation	6	\$ 1,563	\$ 1,663	\$ 9,980	\$ 9,980
Conduit 3/4"PVC	435	\$ 21	\$ 22	\$ 9,567	\$ 9,567
Wiring #8AWG CU	1845	\$ 1	\$ 1	\$ 2,283	\$ 2,283
Total				\$ 44,096	\$ 47,094

Medium Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Large (HS)	4	\$ 1,162	\$ 1,422	\$ 5,687
PSMH, Large	8	\$ 1,079	\$ 1,321	\$ 10,565
Labor, Luminaire	12	\$ 141	\$ 150	\$ 1,799
30ft Pole	8	\$ 1,045	\$ 1,279	\$ 10,232
Labor, Pole	8	\$ 687	\$ 732	\$ 5,853
Foundation	8	\$ 1,563	\$ 1,663	\$ 13,306
Ingrade pull box by	8	\$ 1,163	\$ 1,237	\$ 9,899
Conduit 1 1/2"PVC	1080	\$ 31	\$ 33	\$ 35,756
Wiring #3AWG CU	4320	\$ 3	\$ 3	\$ 14,747
Total				\$ 93,098

Medium Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Large OPT2	12	\$ 1,366	\$ 1,265	\$ 15,175	\$ 20,064
Labor, Luminaire	12	\$ 141	\$ 150	\$ 1,799	\$ 1,799
35ft Pole OPT2	8	\$ 1,516	\$ 1,856	\$ 14,844	\$ 14,844
Labor, Pole	8	\$ 718	\$ 764	\$ 6,114	\$ 6,114
Foundation	8	\$ 1,885	\$ 2,006	\$ 16,051	\$ 16,051
Conduit 1 1/2"PVC	700	\$ 27	\$ 29	\$ 20,189	\$ 20,189
Wiring #4AWG CU	3380	\$ 2	\$ 2	\$ 8,266	\$ 8,266
Total				\$ 82,439	\$ 87,327

Large Parking

Item	Quantity	2014 Cost	2017 Cost	2017 Total Cost
PSMH, Large (HS)	24	\$ 1,162	\$ 1,422	\$ 34,120
PSMH, Large	24	\$ 1,079	\$ 1,321	\$ 31,696
Labor, Luminaire	48	\$ 141	\$ 150	\$ 7,197
35ft Pole OPT1	36	\$ 1,304	\$ 1,596	\$ 57,459
Labor, Pole	36	\$ 718	\$ 764	\$ 27,512
Foundation	36	\$ 1,885	\$ 2,006	\$ 72,229
Ingrade pull box by	36	\$ 1,163	\$ 1,237	\$ 44,543
Conduit 2"PVC	5270	\$ 31	\$ 33	\$ 174,478
Wiring #2 AWG CU	28690	\$ 3	\$ 3	\$ 97,935
Panel&feeder add	1	\$ 3,385	\$ 3,603	\$ 3,603
Total				\$ 449,234

Large Parking

Item	Quantity	2014 Cost	2017 Cost	Cost, \$/Klm Cost	Cost, without
LED, Large OPT2	64	\$ 1,366	\$ 1,265	\$ 80,933	\$ 107,005
Labor, Luminaire	64	\$ 141	\$ 150	\$ 9,596	\$ 9,596
39ft Pole OPT2	28	\$ 1,874	\$ 2,294	\$ 64,225	\$ 64,225
Labor, Pole	28	\$ 927	\$ 987	\$ 27,634	\$ 27,634
Foundation	28	\$ 1,885	\$ 2,006	\$ 56,178	\$ 56,178
Conduit 2"PVC	3400	\$ 31	\$ 33	\$ 112,566	\$ 112,566
Wiring #4 AWG CU	21275	\$ 2	\$ 2	\$ 52,029	\$ 52,029
Total				\$ 403,161	\$ 429,234

Figure 37 below, provides a summary of the results of these individual calculations for the respective sites.

The second column (2017 PSMH) shows the projected cost of the PSMH system required to meet the design criteria. The third column (2017 LED, \$/klm Reduction) shows the projected cost of the LED system necessary to meet the same design criteria. In all cases, the overall higher performance of the lighting equipment resulted in reductions in the amount of equipment, and as a result, the installed cost with an LED system produces a lower first cost approach to meet the design requirements.

The final column shows the projected cost of the system without the reduction in the cost of the LED technology that is anticipated. This still has the efficacy improvements factored in, but the calculations presume that there are no savings in the LED cost per lumen compared to today. This represents a very conservative position, as history has proven that the cost will decline as

the technology improves. Even so, the LED lighting systems project to have lower first-cost in 2017.

As a result, the general hardscape cost effectiveness results suggest that the LED baseline measure will not add additional cost to the lighting system compared to the incumbent PSMH technology.

Figure 37: Costing Calculations for Real Site Designs of Three Sites in Four Lighting Zones

LZ1 - 2017 Cost			
	2017 PSMH	2017 LED, \$/klm Reduction	2017 LED, without \$/klm Reduction
Small Parking	\$ 44,812	\$ 27,568	\$ 28,842
Medium Parking	\$ 95,294	\$ 33,336	\$ 55,526
Large Parking	\$ 379,214	\$ 276,877	\$ 294,514

LZ2 - 2017 Cost			
	2017 PSMH	2017 LED, \$/klm Reduction	2017 LED, without \$/klm Reduction
Small Parking	\$ 43,820	\$ 27,568	\$ 28,842
Medium Parking	\$ 94,852	\$ 33,336	\$ 55,526
Large Parking	\$ 307,599	\$ 276,877	\$ 294,514

LZ3 - 2017 Cost			
	2017 PSMH	2017 LED, \$/klm Reduction	2017 LED, without \$/klm Reduction
Small Parking	\$ 51,036	\$ 30,064	\$ 32,063
Medium Parking	\$ 91,615	\$ 48,600	\$ 77,423
Large Parking	\$ 337,714	\$ 297,523	\$ 314,386

LZ4 - 2017 Cost			
	2017 PSMH	2017 LED, \$/klm Reduction	2017 LED, without \$/klm Reduction
Small Parking	\$ 48,428	\$ 44,096	\$ 47,094
Medium Parking	\$ 93,098	\$ 82,439	\$ 87,327
Large Parking	\$ 449,234	\$ 403,161	\$ 429,234

APPENDIX G: STATEWIDE GENERAL HARDSCAPE AREA ESTIMATES INFORMATION

Since the outdoor hardscape is not estimated as part of the construction forecasts, statewide impacts must be completed by making proxies with reasonable estimates of the relationship of the line item to the potential gross square footage of indoor spaces associated with the measure.

In effect, the estimates relate the unit of the measure (square foot of hardscape), with an equivalent unit of gross interior space, which can then be projected using the construction forecasts. Most measure line items only apply to certain building types (retail or small office, for example), and this is taken into account as well.

The process to develop the relationship of General Hardscape square footage to building gross square footage for statewide construction estimates is as follows:

1. Establish the square footage of a parking space (which will be the basic unit of comparison because of the code use of minimum spaces per square foot).
2. Determine any modifications to the basic unit required for specific building types to accommodate specific design requirements. This is primarily to adjust for warehouse buildings.
3. Determine the basic parking requirements for the listed building types in the construction forecasts.
4. Create a table of adjustment factors to apply to the respective building types, normalizing the value back to a single square footage unit to make the calculations work in a direct manner.

Step #1: Establish 'per space' Square Footage

The Statewide CASE Team first established the approximate square footage of hardscape associated with a single parking space, using the following assumptions that are based on general design documents and traditional design standards:

- Each parking space is approximately 144 square feet (8 feet by 18 feet).
- There is a drive lane to gain access to the space, and the minimum amount is one-half of the drive lane directly in front of the parking space. This adds 80 square feet (8 feet by 10 feet).
- The parking is only 'funded' to 75% on-site. This reduces the vehicle hardscape from 224 square feet to 168 square feet. There are many reasons this may occur, including trade-offs with mass transit, on-street parking, garage space parking, etc. Many municipalities permit trades of this kind. The actual amount is unclear, so this adjustment is an estimate based on reasonable expectations.
- There is vehicular hardscape that is not specifically associated with the parking lot. This adds 40 square feet per space. This constitutes all of the hardscape on a site that is oriented to vehicles, but not specifically included in the parking space requirements that

the municipalities are establishing, including loading docks, access drives, pick-up and drop-off zones, etc. However, warehouse buildings have a large requirement for loading dock and access hardscape that is underrepresented in this without increasing this value to 1,800 square feet.

- There is hardscape that is not vehicle oriented that must be included. This constitutes all the rest of the hardscape on a site, and includes sidewalks required to gain access to the building. The non-vehicular hardscape adds 40 square feet to the hardscape per space.

This results in a net of 250 square feet of hardscape per parking space for the basic Parking Space unit.

Step #2: Modifications for Specific Building Types

The majority of building types in the construction forecasts can use the 250 square feet per space estimate. However, warehouses are an exception to this and need adjustment to these values.

- Parking space - 144 square feet.
- Drive lane - 80 square feet.
- The parking is only 'funded' to 75% on-site - 168 square feet.
- Other vehicular hardscape - Warehouse buildings have a large requirement for loading dock and access hardscape that is underrepresented without using a much higher hardscape value because the number of people in the buildings is low relative to the size of the building and the large vehicles on the site. Based on reasonable estimates, this addition should be 390 square feet.
- Non-vehicular hardscape - 40 square feet.

This results in a net of 600 square feet of hardscape per parking space for warehouses. This will be applied as an adjustment multiplier in step #4.

Step #3: Determine General Parking Requirements

The general hardscape square footage values are based on the requirements for parking spaces in various building development codes. These vary depending on the building density and location; how urban or suburban the region is. The parking space requirements also vary depending on the use of the building, and other variables. Figure 38 provides information from three metropolitan areas that show the range of minimum parking space accommodation requirements in the local building standards (NRC2013), (MTC2012), (LADBS2013).

Figure 38: Parking Space Requirements for Various Metropolitan Regions

Metro Region	Parking Space Minimums (One space Per...)								
	Office	Retail	Restaurant	Mixed Use	Warehouse	Hotel	Industrial	School	College
Los Angeles Area ¹	500sf	250sf	100sf	-	500sf up to 10,000sf, 5,000sf after		500sf	Classroom (elementary)	5 seats (classroom)
San Diego Area ²	250sf to 330sf	200sf to 1,000sf	70sf to 1,000sf	-	1,000sf	Each hotel room, and Per 100sf convention space	400sf to 650sf	.5 Classroom (elementary), 5 students (high school)	-
Bay Area Metro Region ³	200sf to 400sf	200sf to 500sf	-	500sf to 1,000sf	1,000sf	-	-	-	-

1. Los Angeles City Department of Building and Safety, 2013. P/ZC 2002-011.
2. San Diego Municipal Code, 2009. Chapter 4: General Regulations.
3. Survey of Bay Area Cities' Parking Requirements: Summary Report. Includes cities in Alameda, Contra Costa, Napa, San Mateo, Santa Clara, Solano, and Sonoma counties.

Using reasonable estimates from the wide range of parking space requirements, the minimums were translated into reasonable single values for individual building types that match the construction estimate forecasts. These values are shown in Figure 39.

Figure 39: Representative Code Parking Space Requirements Employed

	Representative Code-Collected Parking Minimums (One space per)								
	Office, LG & SM	Retail	Restaurant	Food (Grocery)	Warehouse, Ref & NR	Hotel	School	College	Other
Value Employed	250sf	360sf	250sf	250sf	2,000sf	360sf	360sf	250sf	360sf

These values were grouped into three basic groups; 250sf, 360sf, and 2,000sf. These will also be applied as adjustment multiplier in step #4.

Step #4: Create a Table of Adjustment Factors

The best method to apply general hardscape to each building type is to determine a single unit of adjustment and apply that unit to the construction square footage uniformly if possible.

In this case, the unit selected is a single Parking Space, which represents 250 square feet of hardscape, as was determined in Step #1.

However, since some building types require more square footage per space, and the various buildings have different densities for the spaces, a table must be developed to adjust this unit for the specifics of the individual building types.

Figure 40 below provides this table and represents the process for making the adjustments to the influence factors that are applied in the statewide impacts calculations.

Figure 40: Parking Space Area Multipliers Applied in Statewide Calculations

	Area Multipliers to Apply to Building Types (Using 250sf as Basic Unit)						
	Basic Parking Unit	Adjustment for Site Differences		Adjustment for Code Requirement Differences		Final Value	Converted Into "Basic (250sf) Parking Units"
		S. F. Per Space Required	Adjustment	Per Space Min. Required	Adjustment		
Parking Space for Office, Grocery, Restaurant, College Building Types	250sf	---	---	250sf	1	250sf	1
Parking Space for Retail, Hotel, School, Other Building Types	250sf	---	----	360sf	0.7	360sf	0.7
Parking Space for Warehouse, REF & NR	250sf	600sf	2.4	2,000sf	0.125	830sf	0.3

As a result, the energy savings in the first row of building types are applied at the rate of 250 square feet of hardscape for each 250 square feet of gross building area. The second row of building types savings are applied at the rate of 250 square feet of hardscape to 360 square feet of gross building area. Warehouse savings are applied at the rate of 250 square feet for every 830 square feet of warehouse gross area, which is equivalent to 600 square feet of hardscape in 2,000 square feet for warehouse.

APPENDIX H: COST EFFECTIVENESS

CALCULATION INFORMATION FOR OTHER LINE ITEMS

Following is a compilation of cost calculations associated with each line item of the lighting allowances.

Note that the calculation sheets have ben anonymized so specific luminaire citations is not available. In each category, the luminaires are labelled “Lum. A”, “Lum. B”, etc. and “LED A”, “LED B”, etc. The naming is repeated in every calculation sheet. The luminaires in a single measure line item (Building Entrances, for example) are labelled so that the designations indicate the same luminaire in all four sheets, but they may have had different lamps wattages or LED lumen output ratings within the product line listed, so it does not indicated that the exact same luminaire is being cited, only that the luminaire product line is the same.

Also note that the naming is repeated in every measure line item. Therefore, “Lum. A” in one measure line item is not the same product as “Lum. A” in a different one.

Figure 41: Building Entrances Calculation Results and Recommendations

Buliding Entrances NO CANOPY Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	30	60	90	90	W
	LPW	35	33	31	32	lm/W
2016	LPW	84	95	104	108	lm/W
	Change	13	21	27	26	Limit of Reduction
	Proposed	15	25	35	45	W

Figure 42: Building Entrances Lumen Equivalency Calculation Pt. 1

Building Entrance Calculations NO CANOPY T-24 2016 - Incumbent Lamps

2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
18	CFL	Lum. A	20	690	0.861	35	0.20	0.10	0.05	0.00	7	3	1.7	0
26	CFL	Lum. A	28	1,026	0.860	37	0.25	0.15	0.05	0.05	9	5	2	2
32	CFL	Lum. A	35	1,440	0.860	41	0.25	0.20	0.15	0.10	10	8	6	4
42	CFL	Lum. A	46	1,920	0.860	42	0.15	0.25	0.25	0.10	6	10	10	4
50	MH	Lum. B	67	1,347	0.464	20	0.10	0.15	0.15	0.05	2	3	3	1
70	MH	Lum. B	92	2,778	0.589	30	0.05	0.10	0.20	0.10	2	3	6	3
100	MH	Lum. B	129	3,936	0.550	31	0.00	0.05	0.10	0.30	0	2	3	9
150	MH	Lum. B	190	9,427	0.786	50	0.00	0.00	0.05	0.30	0	0	2	15
							1.00	1.00	1.00	1.00	36	35	35	38

2008 Basis of Design							Weighting				Weighted LPW				
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	
18	CFL	Lum C	20	690	0.861	35	0.20	0.10	0.05	0.00	7	3	2	0	
26	CFL	Lum C	28	1,026	0.860	37	0.25	0.15	0.05	0.05	9	5	2	2	
32	CFL	Lum C	35	1,440	0.860	41	0.25	0.20	0.15	0.10	10	8	6	4	
42	CFL	Lum C	46	1,920	0.860	42	0.15	0.25	0.25	0.10	6	10	10	4	
50	MH	Lum . D	67	732	0.464	11	0.10	0.15	0.15	0.05	1	2	2	1	
70	MH	Lum . D	92	1,509	0.589	16	0.05	0.10	0.20	0.10	1	2	3	2	
100	MH	Lum . D	129	2,138	0.550	17	0.00	0.05	0.10	0.30	0	1	2	5	
150	MH	Lum . D	190	5,029	0.786	26	0.00	0.00	0.05	0.30	0	0	1	8	
							1.00	1.00	1.00	1.00	35	32	28	25	
AVERAGE:												35	33	31.4	32

Figure 43: Building Entrances Lumen Equivalency Calculation Pt. 2

Building Entrance Calculations NO CANOPY T-24 2016 - LED

Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	Weighting				Weighted LPW			
				LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	852	21	40	0.20	0.10	0.05	0.00	8	4	2	0
LED A	852	21	40	0.25	0.15	0.05	0.05	10	6	2	2
LED B	1,172	19	61	0.25	0.20	0.15	0.10	15	12	9	6
LED B	1,441	19	75	0.15	0.25	0.25	0.10	11	19	19	8
LED C	2,969	24	122	0.10	0.15	0.15	0.05	12	18	18	6
LED C	4,455	36	124	0.05	0.10	0.20	0.10	6	12	25	12
LED C	6,364	55	117	0.00	0.05	0.10	0.30	0	6	12	35
LED C	11,874	99	120	0.00	0.00	0.05	0.30	0	0	6	36
				1.00	1.00	1.00	1.00	63	78	93	105

Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	Weighting				Weighted LPW			
				LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED D	514	6	81	0.20	0.10	0.05	0.00	16	8	4	0
LED D	895	11	78	0.25	0.15	0.05	0.05	19	12	4	4
LED E	1,709	17	100	0.25	0.20	0.15	0.10	25	20	15	10
LED F	2,406	19	126	0.15	0.25	0.25	0.10	19	31	31	13
LED E	1,709	17	100	0.10	0.15	0.15	0.05	10	15	15	5
LED F	2,406	19	126	0.05	0.10	0.20	0.10	6	13	25	13
LED E	3,405	33	102	0.00	0.05	0.10	0.30	0	5	10	31
LED G	6,231	53	118	0.00	0.00	0.05	0.30	0	0	6	35
				1.00	1.00	1.00	1.00	96	104	111	110
AVERAGE:								80	91	101.7	108
Increase x:								2.25	2.72	3.24	3.40

Figure 44: Building Entrances Cost Calculation Pt. 1

Building Entrance Calculations NO CANOPY T-24 2016 - Incumbent Lamps

Area								Weighting				Weighted \$				Weighted W			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW												
18	CFL	Lum. A	\$ 600	20	690	0.861	35	0.20	0.10	0.05	0.00	\$120	\$ 60	\$ 30	\$ -	4	2	1	0
26	CFL	Lum. A	\$ 600	28	1,026	0.860	37	0.25	0.15	0.05	0.05	\$150	\$ 90	\$ 30	\$ 30	7	4	1	1
32	CFL	Lum. A	\$ 600	35	1,440	0.860	41	0.25	0.20	0.15	0.10	\$150	\$120	\$ 90	\$ 60	9	7	5	4
42	CFL	Lum. A	\$ 600	46	1,920	0.860	42	0.15	0.25	0.25	0.10	\$ 90	\$150	\$150	\$ 60	7	12	12	5
50	MH	Lum. B	\$ 721	67	1,347	0.464	20	0.10	0.15	0.15	0.05	\$ 72	\$108	\$108	\$ 36	7	10	10	3
70	MH	Lum. B	\$ 721	92	2,778	0.589	30	0.05	0.10	0.20	0.10	\$ 36	\$ 72	\$144	\$ 72	5	9	18	9
100	MH	Lum. B	\$ 731	129	3,936	0.550	31	0.00	0.05	0.10	0.30	\$ -	\$ 37	\$ 73	\$219	0	6	13	39
150	MH	Lum. B	\$ 745	190	9,427	0.786	50	0.00	0.00	0.05	0.30	\$ -	\$ -	\$ 37	\$224	0	0	10	57
								1.00	1.00	1.00	1.00	\$618	\$637	\$663	\$701	38	50	70	118

Wall Pack								Weighting				Weighted \$				Weighted W			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW												
18	CFL	Lum C	\$ 600	20	690	0.861	35	0.20	0.10	0.05	0.00	\$120	\$ 60	\$ 30	\$ -	4	2	1	0
26	CFL	Lum C	\$ 600	28	1,026	0.860	37	0.25	0.15	0.05	0.05	\$150	\$ 90	\$ 30	\$ 30	7	4	1	1
32	CFL	Lum C	\$ 600	35	1,440	0.860	41	0.25	0.20	0.15	0.10	\$150	\$120	\$ 90	\$ 60	9	7	5	4
42	CFL	Lum C	\$ 600	46	1,920	0.860	42	0.15	0.25	0.25	0.10	\$ 90	\$150	\$150	\$ 60	7	12	12	5
50	MH	Lum . D	\$ 377	67	732	0.464	11	0.10	0.15	0.15	0.05	\$ 38	\$ 57	\$ 57	\$ 19	7	10	10	3
70	MH	Lum . D	\$ 377	92	1,509	0.589	16	0.05	0.10	0.20	0.10	\$ 19	\$ 38	\$ 75	\$ 38	5	9	18	9
100	MH	Lum . D	\$ 382	129	2,138	0.550	17	0.00	0.05	0.10	0.30	\$ -	\$ 19	\$ 38	\$115	0	6	13	39
150	MH	Lum . D	\$ 393	190	5,029	0.786	26	0.00	0.00	0.05	0.30	\$ -	\$ -	\$ 20	\$118	0	0	10	57
								1.00	1.00	1.00	1.00	\$567	\$533	\$490	\$439	38	50	70	118
								AVERAGE:				\$592	\$585	\$576	\$570	38	50	70	118
								\$/W				\$ 16	\$ 12	\$ 8	\$ 5				

Figure 45: Building Entrances Cost Calculation Pt. 2

Building Entrance Calculations NO CANOPY T-24 2016 - LED

Luminaire	Maintained Luminaire Lumens	Cost	2017 Fixture Watts	LPW	Weighting				Weighted Cost				Weighted W			
					LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	852	\$ 979	21	40	0.20	0.10	0.05	0.00	\$196	\$ 98	\$ 49	\$ -	4	2	1	0
LED A	852	\$ 979	21	40	0.25	0.15	0.05	0.05	\$245	\$147	\$ 49	\$ 49	5	3	1	1
LED B	1,172	\$ 670	19	61	0.25	0.20	0.15	0.10	\$168	\$134	\$ 101	\$ 67	5	4	3	2
LED B	1,441	\$ 701	19	75	0.15	0.25	0.25	0.10	\$105	\$175	\$ 175	\$ 70	3	5	5	2
LED C	2,969	\$ 1,428	24	122	0.10	0.15	0.15	0.05	\$143	\$214	\$ 214	\$ 71	2	4	4	1
LED C	4,455	\$ 1,428	36	124	0.05	0.10	0.20	0.10	\$ 71	\$143	\$ 286	\$ 143	2	4	7	4
LED C	6,364	\$ 1,428	55	117	0.00	0.05	0.10	0.30	\$ -	\$ 71	\$ 143	\$ 429	0	3	5	16
LED C	11,874	\$ 1,537	99	120	0.00	0.00	0.05	0.30	\$ -	\$ -	\$ 77	\$ 461	0	0	5	30
					1.00	1.00	1.00	1.00	\$928	\$983	\$1,093	\$1,290	21	24	31	56

Luminaire	Maintained Luminaire Lumens	Cost	2017 Fixture Watts	LPW	Weighting				Weighted Cost				Weighted LPW			
					LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED D	514	\$ 207	6	81	0.20	0.10	0.05	0.00	\$ 41	\$ 21	\$ 10	\$ -	16	8	4	0
LED D	895	\$ 237	11	78	0.25	0.15	0.05	0.05	\$ 59	\$ 36	\$ 12	\$ 12	19	12	4	4
LED E	1,709	\$ 444	17	100	0.25	0.20	0.15	0.10	\$111	\$ 89	\$ 67	\$ 44	25	20	15	10
LED F	2,406	\$ 775	19	126	0.15	0.25	0.25	0.10	\$116	\$194	\$ 194	\$ 77	19	31	31	13
LED E	1,709	\$ 444	17	100	0.10	0.15	0.15	0.05	\$ 44	\$ 67	\$ 67	\$ 22	10	15	15	5
LED F	2,406	\$ 775	19	126	0.05	0.10	0.20	0.10	\$ 39	\$ 77	\$ 155	\$ 77	6	13	25	13
LED E	3,405	\$ 444	33	102	0.00	0.05	0.10	0.30	\$ -	\$ 22	\$ 44	\$ 133	0	5	10	31
LED G	6,231	\$ 1,512	53	118	0.00	0.00	0.05	0.30	\$ -	\$ -	\$ 76	\$ 453	0	0	6	35
					1.00	1.00	1.00	1.00	\$411	\$505	\$ 624	\$ 820	96	104	111	110
AVERAGE:									\$669	\$744	\$ 859	\$1,055	59	64	71	83
Increase x:													1.55	1.27	1.01	0.70
\$/W									\$ 11	\$ 12	\$ 12	\$ 13				

Figure 46: Building Primary Entrances Calculation Results and Recommendations

Building Primary Entrances Recommendations

LZ1 LZ2 LZ3 LZ4

2013	Allowance	45	80	120	130	W
	LPW	25	25	25	26	lm/W
2016	LPW	72	79	86	92	lm/W
	Change	16	25	34	36	Limit of Reduction
	Proposed	20	40	60	80	W

Figure 47: Building Primary Entrances Lumen Equivalency Calculation Pt. 1

Primary Entrances Calculations T-24 2016 - Incumbent Lamps

Downlight								Weighting				Weighted LPW			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW									
32	CFL	Lum. A	36	646	0.860	18	0.50	0.35	0.10	0.05	9	6	2	1	
42	CFL	Lum. A	47	861	0.860	18	0.30	0.30	0.20	0.15	5	5	4	3	
70	PSMH	Lum. B	90	1,433	0.589	16	0.15	0.20	0.25	0.25	2	3	4	4	
100	PSMH	Lum. B	129	2,030	0.550	16	0.05	0.10	0.30	0.30	1	2	5	5	
150	PSMH	Lum. C	190	5,081	0.786	27	0.00	0.05	0.10	0.15	0	1	3	4	
175	PSMH	Lum. C	198	3,834	0.648	19	0.00	0.00	0.05	0.10	0	0	1	2	
								1.00	1.00	1.00	1.00	18	18	18	18
Wall Pack								Weighting				Weighted LPW			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW									
26	CFL	Lum. D	27	710	0.860	26	0.40	0.20	0.10	0.00	11	5	3	0	
32	CFL	Lum. D	36	947	0.860	26	0.25	0.25	0.15	0.05	7	7	4	1	
42	CFL	Lum. D	47	1,262	0.860	27	0.20	0.20	0.15	0.10	5	5	4	3	
70	PSMH	Lum. D	90	1,509	0.589	17	0.10	0.15	0.20	0.10	2	3	3	2	
100	PSMH	Lum. D	129	2,138	0.550	17	0.05	0.10	0.20	0.15	1	2	3	2	
150	PSMH	Lum. D	190	5,029	0.786	26	0.00	0.05	0.05	0.25	0	1	1	7	
175	PSMH	Lum. E	198	4,944	0.648	25	0.00	0.05	0.10	0.25	0	1	2	6	
250	PSMH	Lum. E	291	6,552	0.611	23	0.00	0.00	0.05	0.10	0	0	1	2	
								1.00	1.00	1.00	1.00	25	24	22	23
Area								Weighting				Weighted LPW			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW									
18	CFL	Lum. F	19	690	0.861	36	0.05	0.05	0.00	0.00	2	2	0	0	
26	CFL	Lum. F	27	1,026	0.860	38	0.10	0.05	0.00	0.00	4	2	0	0	
32	CFL	Lum. F	36	1,440	0.860	40	0.20	0.10	0.10	0.00	8	4	4	0	
42	CFL	Lum. F	47	1,920	0.860	41	0.20	0.15	0.10	0.10	8	6	4	4	
50	MH	Lum. G	67	1,347	0.464	20	0.20	0.20	0.15	0.10	4	4	3	2	
70	MH	Lum. G	92	2,778	0.589	30	0.15	0.25	0.25	0.20	5	8	8	6	
100	MH	Lum. G	129	3,936	0.550	31	0.10	0.15	0.25	0.30	3	5	8	9	
150	MH	Lum. G	190	9,427	0.786	50	0.00	0.05	0.15	0.30	0	2	7	15	
								1.00	1.00	1.00	1.00	33	32	34	36
								AVERAGE:				25	25	25	26

Figure 48: Building Primary Entrances Lumen Equivalency Calculation Pt. 2

Primary Entrances Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	549	0.700	18	31	0.50	0.35	0.10	0.05	16	11	3	2
LED B	823	0.700	20	42	0.30	0.30	0.20	0.15	13	13	8	6
LED C	1,710	0.700	26	66	0.15	0.20	0.25	0.25	10	13	17	17
LED D	2,207	0.700	35	63	0.05	0.10	0.30	0.30	3	6	19	19
LED E	4,610	0.700	62	74	0.00	0.05	0.10	0.15	0	4	7	11
LED F	4,174	0.700	49	85	0.00	0.00	0.05	0.10	0	0	4	9
					1.00	1.00	1.00	1.00	41	47	59	63

2016 LED Equivalency					Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED G	514	0.700	6	81	0.40	0.20	0.10	0.00	33	16	8	0
LED G	895	0.700	11	78	0.25	0.25	0.15	0.05	19	19	12	4
LED H	1,373	0.958	13	108	0.20	0.20	0.15	0.10	22	22	16	11
LED H	2,341	0.903	27	87	0.10	0.15	0.20	0.10	9	13	17	9
LED J	2,733	0.700	35	77	0.05	0.10	0.20	0.15	4	8	15	12
LED K	5,312	0.887	50	106	0.00	0.05	0.05	0.25	0	5	5	26
LED K	6,645	0.887	61	108	0.00	0.05	0.10	0.25	0	5	11	27
LED L	10,251	0.887	101	102	0.00	0.00	0.05	0.10	0	0	5	10
					1.00	1.00	1.00	1.00	86	89	90	99

2016 LED Equivalency					Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED M	852	0.768	21	40	0.05	0.05	0.00	0.00	2	2	0	0
LED M	852	0.768	21	40	0.10	0.05	0.00	0.00	4	2	0	0
LED N	1,172	0.700	19	61	0.20	0.10	0.10	0.00	12	6	6	0
LED N	1,441	0.700	19	75	0.20	0.15	0.10	0.10	15	11	8	8
LED P	2,969	0.946	24	122	0.20	0.20	0.15	0.10	24	24	18	12
LED P	4,455	0.946	36	124	0.15	0.25	0.25	0.20	19	31	31	25
LED P	6,364	0.946	55	117	0.10	0.15	0.25	0.30	12	17	29	35
LED P	11,874	0.946	99	120	0.00	0.05	0.15	0.30	0	6	18	36
					1.00	1.00	1.00	1.00	88	100	110	116
AVERAGE:									72	79	86	92

Figure 49: Building Primary Entrances Cost Calculation Pt. 1

Primary Entrances Calculations T-24 2016 - Incumbent Lamps

Downlight							
2008 Basis of Design							
Wattage	Lamp Type	Luminaire	Initial Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW
32	CFL	Lum. A	\$ 334	36	646	0.860	18
42	CFL	Lum. A	\$ 334	47	861	0.860	18
70	PSMH	Lum. B	\$ 300	90	1,433	0.589	16
100	PSMH	Lum. B	\$ 215	129	2,030	0.550	16
150	PSMH	Lum. C	\$ 603	190	5,081	0.786	27
175	PSMH	Lum. C	\$ 489	198	3,834	0.648	19

Weighting			
LZ1	LZ2	LZ3	LZ4
0.50	0.35	0.10	0.05
0.30	0.30	0.20	0.15
0.15	0.20	0.25	0.25
0.05	0.10	0.30	0.30
0.00	0.05	0.10	0.15
0.00	0.00	0.05	0.10

Weighted Cost			
LZ1	LZ2	LZ3	LZ4
\$167	\$117	\$ 33	\$ 17
\$100	\$100	\$ 67	\$ 50
\$ 45	\$ 60	\$ 75	\$ 75
\$ 11	\$ 21	\$ 64	\$ 64
\$ -	\$ 30	\$ 60	\$ 90
\$ -	\$ -	\$ 24	\$ 49

Weighted W			
LZ1	LZ2	LZ3	LZ4
18	13	4	2
14	14	9	7
14	18	23	23
6	13	39	39
0	10	19	29
0	0	10	20

1.00	1.00	1.00	1.00
------	------	------	------

\$323	\$328	\$324	\$345
-------	-------	-------	-------

52	67	103	118
----	----	-----	-----

Wall Pack							
2008 Basis of Design							
Wattage	Lamp Type	Luminaire	Initial Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW
26	CFL	Lum. D	\$ 365	27	710	0.860	26
32	CFL	Lum. D	\$ 368	36	947	0.860	26
42	CFL	Lum. D	\$ 368	47	1,262	0.860	27
70	PSMH	Lum. D	\$ 377	90	1,509	0.589	17
100	PSMH	Lum. D	\$ 382	129	2,138	0.550	17
150	PSMH	Lum. D	\$ 393	190	5,029	0.786	26
175	PSMH	Lum. E	\$ 974	198	4,944	0.648	25
250	PSMH	Lum. E	\$ 1,229	291	6,552	0.611	23

Weighting			
LZ1	LZ2	LZ3	LZ4
0.40	0.20	0.10	0.00
0.25	0.25	0.15	0.05
0.20	0.20	0.15	0.10
0.10	0.15	0.20	0.10
0.05	0.10	0.20	0.15
0.00	0.05	0.05	0.25
0.00	0.05	0.10	0.25
0.00	0.00	0.05	0.10

Weighted Cost			
LZ1	LZ2	LZ3	LZ4
\$146	\$ 73	\$ 36	\$ -
\$ 92	\$ 92	\$ 55	\$ 18
\$ 74	\$ 74	\$ 55	\$ 37
\$ 38	\$ 57	\$ 75	\$ 38
\$ 19	\$ 38	\$ 76	\$ 57
\$ -	\$ 20	\$ 20	\$ 98
\$ -	\$ 49	\$ 97	\$244
\$ -	\$ -	\$ 61	\$123

Weighted W			
LZ1	LZ2	LZ3	LZ4
11	5	3	0
9	9	5	2
9	9	7	5
9	14	18	9
6	13	26	19
0	10	10	48
0	10	20	50
0	0	15	29

1.00	1.00	1.00	1.00
------	------	------	------

\$369	\$402	\$477	\$615
-------	-------	-------	-------

45	70	103	161
----	----	-----	-----

Area							
2008 Basis of Design							
Wattage	Lamp Type	Luminaire	Initial Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW
18	CFL	Lum. F	\$ 600	19	690	0.861	36
26	CFL	Lum. F	\$ 600	27	1,026	0.860	38
32	CFL	Lum. F	\$ 600	36	1,440	0.860	40
42	CFL	Lum. F	\$ 600	47	1,920	0.860	41
50	MH	Lum. G	\$ 767	67	1,347	0.464	20
70	MH	Lum. G	\$ 767	92	2,778	0.589	30
100	MH	Lum. G	\$ 778	129	3,936	0.550	31
150	MH	Lum. G	\$ 793	190	9,427	0.786	50

Weighting			
LZ1	LZ2	LZ3	LZ4
0.05	0.05	0.00	0.00
0.10	0.05	0.00	0.00
0.20	0.10	0.10	0.00
0.20	0.15	0.10	0.10
0.20	0.20	0.15	0.10
0.15	0.25	0.25	0.20
0.10	0.15	0.25	0.30
0.00	0.05	0.15	0.30

Weighted Cost			
LZ1	LZ2	LZ3	LZ4
\$ 30	\$ 30	\$ -	\$ -
\$ 60	\$ 30	\$ -	\$ -
\$120	\$ 60	\$ 60	\$ -
\$120	\$ 90	\$ 60	\$ 60
\$153	\$153	\$115	\$ 77
\$115	\$192	\$192	\$153
\$ 78	\$117	\$195	\$234
\$ -	\$ 40	\$119	\$238

Weighted W			
LZ1	LZ2	LZ3	LZ4
1	1	0	0
3	1	0	0
7	4	4	0
9	7	5	5
13	13	10	7
14	23	23	18
13	19	32	39
0	10	29	57

1.00	1.00	1.00	1.00
------	------	------	------

\$676	\$712	\$741	\$762
-------	-------	-------	-------

60	78	102	126
----	----	-----	-----

AVERAGE:	\$456	\$481	\$514	\$574
----------	-------	-------	-------	-------

\$/W	\$ 9	\$ 7	\$ 5	\$ 4
------	------	------	------	------

Figure 50: Building Primary Entrances Cost Calculation Pt. 2

Primary Entrances Calculations T-24 2016 - LED

2016 LED Equivalency						LPW		Weighting				Weighted Cost				Weighted W					
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4		
LED A	784	549	\$ 245	18	31	13	73%	0.50	0.35	0.10	0.05	\$ 122	\$ 86	\$ 24	\$ 12	9	6	2	1		
LED B	1,175	823	\$ 252	20	42	24	130%	0.30	0.30	0.20	0.15	\$ 76	\$ 76	\$ 50	\$ 38	6	6	4	3		
LED C	2,443	1,710	\$ 318	26	66	50	315%	0.15	0.20	0.25	0.25	\$ 48	\$ 64	\$ 80	\$ 80	4	5	6	6		
LED D	3,153	2,207	\$ 318	35	63	47	301%	0.05	0.10	0.30	0.30	\$ 16	\$ 32	\$ 95	\$ 95	2	3	10	10		
LED E	6,586	4,610	\$ 1,274	62	74	48	178%	0.00	0.05	0.10	0.15	\$ -	\$ 64	\$ 127	\$ 191	0	3	6	9		
LED F	5,963	4,174	\$ 494	49	85	66	339%	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 25	\$ 49	0	0	2	5		
						1.00	1.00	1.00	1.00					\$ 262	\$ 320	\$ 402	\$ 466	20	24	31	35

2016 LED Equivalency						LPW		Weighting				Weighted Cost				Weighted W					
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4		
LED G	734	514	\$ 207	6	81	55	209%	0.40	0.20	0.10	0.00	\$ 83	\$ 41	\$ 21	\$ -	3	1	1	0		
LED G	1,278	895	\$ 237	11	78	52	196%	0.25	0.25	0.15	0.05	\$ 59	\$ 59	\$ 36	\$ 12	3	3	2	1		
LED H	1,433	1,373	\$ 428	13	108	81	300%	0.20	0.20	0.15	0.10	\$ 86	\$ 86	\$ 64	\$ 43	3	3	2	1		
LED H	2,593	2,341	\$ 428	27	87	70	418%	0.10	0.15	0.20	0.10	\$ 43	\$ 64	\$ 86	\$ 43	3	4	5	3		
LED J	3,904	2,733	\$ 377	35	77	61	367%	0.05	0.10	0.20	0.15	\$ 19	\$ 38	\$ 75	\$ 57	2	4	7	5		
LED K	5,989	5,312	\$ 1,476	50	106	79	300%	0.00	0.05	0.05	0.25	\$ -	\$ 74	\$ 74	\$ 369	0	3	3	13		
LED K	7,491	6,645	\$ 1,583	61	108	83	333%	0.00	0.05	0.10	0.25	\$ -	\$ 79	\$ 158	\$ 396	0	3	6	15		
LED L	11,557	10,251	\$ 1,519	101	102	79	352%	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 76	\$ 152	0	0	5	10		
						1.00	1.00	1.00	1.00					\$ 289	\$ 441	\$ 590	\$ 1,071	12	20	30	48

2016 LED Equivalency						LPW		Weighting				Weighted Cost				Weighted W					
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4		
LED M	1,110	852	\$ 979	21	40	4	10%	0.05	0.05	0.00	0.00	\$ 49	\$ 49	\$ -	\$ -	1	1	0	0		
LED M	1,110	852	\$ 979	21	40	2	5%	0.10	0.05	0.00	0.00	\$ 98	\$ 49	\$ -	\$ -	2	1	0	0		
LED N	1,674	1,172	\$ 670	19	61	21	53%	0.20	0.10	0.10	0.00	\$ 134	\$ 67	\$ 67	\$ -	4	2	2	0		
LED N	2,059	1,441	\$ 701	19	75	34	84%	0.20	0.15	0.10	0.10	\$ 140	\$ 105	\$ 70	\$ 70	4	3	2	2		
LED P	3,139	2,969	\$ 1,428	24	122	102	507%	0.20	0.20	0.15	0.10	\$ 286	\$ 286	\$ 214	\$ 143	5	5	4	2		
LED P	4,709	4,455	\$ 1,428	36	124	93	309%	0.15	0.25	0.25	0.20	\$ 214	\$ 357	\$ 357	\$ 286	5	9	9	7		
LED P	6,727	6,364	\$ 1,428	55	117	86	282%	0.10	0.15	0.25	0.30	\$ 143	\$ 214	\$ 357	\$ 429	5	8	14	16		
LED P	12,552	11,874	\$ 1,537	99	120	71	143%	0.00	0.05	0.15	0.30	\$ -	\$ 77	\$ 231	\$ 461	0	5	15	30		
						1.00	1.00	1.00	1.00					\$ 1,064	\$ 1,204	\$ 1,296	\$ 1,388	27	34	45	58
AVERAGE:														\$ 538	\$ 655	\$ 763	\$ 975	20	26	36	47
\$/W														\$ 27	\$ 25	\$ 21	\$ 21				

Figure 51: Drive-Up Windows Calculation Results and Recommendations

Drive-Up Windows Recommendations

LZ1 LZ2 LZ3 LZ4

2013	Allowance	40	75	125	200	W
	LPW	29	30	32	33	lm/W
2016	LPW	88	87	89	93	lm/W
	Change	13	26	45	72	Limit of Reduction
	Proposed	30	40	60	100	W

Figure 52: Drive-Up Windows Lumen Equivalency Calculation Pt. 1

Drive-up Windows Calculations T-24 2016 - Incumbent Lamps

Round Ceiling Mounted Downlight

2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
50	PSMH	Lum. A	67	1,022	0.464	15	0.10	0.05	0.00	0.00	2	1	0	0
70	PSMH	Lum. A	92	2,108	0.589	23	0.20	0.15	0.05	0.10	5	3	1	2
100	PSMH	Lum. A	129	2,986	0.550	23	0.30	0.25	0.20	0.30	7	6	5	7
150	PSMH	Lum. A	190	7,026	0.786	37	0.40	0.55	0.75	0.60	15	20	28	22
							1.00	1.00	1.00	1.00	28	30	34	31

Ceiling Mounted Box, Full Cut-Off

2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
70	PSMH	Lum. B	92	2,114	0.589	23	0.10	0.05	0.00	0.00	2	1	0	0
100	PSMH	Lum. C	129	3,445	0.550	27	0.20	0.15	0.05	0.10	5	4	1	3
150	PSMH	Lum. C	190	7,713	0.786	41	0.30	0.25	0.20	0.30	12	10	8	12
175	PSMH	Lum. C	198	6,335	0.648	32	0.40	0.55	0.75	0.60	13	18	24	19
							1.00	1.00	1.00	1.00	33	33	33	34

10" Recessed Downlights, Fresnel Lens

2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
(3) 32	CFL	Lum. D	68	1,748	0.860	26	0.05	0.05	0.00	0.00	1	1	0	0
(2) 42	CFL	Lum. D	93	2,276	0.860	24	0.05	0.05	0.05	0.05	1	1	1	1
(2) 57	CFL	Lum. D	128	3,408	0.860	27	0.00	0.05	0.10	0.10	0	1	3	3
50	PSMH	Lum. E	67	868	0.464	13	0.10	0.05	0.00	0.00	1	1	0	0
70	PSMH	Lum. E	92	1,790	0.589	19	0.20	0.10	0.05	0.05	4	2	1	1
100	PSMH	Lum. E	129	2,537	0.550	20	0.30	0.20	0.10	0.40	6	4	2	8
150	PSMH	Lum. E	190	5,968	0.786	31	0.30	0.50	0.70	0.40	9	16	22	13
							1.00	1.00	1.00	1.00	23	26	29	25
							AVERAGE:				28	30	32	30

Figure 53: Drive-Up Windows Lumen Equivalency Calculation Pt. 2

Drive-up Windows Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	1,736	0.900	19	91	0.10	0.05	0.00	0.00	9	5	0	0
LED A	3,444	0.900	38	90	0.20	0.15	0.05	0.10	18	13	4	9
LED B	4,876	0.887	49	100	0.30	0.25	0.20	0.30	30	25	20	30
LED C	8,302	0.900	67	123	0.40	0.55	0.75	0.60	49	68	92	74
					1.00	1.00	1.00	1.00	106	111	117	113

2016 LED Equivalency					Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED E	3,233	0.781	37	88	0.10	0.05	0.00	0.00	9	4	0	0
LED E	5,301	0.781	61	87	0.20	0.15	0.05	0.10	17	13	4	9
LED E	7,439	0.781	91	81	0.30	0.25	0.20	0.30	24	20	16	24
LED E	7,439	0.781	91	81	0.40	0.55	0.75	0.60	33	45	61	49
					1.00	1.00	1.00	1.00	83	83	82	82

2016 LED Equivalency					Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	1,443	0.700	23	62	0.05	0.05	0.00	0.00	3	3	0	0
LED F	1,710	0.700	26	66	0.05	0.05	0.05	0.05	3	3	3	3
LED G	2,902	0.700	40	73	0.00	0.05	0.10	0.10	0	4	7	7
LED F2	1,320	0.700	20	66	0.10	0.05	0.00	0.00	7	3	0	0
LED F	2,207	0.700	35	63	0.20	0.10	0.05	0.05	13	6	3	3
LED G	2,902	0.700	40	73	0.30	0.20	0.10	0.40	22	15	7	29
LED H	6,045	0.700	90	67	0.30	0.50	0.70	0.40	20	33	47	27
					1.00	1.00	1.00	1.00	68	68	68	70
					AVERAGE:				86	87	89	88

Figure 54: Drive-Up Windows Cost Calculation Pt. 1

Drive-up Windows Cost Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design								Weighting				Weighted Lumens				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	Initial Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
50	PSMH	Lum. A	\$ 483	67	1,022	0.464	15	0.10	0.05	0.00	0.00	102	51	0	0	\$ 48	\$ 24	\$ -	\$ -	102	3	0	0
70	PSMH	Lum. A	\$ 483	92	2,108	0.589	23	0.20	0.15	0.05	0.10	422	316	105	211	\$ 97	\$ 72	\$ 24	\$ 48	18	14	5	9
100	PSMH	Lum. A	\$ 506	129	2,986	0.550	23	0.30	0.25	0.20	0.30	896	746	597	896	\$ 152	\$ 127	\$ 101	\$ 152	39	32	26	39
150	PSMH	Lum. A	\$ 528	190	7,026	0.786	37	0.40	0.55	0.75	0.60	2810	3864	5269	4216	\$ 211	\$ 290	\$ 396	\$ 317	76	105	143	114
								1.00	1.00	1.00	1.00	4230	4978	5972	5322	\$ 508	\$ 514	\$ 521	\$ 517	235	154	173	162

2008 Basis of Design								Weighting				Weighted Lumens				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	Initial Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
70	PSMH	Lum. B	\$ 293	92	2,114	0.589	23	0.10	0.05	0.00	0.00	211	106	0	0	\$ 29	\$ 15	\$ -	\$ -	9	5	0	0
100	PSMH	Lum. C	\$ 592	129	3,445	0.550	27	0.20	0.15	0.05	0.10	689	517	172	344	\$ 118	\$ 89	\$ 30	\$ 59	26	19	6	13
150	PSMH	Lum. C	\$ 591	190	7,713	0.786	41	0.30	0.25	0.20	0.30	2314	1928	1543	2314	\$ 177	\$ 148	\$ 118	\$ 177	57	48	38	57
175	PSMH	Lum. C	\$ 591	198	6,335	0.648	32	0.40	0.55	0.75	0.60	2534	3484	4751	3801	\$ 236	\$ 325	\$ 443	\$ 355	79	109	149	119
								1.00	1.00	1.00	1.00	5748	6035	6466	6459	\$ 562	\$ 576	\$ 591	\$ 591	171	180	193	189

2008 Basis of Design								Weighting				Weighted Lumens				Weighted Cost				Weighted W				
Wattage	Lamp Type	Luminaire	Initial Cost	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	
(3) 32	CFL	Lum. D	\$ 246	68	1,748	0.860	26	0.05	0.05	0.00	0.00	87	87	0	0	\$ 12	\$ 12	\$ -	\$ -	3	3	0	0	
(2) 42	CFL	Lum. D	\$ 321	93	2,276	0.860	24	0.05	0.05	0.05	0.05	114	114	114	114	\$ 16	\$ 16	\$ 16	\$ 16	5	5	5	5	
(2) 57	CFL	Lum. D	\$ 321	128	3,408	0.860	27	0.00	0.05	0.10	0.10	0	170	341	341	\$ -	\$ 16	\$ 32	\$ 32	0	6	13	13	
50	PSMH	Lum. E	\$ 470	67	868	0.464	13	0.10	0.05	0.00	0.00	87	43	0	0	\$ 47	\$ 23	\$ -	\$ -	7	3	0	0	
70	PSMH	Lum. E	\$ 469	92	1,790	0.589	19	0.20	0.10	0.05	0.05	358	179	90	90	\$ 94	\$ 47	\$ 23	\$ 23	18	9	5	5	
100	PSMH	Lum. E	\$ 470	129	2,537	0.550	20	0.30	0.20	0.10	0.40	761	507	254	1015	\$ 141	\$ 94	\$ 47	\$ 188	39	26	13	52	
150	PSMH	Lum. E	\$ 470	190	5,968	0.786	31	0.30	0.50	0.70	0.40	1790	2984	4178	2387	\$ 141	\$ 235	\$ 329	\$ 188	57	95	133	76	
								1.00	1.00	1.00	1.00	3197	4085	4976	3946	\$ 451	\$ 443	\$ 447	\$ 447	129	148	168	150	
AVERAGE:												4392	5033	5804	5242	\$ 507	\$ 511	\$ 520	\$ 518	178	161	178	167	
\$/W																	\$ 3	\$ 3	\$ 3	\$ 3				
\$/lumen																	\$ 0.12	\$ 0.10	\$ 0.09	\$ 0.10				

Figure 55: Drive-Up Windows Cost Calculation Pt. 2

Drive-up Windows Cost Calculations T-24 2016 - LED

2016 LED Equivalency						Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Initial Cost	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	1,736	\$ 455	0.900	19	91	0.10	0.05	0.00	0.00	\$ 46	\$ 23	\$ -	\$ -	2	1	0	0
LED A	3,444	\$ 586	0.900	38	90	0.20	0.15	0.05	0.10	\$117	\$ 88	\$ 29	\$ 59	8	6	2	4
LED B	4,876	\$ 1,087	0.887	49	100	0.30	0.25	0.20	0.30	\$326	\$272	\$ 217	\$ 326	15	12	10	15
LED C	8,302	\$ 1,054	0.900	67	123	0.40	0.55	0.75	0.60	\$422	\$580	\$ 791	\$ 632	27	37	51	40
						1.00	1.00	1.00	1.00	\$910	\$962	\$ 1,037	\$ 1,017	51	56	62	59

2016 LED Equivalency						Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Initial Cost	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED E	3,233	\$ 1,087	0.781	37	88	0.10	0.05	0.00	0.00	\$109	\$ 54	\$ -	\$ -	4	2	0	0
LED E	5,301	\$ 1,087	0.781	61	87	0.20	0.15	0.05	0.10	\$217	\$163	\$ 54	\$ 109	12	9	3	6
LED E	7,439	\$ 761	0.781	91	81	0.30	0.25	0.20	0.30	\$228	\$190	\$ 152	\$ 228	27	23	18	27
LED E	7,439	\$ 761	0.781	91	81	0.40	0.55	0.75	0.60	\$304	\$418	\$ 571	\$ 456	37	50	69	55
						1.00	1.00	1.00	1.00	\$859	\$826	\$ 777	\$ 793	80	84	90	88

2016 LED Equivalency						Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Initial Cost	LLD	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	1,443	\$ 288	0.700	23	62	0.05	0.05	0.00	0.00	\$ 14	\$ 14	\$ -	\$ -	1	1	0	0
LED F	1,710	\$ 318	0.700	26	66	0.05	0.05	0.05	0.05	\$ 16	\$ 16	\$ 16	\$ 16	1	1	1	1
LED G	2,902	\$ 798	0.700	40	73	0.00	0.05	0.10	0.10	\$ -	\$ 40	\$ 80	\$ 80	0	2	4	4
LED F2	1,320	\$ 288	0.700	20	66	0.10	0.05	0.00	0.00	\$ 29	\$ 14	\$ -	\$ -	2	1	0	0
LED F	2,207	\$ 318	0.700	35	63	0.20	0.10	0.05	0.05	\$ 64	\$ 32	\$ 16	\$ 16	7	3	2	2
LED G	2,902	\$ 798	0.700	40	73	0.30	0.20	0.10	0.40	\$239	\$160	\$ 80	\$ 319	12	8	4	16
LED H	6,045	\$ 1,274	0.700	90	67	0.30	0.50	0.70	0.40	\$382	\$637	\$ 892	\$ 510	27	45	63	36
						1.00	1.00	1.00	1.00	\$744	\$913	\$ 1,083	\$ 940	50	62	74	59
AVERAGE:										\$838	\$900	\$ 966	\$ 917	61	67	75	69
										\$ 14	\$ 13	\$ 13	\$ 13				

Figure 56: Vehicle Service Station Uncovered Fuel Dispenser Calculation Results and Recommendations

Uncovered Fuel Dispensers Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	120	175	185	330	W
	LPW	27	27	26	26	lm/W
2016	LPW	85	89	93	97	lm/W
	Change	38	52	52	90	Limit of Reduction
	Proposed	80	100	140	160	W

Figure 57: Vehicle Service Station Uncovered Fuel Dispenser Lumen Equivalency Calculation Pt. 1

Uncovered Fuel Dispensers Calculations T-24 2016 - Incumbent Lamps

Area							2008 Basis of Design				Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4				
100	PSMH	Lum. A	129	2,809	0.550	22	0.20	0.10	0.05	0.00	4	2	1	0				
150	PSMH	Lum. A	190	6,558	0.786	35	0.30	0.20	0.10	0.05	10	7	3	2				
175	PSMH	Lum. A	198	5,053	0.648	26	0.30	0.30	0.30	0.25	8	8	8	6				
250	PSMH	Lum. A	291	6,697	0.611	23	0.20	0.30	0.35	0.40	5	7	8	9				
400	PSMH	Lum. A	452	13,641	0.723	30	0.00	0.10	0.20	0.30	0	3	6	9				
							1.00	1.00	1.00	1.00	27	27	26	26				
							AVERAGE:				27	27	26	26				

Figure 58: Vehicle Service Station Uncovered Fuel Dispenser Lumen Equivalency Calculation Pt. 2

Uncovered Fuel Dispensers Calculations T-24 2016 - LED

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	3,331	37	89	0.20	0.10	0.05	0.00	18	9	4	0
LED A	5,965	76	79	0.30	0.20	0.10	0.05	24	16	8	4
LED A	5,391	60	90	0.30	0.30	0.30	0.25	27	27	27	23
LED A	7,662	90	85	0.20	0.30	0.35	0.40	17	25	30	34
LED B	16,942	139	122	0.00	0.10	0.20	0.30	0	12	24	37
				1.00	1.00	1.00	1.00	85	89	93	97
				AVERAGE:				85	89	93	97

Figure 59: Vehicle Service Station Uncovered Fuel Dispenser Cost Calculation Pt. 1

Uncovered Fuel Dispensers Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design							Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Initial Cost	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
100	PSMH	Lum. A	129	\$1,035	2,809	22	0.20	0.10	0.05	0.00	\$ 207	\$ 104	\$ 52	\$ -	26	13	6	0
150	PSMH	Lum. A	190	\$1,035	6,558	35	0.30	0.20	0.10	0.05	\$ 311	\$ 207	\$ 104	\$ 52	57	38	19	10
175	PSMH	Lum. A	198	\$1,035	5,053	26	0.30	0.30	0.30	0.25	\$ 311	\$ 311	\$ 311	\$ 259	59	59	59	50
250	PSMH	Lum. A	291	\$1,235	6,697	23	0.20	0.30	0.35	0.40	\$ 247	\$ 370	\$ 432	\$ 494	58	87	102	116
400	PSMH	Lum. A	452	\$1,235	13,641	30	0.00	0.10	0.20	0.30	\$ -	\$ 123	\$ 247	\$ 370	0	45	90	136
							1.00	1.00	1.00	1.00	\$1,075	\$1,115	\$1,145	\$1,175	200	243	277	311
AVERAGE:											\$1,075	\$1,115	\$1,145	\$1,175	200	243	277	311
\$/W											\$ 5	\$ 5	\$ 4	\$ 4				

Figure 60: Vehicle Service Station Uncovered Fuel Dispenser Cost Calculation Pt. 2

Uncovered Fuel Dispensers Calculations T-24 2016 -LED

2016 LED Equivalency					Weighting				Weighted Cost				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	3,331	\$ 1,204	37	89	0.20	0.10	0.05	0.00	\$ 241	\$ 120	\$ 60	\$ -	7	4	2	0
LED A	5,965	\$ 1,720	76	79	0.30	0.20	0.10	0.05	\$ 516	\$ 344	\$ 172	\$ 86	23	15	8	4
LED A	5,391	\$ 1,810	60	90	0.30	0.30	0.30	0.25	\$ 543	\$ 543	\$ 543	\$ 453	18	18	18	15
LED A	7,662	\$ 1,810	90	85	0.20	0.30	0.35	0.40	\$ 362	\$ 543	\$ 634	\$ 724	18	27	32	36
LED B	16,942	\$ 808	139	122	0.00	0.10	0.20	0.30	\$ -	\$ 81	\$ 162	\$ 242	0	14	28	42
					1.00	1.00	1.00	1.00	\$ 1,662	\$1,631	\$1,570	\$1,505	66	78	87	97
AVERAGE:									\$ 1,662	\$1,631	\$1,570	\$1,505	66	78	87	97
\$/W									\$ 25	\$ 21	\$ 18	\$ 16				

Figure 61: ATM Calculation Results and Recommendations

ATM Recommendations

		LZ1	LZ2	LZ3	LZ4	
2016	Watts for First ATM	185	185	186	185	Limit of Reduction
	Watts for Add'l ATMs	60	60	60	60	
	Watts for First ATM	250	250	250	250	Proposed
	Watts for Add'l ATMs	70	70	70	70	

Lumen equivalency calculations were not performed for the ATM allowance. Instead, a lighting system was calculated to meet the illuminance calculations and was used as the proposal.

Figure 62: Outdoor Sales Frontage Calculation Results and Recommendations

Outdoor Sales Frontage Recommendations

		LZ1	LZ2	LZ3	LZ4	
2008	Allowance		22.5	36.0	45.0	W/lf
	LPW	33	34	38	44	lm/W
2016	LPW	95	102	110	108	lm/W
	Change		7	12	18	Limit of Reduction
	Proposed		15	25	30	W/lf

Figure 63: Outdoor Sales Frontage Lumen Equivalency Calculation Pt. 1

Sales Frontage Calculations T-24 2016 - Incumbent Lamps

Area							Weighting				Weighted LPW			
2008 Basis of Design							LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW								
100	PSMH	Lum. A	129	2,809	0.550	22	0.10	0.05	0.00	0.00	2	1	0	0
150	PSMH	Lum. A	190	6,558	0.786	35	0.20	0.10	0.00	0.00	7	3	0	0
175	PSMH	Lum. A	198	5,053	0.648	26	0.25	0.20	0.10	0.00	6	5	3	0
250	PSMH	Lum. A	291	6,697	0.611	23	0.20	0.25	0.20	0.10	5	6	5	2
320	PSMH	Lum. A	368	11,997	0.704	33	0.15	0.20	0.20	0.15	5	7	7	5
400	PSMH	Lum. A	452	13,641	0.723	30	0.10	0.15	0.25	0.20	3	5	8	6
750	PSMH	Lum. A	818	37,028	0.824	45	0.00	0.05	0.15	0.25	0	2	7	11
1000	PSMH	Lum. A	1080	57,062	0.801	53	0.00	0.00	0.10	0.30	0	0	5	16
							1.00	1.00	1.00	1.00	28	29	33	40

Flood							Weighting				Weighted LPW			
2008 Basis of Design							LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW								
100	PSMH	Lum. B	129	3,488	0.550	27	0.10	0.05	0.00	0.00	3	1	0	0
150	PSMH	Lum. B	190	8,207	0.786	43	0.20	0.10	0.00	0.00	9	4	0	0
175	PSMH	Lum. B	198	6,192	0.648	31	0.25	0.20	0.10	0.00	8	6	3	0
250	PSMH	Lum. B	291	9,645	0.611	33	0.20	0.25	0.20	0.10	7	8	7	3
320	PSMH	Lum. B	368	17,273	0.704	47	0.15	0.20	0.20	0.15	7	9	9	7
400	PSMH	Lum. B	452	19,640	0.723	43	0.10	0.15	0.25	0.20	4	7	11	9
750	PSMH	Lum. B	818	37,800	0.824	46	0.00	0.05	0.15	0.25	0	2	7	12
1000	PSMH	Lum. B	1080	58,253	0.801	54	0.00	0.00	0.10	0.30	0	0	5	16
							1.00	1.00	1.00	1.00	37	38	42	47
AVERAGE:											33	34	38	44

Figure 64: Outdoor Sales Frontage Lumen Equivalency Calculation Pt. 2

Sales Frontage Calculations T-24 2016 - LED

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	3,331	37	89	0.10	0.05	0.00	0.00	9	4	0	0
LED A	5,965	76	79	0.20	0.10	0.00	0.00	16	8	0	0
LED A	5,391	60	90	0.25	0.20	0.10	0.00	23	18	9	0
LED A	7,662	90	85	0.20	0.25	0.20	0.10	17	21	17	8
LED B	15,789	130	122	0.15	0.20	0.20	0.15	18	24	24	18
LED B	16,942	139	122	0.10	0.15	0.25	0.20	12	18	30	24
LED C	39,885	378	106	0.00	0.05	0.15	0.25	0	5	16	26
LED C	48,959	589	83	0.00	0.00	0.10	0.30	0	0	8	25
				1.00	1.00	1.00	1.00	95	99	105	102

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED E	6,988	58	120	0.10	0.05	0.00	0.00	12	6	0	0
LED F	8,719	112	78	0.20	0.10	0.00	0.00	16	8	0	0
LED E	9,151	78	117	0.25	0.20	0.10	0.00	29	23	12	0
LED E	12,699	121	105	0.20	0.25	0.20	0.10	21	26	21	11
LED F	20,183	179	113	0.15	0.20	0.20	0.15	17	23	23	17
LED G	23,812	189	126	0.10	0.15	0.25	0.20	13	19	31	25
LED G	47,655	378	126	0.00	0.05	0.15	0.25	0	6	19	32
LED G	58,496	589	99	0.00	0.00	0.10	0.30	0	0	10	30
				1.00	1.00	1.00	1.00	107	111	116	114
AVERAGE:								101	105	110	108

Hardscape Ornamental Calculations Results

The Hardscape Ornamental allowance was not set through a calculation process originally. Therefore, this value was adjusted downward by 25% to reflect the growing use of LED lighting to replace incandescent in this category.

Figure 67: Building Facades Calculation Results and Recommendations

Building Facades Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance		0.18	0.35	0.50	W/sf
	LPW	34	36	36	36	lm/W
2016	LPW	82	86	88	90	lm/W
	Change		0.07	0.14	0.20	Limit of Reduction
	Proposed		0.15	0.25	0.35	W/sf

Figure 68: Building Facades Lumen Equivalency Calculation Pt. 1

Building Facade Calculations T-24 2016 - Incumbent Lamps

Wall Mounted Full Cutoff						Weighting				Weighted LPW			
2008 Basis of Design						LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Lamp Type	Luminaire	Lamp Wattage	System Watts	Maintained Luminaire Lumens	LPW								
CFL	Lum. A	26	28	1,119	40	0.10	0.10	0.05	0.05	4	4	2	2
CFL	Lum. A	32	35	1,492	43	0.15	0.10	0.10	0.05	6	4	4	2
CFL	Lum. A	42	46	1,989	43	0.30	0.25	0.20	0.10	13	11	9	4
PSMH	Lum. B	50	67	732	11	0.15	0.20	0.10	0.20	2	2	1	2
PSMH	Lum. B	70	92	1,509	16	0.15	0.20	0.15	0.10	2	3	2	2
PSMH	Lum. B	100	129	2,138	17	0.10	0.05	0.20	0.20	2	1	3	3
PSMH	Lum. B	150	190	5,029	26	0.05	0.05	0.15	0.20	1	1	4	5
PSMH	Lum. C	250	291	6,431	22	0.00	0.05	0.05	0.10	0	1	1	2
						1.00	1.00	1.00	1.00	30	28	27	23

Ground Mounted Floodlight						Weighting				Weighted LPW			
2008 Basis of Design						LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Lamp Type	Luminaire	Lamp Wattage	System Watts	Maintained Luminaire Lumens	LPW								
PSMH	Lum. D	100	129	3,816	30	1.00	0.45	0.25	0.25	30	13	7	7
PSMH	Lum. D	150	190	8,670	46	0.00	0.45	0.50	0.35	0	21	23	16
PSMH	Lum. D	250	291	12,139	42	0.00	0.10	0.25	0.40	0	4	10	17
						1.00	1.00	1.00	1.00	30	38	41	40

Wall Mounted Floodlight						Weighting				Weighted LPW			
2008 Basis of Design						LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Lamp Type	Luminaire	Lamp Wattage	System Watts	Maintained Luminaire Lumens	LPW								
T8	Lum. E	17	19	952	50	0.10	0.05	0.08	0.10	5	3	4	5
T8	Lum. E	25	26	1,434	55	0.10	0.05	0.08	0.10	6	3	4	6
T8	Lum. E	32	33	2,084	63	0.30	0.30	0.20	0.10	19	19	13	6
T5	Lum. E	14	17	855	50	0.10	0.05	0.08	0.10	5	3	4	5
T5	Lum. E	21	25	1,490	60	0.10	0.05	0.08	0.10	6	3	4	6
T5	Lum. E	28	31	1,856	60	0.30	0.30	0.20	0.10	18	18	12	6
T5HO	Lum. E	24	27	1,275	47	0.00	0.05	0.05	0.10	0	2	2	5
T5HO	Lum. E	39	41	2,326	57	0.00	0.05	0.05	0.15	0	3	3	9
T5HO	Lum. E	54	62	3,021	49	0.00	0.10	0.20	0.15	0	5	10	7
						1.00	1.00	1.00	1.00	58	58	56	54

Cylindrical Uplight						Weighting				Weighted LPW			
2008 Basis of Design						LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Lamp Type	Luminaire	Lamp Wattage	System Watts	Maintained Luminaire Lumens	LPW								
MR16	Lum. F	50	50	752	15	0.30	0.15	0.05	0.00	5	2	1	0
MR16	Lum. F	75	75	1,062	14	0.30	0.15	0.10	0.05	4	2	1	1
PSMH	Lum. G	50	67	1,087	16	0.15	0.30	0.25	0.10	2	5	4	2
PSMH	Lum. G	70	92	2,241	24	0.15	0.25	0.35	0.25	4	6	9	6
PSMH	Lum. G	100	129	3,175	25	0.10	0.10	0.15	0.30	2	2	4	7
PSMH	Lum. H	150	190	7,001	37	0.00	0.05	0.10	0.30	0	2	4	11
						1.00	1.00	1.00	1.00	17	20	22	27

AVERAGE:										34	36	36	36
----------	--	--	--	--	--	--	--	--	--	----	----	----	----

Figure 69: Building Facades Lumen Equivalency Calculation Pt. 2

Building Facade Calculations T-24 2016 - LED

2016 LED Equivalency						Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	19	1,600	0.930	84	0.10	0.10	0.05	0.05	8	8	4	4
LED	LED A	19	1,600	0.930	84	0.15	0.10	0.10	0.05	13	8	8	4
LED	LED A	19	1,967	0.930	103	0.30	0.25	0.20	0.10	31	26	21	10
LED	LED A	19	1,600	0.930	84	0.15	0.20	0.10	0.20	13	17	8	17
LED	LED B	24	2,502	0.887	105	0.15	0.20	0.15	0.10	16	21	16	11
LED	LED B	35	3,049	0.781	86	0.10	0.05	0.20	0.20	9	4	17	17
LED	LED C	50	5,312	0.887	106	0.05	0.05	0.15	0.20	5	5	16	21
LED	LED C	77	7,992	0.887	103	0.00	0.05	0.05	0.10	0	5	5	10
						1.00	1.00	1.00	1.00	94	95	96	95

2016 LED Equivalency						Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED D	67	6,082	0.930	91	1.00	0.45	0.25	0.25	91	41	23	23
LED	LED E	96	11,439	0.927	119	0.00	0.45	0.50	0.35	0	53	59	42
LED	LED E	156	14,847	0.840	95	0.00	0.10	0.25	0.40	0	10	24	38
						1.00	1.00	1.00	1.00	91	104	106	102

2016 LED Equivalency						Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED F	13	1,083	0.938	80	0.10	0.05	0.08	0.10	8	4	6	8
LED	LED G	21	1,395	0.915	66	0.10	0.05	0.08	0.10	7	3	5	7
LED	LED F	25	2,167	0.938	87	0.30	0.30	0.20	0.10	26	26	17	9
LED	LED F	13	1,083	0.938	80	0.10	0.05	0.08	0.10	8	4	6	8
LED	LED G	21	1,395	0.915	66	0.10	0.05	0.08	0.10	7	3	5	7
LED	LED G	21	1,395	0.915	66	0.30	0.30	0.20	0.10	20	20	13	7
LED	LED G	21	1,395	0.915	66	0.00	0.05	0.05	0.10	0	3	3	7
LED	LED G	42	2,638	0.915	62	0.00	0.05	0.05	0.15	0	3	3	9
LED	LED F	35	3,163	0.938	89	0.00	0.10	0.20	0.15	0	9	18	13
						1.00	1.00	1.00	1.00	75	76	77	74

2016 LED Equivalency						Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED H	11	635	0.700	60	0.30	0.15	0.05	0.00	18	9	3	0
LED	LED H	11	635	0.700	60	0.30	0.15	0.10	0.05	18	9	6	3
LED	LED H	30	1,845	0.700	62	0.15	0.30	0.25	0.10	9	19	15	6
LED	LED H	39	2,638	0.700	68	0.15	0.25	0.35	0.25	10	17	24	17
LED	LED J	57	7,044	0.700	123	0.10	0.10	0.15	0.30	12	12	18	37
LED	LED J	77	6,740	0.700	88	0.00	0.05	0.10	0.30	0	4	9	26
						1.00	1.00	1.00	1.00	68	70	75	89

AVERAGE:

82	86	88	90
----	----	----	----

Figure 70: Building Facades Cost Calculation Pt. 1

Building Facade Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design							Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Lamp Wattage	System Watts	Initial Cost	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
CFL	Lum. A	26	28	\$ 351	1,119	40	0.10	0.10	0.05	0.05	\$ 35	\$ 35	\$ 18	\$ 18	3	3	1	1
CFL	Lum. A	32	35	\$ 371	1,492	43	0.15	0.10	0.10	0.05	\$ 56	\$ 37	\$ 37	\$ 19	5	4	4	2
CFL	Lum. A	42	46	\$ 402	1,989	43	0.30	0.25	0.20	0.10	\$ 121	\$ 101	\$ 80	\$ 40	14	12	9	5
PSMH	Lum. B	50	67	\$ 368	732	11	0.15	0.20	0.10	0.20	\$ 55	\$ 74	\$ 37	\$ 74	10	13	7	13
PSMH	Lum. B	70	92	\$ 377	1,509	16	0.15	0.20	0.15	0.10	\$ 57	\$ 75	\$ 57	\$ 38	14	18	14	9
PSMH	Lum. B	100	129	\$ 377	2,138	17	0.10	0.05	0.20	0.20	\$ 38	\$ 19	\$ 75	\$ 75	13	6	26	26
PSMH	Lum. B	150	190	\$ 382	5,029	26	0.05	0.05	0.15	0.20	\$ 19	\$ 19	\$ 57	\$ 76	10	10	29	38
PSMH	Lum. C	250	291	\$ 393	6,431	22	0.00	0.05	0.05	0.10	\$ -	\$ 20	\$ 20	\$ 39	0	15	15	29
							1.00	1.00	1.00	1.00	\$ 380	\$ 380	\$ 381	\$ 379	68	80	103	123

2008 Basis of Design							Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Lamp Wattage	System Watts	Initial Cost	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
PSMH	Lum. D	100	129	\$ 506	3,816	30	1.00	0.45	0.25	0.25	\$ 506	\$ 227	\$ 126	\$ 126	129	58	32	32
PSMH	Lum. D	150	190	\$ 515	8,670	46	0.00	0.45	0.50	0.35	\$ -	\$ 232	\$ 257	\$ 180	0	86	95	67
PSMH	Lum. D	250	291	\$ 637	12,139	42	0.00	0.10	0.25	0.40	\$ -	\$ 64	\$ 159	\$ 255	0	29	73	116
							1.00	1.00	1.00	1.00	\$ 506	\$ 523	\$ 543	\$ 562	129	173	200	215

2008 Basis of Design							Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Lamp Wattage	System Watts	Initial Cost	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
T8	Lum. E	17	19	\$ 775	952	50	0.10	0.05	0.08	0.10	\$ 77	\$ 39	\$ 58	\$ 77	2	1	1	2
T8	Lum. E	25	26	\$ 472	1,434	55	0.10	0.05	0.08	0.10	\$ 47	\$ 24	\$ 35	\$ 47	3	1	2	3
T8	Lum. E	32	33	\$ 553	2,084	63	0.30	0.30	0.20	0.10	\$ 166	\$ 166	\$ 111	\$ 55	10	10	7	3
T5	Lum. E	14	17	\$ 480	855	50	0.10	0.05	0.08	0.10	\$ 48	\$ 24	\$ 36	\$ 48	2	1	1	2
T5	Lum. E	21	25	\$ 517	1,490	60	0.10	0.05	0.08	0.10	\$ 52	\$ 26	\$ 39	\$ 52	3	1	2	3
T5	Lum. E	28	31	\$ 392	1,856	60	0.30	0.30	0.20	0.10	\$ 118	\$ 118	\$ 78	\$ 39	9	9	6	3
T5HO	Lum. E	24	27	\$ 336	1,275	47	0.00	0.05	0.05	0.10	\$ -	\$ 17	\$ 17	\$ 34	0	1	1	3
T5HO	Lum. E	39	41	\$ 362	2,326	57	0.00	0.05	0.05	0.15	\$ -	\$ 18	\$ 18	\$ 54	0	2	2	6
T5HO	Lum. E	54	62	\$ 392	3,021	49	0.00	0.10	0.20	0.15	\$ -	\$ 39	\$ 78	\$ 59	0	6	12	9
							1.00	1.00	1.00	1.00	\$ 508	\$ 470	\$ 471	\$ 466	28	33	35	33

2008 Basis of Design							Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Lamp Wattage	System Watts	Initial Cost	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
MR16	Lum. F	50	50	\$ 91	752	15	0.30	0.15	0.05	0.00	\$ 27	\$ 14	\$ 5	\$ -	15	8	3	0
MR16	Lum. F	75	75	\$ 91	1,062	14	0.30	0.15	0.10	0.05	\$ 27	\$ 14	\$ 9	\$ 5	23	11	8	4
PSMH	Lum. G	50	67	\$ 589	1,087	16	0.15	0.30	0.25	0.10	\$ 88	\$ 177	\$ 147	\$ 59	10	20	17	7
PSMH	Lum. G	70	92	\$ 589	2,241	24	0.15	0.25	0.35	0.25	\$ 88	\$ 147	\$ 206	\$ 147	14	23	32	23
PSMH	Lum. G	100	129	\$ 589	3,175	25	0.10	0.10	0.15	0.30	\$ 59	\$ 59	\$ 88	\$ 177	13	13	19	39
PSMH	Lum. H	150	190	\$ 1,676	7,001	37	0.00	0.05	0.10	0.30	\$ -	\$ 84	\$ 168	\$ 503	0	10	19	57
							1.00	1.00	1.00	1.00	\$ 290	\$ 494	\$ 623	\$ 890	74	84	97	129
							AVERAGE:				\$ 421	\$ 467	\$ 505	\$ 574	75	93	109	125
							\$/W				\$5.63	\$5.04	\$4.63	\$4.59				

Figure 71: Building Facades Cost Calculation Pt. 2

Building Facade Calculations T-24 2016 - LED

2016 LED Equivalency							Weighting				Weighted Cost				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	2017 Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	19	\$ 371	1,600	0.930	84	0.10	0.10	0.05	0.05	\$ 37	\$ 37	\$ 19	\$ 19	8	8	4	4
LED	LED A	19	\$ 402	1,600	0.930	84	0.15	0.10	0.10	0.05	\$ 60	\$ 40	\$ 40	\$ 20	13	8	8	4
LED	LED A	19	\$ 467	1,967	0.930	103	0.30	0.25	0.20	0.10	\$ 140	\$ 117	\$ 93	\$ 47	31	26	21	10
LED	LED A	19	\$ 474	1,600	0.930	84	0.15	0.20	0.10	0.20	\$ 71	\$ 95	\$ 47	\$ 95	13	17	8	17
LED	LED B	24	\$ 996	2,502	0.887	105	0.15	0.20	0.15	0.10	\$ 149	\$ 199	\$ 149	\$ 100	16	21	16	11
LED	LED B	35	\$ 996	3,049	0.781	86	0.10	0.05	0.20	0.20	\$ 100	\$ 50	\$ 199	\$ 199	9	4	17	17
LED	LED C	50	\$ 996	5,312	0.887	106	0.05	0.05	0.15	0.20	\$ 50	\$ 50	\$ 149	\$ 199	5	5	16	21
LED	LED C	77	\$ 996	7,992	0.887	103	0.00	0.05	0.05	0.10	\$ -	\$ 50	\$ 50	\$ 100	0	5	5	10
							1.00	1.00	1.00	1.00	\$ 607	\$ 637	\$ 747	\$ 778	94	95	96	95

2016 LED Equivalency							Weighting				Weighted Cost				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	2017 Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED D	67	\$ 522	6,082	0.930	91	1.00	0.45	0.25	0.25	\$ 522	\$ 235	\$ 131	\$ 131	91	41	23	23
LED	LED E	96	\$ 1,013	11,439	0.927	119	0.00	0.45	0.50	0.35	\$ -	\$ 456	\$ 507	\$ 355	0	53	59	42
LED	LED E	156	\$ 1,383	14,847	0.840	95	0.00	0.10	0.25	0.40	\$ -	\$ 138	\$ 346	\$ 553	0	10	24	38
							1.00	1.00	1.00	1.00	\$ 522	\$ 829	\$ 983	\$ 1,038	91	104	106	102

2016 LED Equivalency							Weighting				Weighted Cost				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	2017 Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED F	13	\$ 679	1,083	0.938	80	0.10	0.05	0.08	0.10	\$ 68	\$ 34	\$ 51	\$ 68	8	4	6	8
LED	LED G	21	\$ 926	1,395	0.915	66	0.10	0.05	0.08	0.10	\$ 93	\$ 46	\$ 69	\$ 93	7	3	5	7
LED	LED F	25	\$ 926	2,167	0.938	87	0.30	0.30	0.20	0.10	\$ 278	\$ 278	\$ 185	\$ 93	26	26	17	9
LED	LED F	13	\$ 926	1,083	0.938	80	0.10	0.05	0.08	0.10	\$ 93	\$ 46	\$ 69	\$ 93	8	4	6	8
LED	LED G	21	\$ 926	1,395	0.915	66	0.10	0.05	0.08	0.10	\$ 93	\$ 46	\$ 69	\$ 93	7	3	5	7
LED	LED G	21	\$ 926	1,395	0.915	66	0.30	0.30	0.20	0.10	\$ 278	\$ 278	\$ 185	\$ 93	20	20	13	7
LED	LED G	21	\$ 926	1,395	0.915	66	0.00	0.05	0.05	0.10	\$ -	\$ 46	\$ 46	\$ 93	0	3	3	7
LED	LED G	42	\$ 926	2,638	0.915	62	0.00	0.05	0.05	0.15	\$ -	\$ 46	\$ 46	\$ 139	0	3	3	9
LED	LED F	35	\$ 1,059	3,163	0.938	89	0.00	0.10	0.20	0.15	\$ -	\$ 106	\$ 212	\$ 159	0	9	18	13
							1.00	1.00	1.00	1.00	\$ 901	\$ 927	\$ 934	\$ 921	75	76	77	74

2016 LED Equivalency							Weighting				Weighted Cost				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	2017 Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED H	11	\$ 1,432	635	0.700	60	0.30	0.15	0.05	0.00	\$ 430	\$ 215	\$ 72	\$ -	18	9	3	0
LED	LED H	11	\$ 1,432	635	0.700	60	0.30	0.15	0.10	0.05	\$ 430	\$ 215	\$ 143	\$ 72	18	9	6	3
LED	LED H	30	\$ 3,131	1,845	0.700	62	0.15	0.30	0.25	0.10	\$ 470	\$ 939	\$ 783	\$ 313	9	19	15	6
LED	LED H	39	\$ 3,131	2,638	0.700	68	0.15	0.25	0.35	0.25	\$ 470	\$ 783	\$ 1,096	\$ 783	10	17	24	17
LED	LED J	57	\$ 3,131	7,044	0.700	123	0.10	0.10	0.15	0.30	\$ 313	\$ 313	\$ 470	\$ 939	12	12	18	37
LED	LED J	77	\$ 3,608	6,740	0.700	88	0.00	0.05	0.10	0.30	\$ -	\$ 180	\$ 361	\$ 1,082	0	4	9	26
							1.00	1.00	1.00	1.00	\$ 2,112	\$ 2,645	\$ 2,924	\$ 3,189	68	70	75	89

AVERAGE:			
\$1,036	\$1,260	\$1,397	\$1,482
\$12.63	\$14.60	\$15.80	\$16.45

Figure 72: Outdoor Sales Lots Calculation Results and Recommendations

Outdoor Sales Lots Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	0.164	0.555	0.758	1.285	W/sf
	LPW	27	29	32	34	lm/W
2016	LPW	93	101	101	103	lm/W
	Change	0.049	0.160	0.243	0.419	Limit of Reduction
	Proposed	0.100	0.250	0.500	1.000	W/sf

Figure 73: Outdoor Sales Lots Lumen Equivalency Calculation Pt. 1

Sales Lot Calculations T-24 2016 - Incumbent Lamps

Area							Weighting				Weighted LPW			
2008 Basis of Design							LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW								
100	PSMH	Lum. A	129	2,809	0.550	22	0.10	0.05	0.00	0.00	2	1	0	0
150	PSMH	Lum. A	190	6,558	0.786	35	0.20	0.10	0.10	0.05	7	3	3	2
175	PSMH	Lum. A	198	5,053	0.648	26	0.25	0.15	0.15	0.10	6	4	4	3
250	PSMH	Lum. A	291	6,697	0.611	23	0.25	0.25	0.20	0.20	6	6	5	5
320	PSMH	Lum. A	368	11,997	0.704	33	0.10	0.25	0.20	0.20	3	8	7	7
400	PSMH	Lum. A	452	13,641	0.723	30	0.10	0.15	0.15	0.20	3	5	5	6
750	PSMH	Lum. A	818	37,028	0.824	45	0.00	0.05	0.15	0.15	0	2	7	7
1000	PSMH	Lum. A	1080	57,062	0.801	53	0.00	0.00	0.05	0.10	0	0	3	5
							1.00	1.00	1.00	1.00	27	29	32	34
AVERAGE:											27	29	32	34

Figure 74: Outdoor Sales Lots Lumen Equivalency Calculation Pt. 2

Sales Lot Calculations T-24 2016 - LED

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	3,331	37	89	0.10	0.05	0.00	0.00	9	4	0	0
LED A	5,965	76	79	0.20	0.10	0.10	0.05	16	8	8	4
LED A	5,391	60	90	0.25	0.15	0.15	0.10	23	14	14	9
LED A	7,662	90	85	0.25	0.25	0.20	0.20	21	21	17	17
LED B	15,789	130	122	0.10	0.25	0.20	0.20	12	30	24	24
LED B	16,942	139	122	0.10	0.15	0.15	0.20	12	18	18	24
LED C	39,885	378	106	0.00	0.05	0.15	0.15	0	5	16	16
LED C	48,959	589	83	0.00	0.00	0.05	0.10	0	0	4	8
				1.00	1.00	1.00	1.00	93	101	101	103
AVERAGE:								93	101	101	103

Figure 75: Outdoor Sales Lots Cost Calculation Pt. 1

Sales Lot Calculations T-24 2016 - Incumbent Lamps

Area								Weighting				Weighted Cost				Weighted W			
2008 Basis of Design																			
Wattage	Lamp Type	Luminaire	System Watts	Initial Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
100	PSMH	Lum. A	129	\$1,035	2,809	0.550	22	0.10	0.05	0.00	0.00	\$ 104	\$ 52	\$ -	\$ -	13	6	0	0
150	PSMH	Lum. A	190	\$1,035	6,558	0.786	35	0.20	0.10	0.10	0.05	\$ 207	\$ 104	\$ 104	\$ 52	38	19	19	10
175	PSMH	Lum. A	198	\$1,035	5,053	0.648	26	0.25	0.15	0.15	0.10	\$ 259	\$ 155	\$ 155	\$ 104	50	30	30	20
250	PSMH	Lum. A	291	\$1,235	6,697	0.611	23	0.25	0.25	0.20	0.20	\$ 309	\$ 309	\$ 247	\$ 247	73	73	58	58
320	PSMH	Lum. A	368	\$ 864	11,997	0.704	33	0.10	0.25	0.20	0.20	\$ 86	\$ 216	\$ 173	\$ 173	37	92	74	74
400	PSMH	Lum. A	452	\$ 864	13,641	0.723	30	0.10	0.15	0.15	0.20	\$ 86	\$ 130	\$ 130	\$ 173	45	68	68	90
750	PSMH	Lum. A	818	\$1,265	37,028	0.824	45	0.00	0.05	0.15	0.15	\$ -	\$ 63	\$ 190	\$ 190	0	41	123	123
1000	PSMH	Lum. A	1080	\$1,265	57,062	0.801	53	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 63	\$ 126	0	0	54	108
								1.00	1.00	1.00	1.00	\$1,051	\$1,028	\$1,061	\$1,064	255	329	425	482
AVERAGE:												\$1,051	\$1,028	\$1,061	\$1,064	255	329	425	482
\$/W:												\$ 4.12	\$ 3.13	\$ 2.50	\$ 2.21				

Figure 76: Outdoor Sales Lots Cost Calculation Pt. 2

Sales Lot Calculations T-24 2016 - LED

2016 LED Equivalency								Weighting				Weighted Cost				Weighted W					
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	2017 Cost	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	4,759	3,331	\$ 1,204	0.700	53	37	89	68	310%	0.10	0.05	0.00	0.00	\$ 120	\$ 60	\$ -	\$ -	4	2	0	0
LED A	8,522	5,965	\$ 1,720	0.700	107	76	79	44	128%	0.20	0.10	0.10	0.05	\$ 344	\$ 172	\$ 172	\$ 86	15	8	8	4
LED A	7,701	5,391	\$ 1,810	0.700	84	60	90	65	254%	0.25	0.15	0.15	0.10	\$ 453	\$ 272	\$ 272	\$ 181	15	9	9	6
LED A	10,945	7,662	\$ 1,810	0.700	128	90	85	62	268%	0.25	0.25	0.20	0.20	\$ 453	\$ 453	\$ 362	\$ 362	23	23	18	18
LED B	17,800	15,789	\$ 795	0.887	183	130	122	89	273%	0.10	0.25	0.20	0.20	\$ 80	\$ 199	\$ 159	\$ 159	13	32	26	26
LED B	19,100	16,942	\$ 808	0.887	196	139	122	92	304%	0.10	0.15	0.15	0.20	\$ 81	\$ 121	\$ 121	\$ 162	14	21	21	28
LED C	45,687	39,885	\$ 1,313	0.873	533	378	106	60	133%	0.00	0.05	0.15	0.15	\$ -	\$ 66	\$ 197	\$ 197	0	19	57	57
LED C	61,352	48,959	\$ 1,626	0.798	831	589	83	30	57%	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 81	\$ 163	0	0	29	59
								1.00	1.00	1.00	1.00	\$1,530	\$1,342	\$1,364	\$1,309	83	113	168	197		
AVERAGE:												\$1,530	\$1,342	\$1,364	\$1,309	83	113	168	197		
\$/W:												\$18.36	\$11.85	\$ 8.14	\$ 6.64						

Figure 77: Vehicle Service Station Hardscape Calculation Results and Recommendations

Service Station Hardscape Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	0.014	0.155	0.308	0.485	W/sf
	LPW	29	28	27	27	lm/W
2016	LPW	82	83	83	83	lm/W
	Change	0.005	0.053	0.101	0.156	Limit of Reduction
	Proposed	0.010	0.100	0.150	0.200	W

Figure 78: Vehicle Service Station Hardscape Lumen Equivalency Calculation Pt. 1

Service Station Hardscape Calculations T-24 2016 - Incumbent Lamps

Area							2008 Basis of Design				Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
42	CFL	Lum. A	47	1,841	0.860	39	0.05	0.05	0.00	0.00	2	2	0	0				
57	CFL	Lum. A	59	2,407	0.860	41	0.10	0.05	0.05	0.05	4	2	2	2				
70	PSMH	Lum. B	90	1,984	0.589	22	0.05	0.05	0.05	0.05	1	1	1	1				
100	PSMH	Lum. B	129	2,809	0.550	22	0.10	0.10	0.15	0.10	2	2	3	2				
150	PSMH	Lum. B	190	6,558	0.786	35	0.25	0.25	0.25	0.20	9	9	9	7				
175	PSMH	Lum. B	198	5,053	0.648	26	0.30	0.30	0.25	0.30	8	8	6	8				
250	PSMH	Lum. B	291	6,697	0.611	23	0.15	0.20	0.25	0.30	3	5	6	7				
							1.00	1.00	1.00	1.00	29	28	27	27				

Figure 79: Vehicle Service Station Hardscape Equivalency Calculation Pt. 2

Service Station Hardscape Calculations T-24 2016 - LED

Area							2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	2,169	1,518	0.700	25	18	86	0.05	0.05	0.00	0.00	4	4	0	0				
LED B	3,230	2,261	0.700	54	38	59	0.10	0.05	0.05	0.05	6	3	3	3				
LED B	3,230	2,261	0.700	54	38	59	0.05	0.05	0.05	0.05	3	3	3	3				
LED A	4,759	3,331	0.700	53	37	89	0.10	0.10	0.15	0.10	9	9	13	9				
LED A	8,522	5,965	0.700	107	76	79	0.25	0.25	0.25	0.20	20	20	20	16				
LED A	7,701	5,391	0.700	84	60	90	0.30	0.30	0.25	0.30	27	27	23	27				
LED A	10,945	7,662	0.700	128	90	85	0.15	0.20	0.25	0.30	13	17	21	25				
							1.00	1.00	1.00	1.00	82	83	83	83				

Figure 80: Vehicle Service Station Hardscape Cost Calculation Pt. 1

Service Station Hardscape Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Initial Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
42	CFL	Lum. A	47	\$ 393	1,841	0.860	39	0.05	0.05	0.00	0.00	\$ 20	\$ 20	\$ -	\$ -	2	2	0	0
57	CFL	Lum. A	59	\$ 402	2,407	0.860	41	0.10	0.05	0.05	0.05	\$ 40	\$ 20	\$ 20	\$ 20	6	3	3	3
70	PSMH	Lum. B	90	\$1,035	1,984	0.589	22	0.05	0.05	0.05	0.05	\$ 52	\$ 52	\$ 52	\$ 52	5	5	5	5
100	PSMH	Lum. B	129	\$1,035	2,809	0.550	22	0.10	0.10	0.15	0.10	\$ 104	\$ 104	\$ 155	\$ 104	13	13	19	13
150	PSMH	Lum. B	190	\$1,035	6,558	0.786	35	0.25	0.25	0.25	0.20	\$ 259	\$ 259	\$ 259	\$ 207	48	48	48	38
175	PSMH	Lum. B	198	\$1,035	5,053	0.648	26	0.30	0.30	0.25	0.30	\$ 311	\$ 311	\$ 259	\$ 311	59	59	50	59
250	PSMH	Lum. B	291	\$1,235	6,697	0.611	23	0.15	0.20	0.25	0.30	\$ 185	\$ 247	\$ 309	\$ 370	44	58	73	87
								1.00	1.00	1.00	1.00	\$ 970	\$1,012	\$1,054	\$1,064	176	188	197	205
								\$/W				\$5.50	\$ 5.39	\$ 5.36	\$ 5.19				

Figure 81: Vehicle Service Station Hardscape Cost Calculation Pt. 2

Service Station Hardscape Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	1,518	\$ 1,246	18	86	0.05	0.05	0.00	0.00	\$ 62	\$ 62	\$ -	\$ -	1	1	0	0
LED B	2,261	\$ 508	38	59	0.10	0.05	0.05	0.05	\$ 51	\$ 25	\$ 25	\$ 25	4	2	2	2
LED B	2,261	\$ 508	38	59	0.05	0.05	0.05	0.05	\$ 25	\$ 25	\$ 25	\$ 25	2	2	2	2
LED A	3,331	\$ 1,204	37	89	0.10	0.10	0.15	0.10	\$ 120	\$ 120	\$ 181	\$ 120	4	4	6	4
LED A	5,965	\$ 1,720	76	79	0.25	0.25	0.25	0.20	\$ 430	\$ 430	\$ 430	\$ 344	19	19	19	15
LED A	5,391	\$ 1,810	60	90	0.30	0.30	0.25	0.30	\$ 543	\$ 543	\$ 453	\$ 543	18	18	15	18
LED A	7,662	\$ 1,810	90	85	0.15	0.20	0.25	0.30	\$ 272	\$ 362	\$ 453	\$ 543	14	18	23	27
					1.00	1.00	1.00	1.00	\$1,503	\$1,568	\$1,566	\$1,601	61	63	66	68
					\$/W				\$24.72	\$24.73	\$23.75	\$23.62				

Figure 82: Vehicle Service Station Canopies Calculation Results and Recommendations

Service Station Canopies Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	0.514	1.005	1.300	2.200	W/sf
	LPW	29	30	32	33	lm/W
2016	LPW	88	87	89	93	lm/W
	Change	0.169	0.344	0.467	0.787	Limit of Reduction
	Proposed	0.400	0.700	0.900	1.200	W/sf

Figure 83: Vehicle Service Station Canopies Lumen Equivalency Calculation Pt. 1

Service Station Canopy Calculations T-24 2016 - Incumbent Lamps

Round Ceiling Mounted Downlight						
2008 Basis of Design						
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW
50	PSMH	Lum. A	67	1,022	0.464	15
70	PSMH	Lum. A	92	2,108	0.589	23
100	PSMH	Lum. A	129	2,986	0.550	23
150	PSMH	Lum. A	190	7,026	0.786	37

Weighting			
LZ1	LZ2	LZ3	LZ4
0.10	0.05	0.00	0.00
0.20	0.15	0.05	0.05
0.30	0.25	0.20	0.10
0.40	0.55	0.75	0.85

Weighted LPW			
LZ1	LZ2	LZ3	LZ4
2	1	0	0
5	3	1	1
7	6	5	2
15	20	28	31

1.00	1.00	1.00	1.00
------	------	------	------

28	30	34	35
-----------	-----------	-----------	-----------

Ceiling Mounted Box, Full Cut-Off						
2008 Basis of Design						
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW
70	PSMH	Lum. B	92	2,114	0.589	23
100	PSMH	Lum. C	129	3,445	0.550	27
150	PSMH	Lum. C	190	7,713	0.786	41
175	PSMH	Lum. C	198	6,335	0.648	32

Weighting			
LZ1	LZ2	LZ3	LZ4
0.10	0.05	0.00	0.00
0.20	0.15	0.05	0.05
0.30	0.25	0.20	0.10
0.40	0.55	0.75	0.85

Weighted LPW			
LZ1	LZ2	LZ3	LZ4
2	1	0	0
5	4	1	1
12	10	8	4
13	18	24	27

1.00	1.00	1.00	1.00
------	------	------	------

33	33	33	33
-----------	-----------	-----------	-----------

10" Recessed Downlights, Fresnel Lens						
2008 Basis of Design						
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW
(3) 32	CFL	Lum. D	68	1,748	0.860	26
(2) 42	CFL	Lum. D	93	2,276	0.860	24
(2) 57	CFL	Lum. D	128	3,408	0.860	27
50	PSMH	Lum. D	67	868	0.464	13
70	PSMH	Lum. D	92	1,790	0.589	19
100	PSMH	Lum. D	129	2,537	0.550	20
150	PSMH	Lum. D	190	5,968	0.786	31

Weighting			
LZ1	LZ2	LZ3	LZ4
0.05	0.05	0.00	0.00
0.05	0.05	0.05	0.05
0.00	0.05	0.10	0.10
0.10	0.05	0.00	0.00
0.20	0.10	0.05	0.05
0.25	0.20	0.10	0.10
0.35	0.50	0.70	0.70

Weighted LPW			
LZ1	LZ2	LZ3	LZ4
1	1	0	0
1	1	1	1
0	1	3	3
1	1	0	0
4	2	1	1
5	4	2	2
11	16	22	22

1.00	1.00	1.00	1.00
------	------	------	------

24	26	29	29
-----------	-----------	-----------	-----------

AVERAGE:

28	30	32	32
-----------	-----------	-----------	-----------

Figure 84: Vehicle Service Station Canopies Equivalency Calculation Pt. 2

Service Station Canopy Calculations T-24 2016 - LED

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	1,736	19	91	0.10	0.05	0.00	0.00	9	5	0	0
LED A	3,444	38	90	0.20	0.15	0.05	0.05	18	13	4	4
LED B	4,876	49	100	0.30	0.25	0.20	0.10	30	25	20	10
LED A	8,302	67	123	0.40	0.55	0.75	0.85	49	68	92	105
				1.00	1.00	1.00	1.00	106	111	117	119

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED C	3,233	37	88	0.10	0.05	0.00	0.00	9	4	0	0
LED C	5,301	61	87	0.20	0.15	0.05	0.05	17	13	4	4
LED C	7,439	91	81	0.30	0.25	0.20	0.10	24	20	16	8
LED C	7,439	91	81	0.40	0.55	0.75	0.85	33	45	61	69
				1.00	1.00	1.00	1.00	83	83	82	82

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED E	1,443	23	62	0.05	0.05	0.00	0.00	3	3	0	0
LED E	1,710	26	66	0.05	0.05	0.05	0.05	3	3	3	3
LED F	2,902	40	73	0.00	0.05	0.10	0.10	0	4	7	7
LED E	1,320	20	66	0.10	0.05	0.00	0.00	7	3	0	0
LED E	2,207	35	63	0.20	0.10	0.05	0.05	13	6	3	3
LED F	2,902	40	73	0.25	0.20	0.10	0.10	18	15	7	7
LED G	6,045	90	67	0.35	0.50	0.70	0.70	23	33	47	47
				1.00	1.00	1.00	1.00	67	68	68	68
AVERAGE:								86	87	89	90

Figure 85: Vehicle Service Station Canopies Cost Calculation Pt. 1

Service Station Canopy Calculations T-24 2016 - Incumbent Lamps

Round Ceiling Mounted Downlight								Weighting				Weighted Cost				Weighted W			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Initial Cost	Maintained Luminaire Lumens	LLD	LPW												
50	PSMH	Lum. A	67	\$ 483	1,022	0.464	15	0.10	0.05	0.00	0.00	\$ 48	\$ 24	\$ -	\$ -	7	3	0	0
70	PSMH	Lum. A	92	\$ 483	2,108	0.589	23	0.20	0.15	0.05	0.05	\$ 97	\$ 72	\$ 24	\$ 24	18	14	5	5
100	PSMH	Lum. A	129	\$ 506	2,986	0.550	23	0.30	0.25	0.20	0.10	\$ 152	\$ 127	\$ 101	\$ 51	39	32	26	13
150	PSMH	Lum. A	190	\$ 528	7,026	0.786	37	0.40	0.55	0.75	0.85	\$ 211	\$ 290	\$ 396	\$ 449	76	105	143	162
								1.00	1.00	1.00	1.00	\$ 508	\$ 514	\$ 521	\$ 523	140	154	173	179

Ceiling Mounted Box, Full Cut-Off								Weighting				Weighted Cost				Weighted W			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Initial Cost	Maintained Luminaire Lumens	LLD	LPW												
70	PSMH	Lum. B	92	\$ 293	2,114	0.589	23	0.10	0.05	0.00	0.00	\$ 29	\$ 15	\$ -	\$ -	9	5	0	0
100	PSMH	Lum. C	129	\$ 592	3,445	0.550	27	0.20	0.15	0.05	0.05	\$ 118	\$ 89	\$ 30	\$ 30	26	19	6	6
150	PSMH	Lum. C	190	\$ 592	7,713	0.786	41	0.30	0.25	0.20	0.10	\$ 178	\$ 148	\$ 118	\$ 59	57	48	38	19
175	PSMH	Lum. C	198	\$ 591	6,335	0.648	32	0.40	0.55	0.75	0.85	\$ 236	\$ 325	\$ 443	\$ 503	79	109	149	168
								1.00	1.00	1.00	1.00	\$ 562	\$ 577	\$ 591	\$ 591	171	180	193	194

10" Recessed Downlights, Fresnel Lens								Weighting				Weighted Cost				Weighted W			
2008 Basis of Design								LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	System Watts	Initial Cost	Maintained Luminaire Lumens	LLD	LPW												
(3) 32	CFL	Lum. D	68	\$ 246	1,748	0.860	26	0.05	0.05	0.00	0.00	\$ 12	\$ 12	\$ -	\$ -	3	3	0	0
(2) 42	CFL	Lum. D	93	\$ 321	2,276	0.860	24	0.05	0.05	0.05	0.05	\$ 16	\$ 16	\$ 16	\$ 16	5	5	5	5
(2) 57	CFL	Lum. D	128	\$ 321	3,408	0.860	27	0.00	0.05	0.10	0.10	\$ -	\$ 16	\$ 32	\$ 32	0	6	13	13
50	PSMH	Lum. D	67	\$ 248	868	0.464	13	0.10	0.05	0.00	0.00	\$ 25	\$ 12	\$ -	\$ -	7	3	0	0
70	PSMH	Lum. D	92	\$ 265	1,790	0.589	19	0.20	0.10	0.05	0.05	\$ 53	\$ 26	\$ 13	\$ 13	18	9	5	5
100	PSMH	Lum. D	129	\$ 265	2,537	0.550	20	0.25	0.20	0.10	0.10	\$ 66	\$ 53	\$ 26	\$ 26	32	26	13	13
150	PSMH	Lum. D	190	\$ 358	5,968	0.786	31	0.35	0.50	0.70	0.70	\$ 125	\$ 179	\$ 250	\$ 250	67	95	133	133
								1.00	1.00	1.00	1.00	\$ 298	\$ 315	\$ 338	\$ 338	132	148	168	168
								AVERAGE:				\$ 456	\$ 468	\$ 484	\$ 484	148	161	178	180
								\$/W				\$ 3.09	\$ 2.92	\$ 2.72	\$ 2.69				

Figure 86: Vehicle Service Station Canopies Cost Calculation Pt. 2

Service Station Canopy Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	1,736	\$ 455	19	91	0.10	0.05	0.00	0.00	\$ 46	\$ 23	\$ -	\$ -	2	1	0	0
LED A	3,444	\$ 586	38	90	0.20	0.15	0.05	0.05	\$ 117	\$ 88	\$ 29	\$ 29	8	6	2	2
LED B	4,876	\$ 1,087	49	100	0.30	0.25	0.20	0.10	\$ 326	\$ 272	\$ 217	\$ 109	15	12	10	5
LED A	8,302	\$ 1,054	67	123	0.40	0.55	0.75	0.85	\$ 422	\$ 580	\$ 791	\$ 896	27	37	51	57
					1.00	1.00	1.00	1.00	\$ 910	\$ 962	\$ 1,037	\$ 1,034	51	56	62	64

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED C	3,233	\$ 1,087	37	88	0.10	0.05	0.00	0.00	\$ 109	\$ 54	\$ -	\$ -	4	2	0	0
LED C	5,301	\$ 1,087	61	87	0.20	0.15	0.05	0.05	\$ 217	\$ 163	\$ 54	\$ 54	12	9	3	3
LED C	7,439	\$ 1,087	91	81	0.30	0.25	0.20	0.10	\$ 326	\$ 272	\$ 217	\$ 109	27	23	18	9
LED C	7,439	\$ 761	91	81	0.40	0.55	0.75	0.85	\$ 304	\$ 418	\$ 571	\$ 647	37	50	69	78
					1.00	1.00	1.00	1.00	\$ 956	\$ 908	\$ 842	\$ 810	80	84	90	90

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED E	1,443	\$ 272	23	62	0.05	0.05	0.00	0.00	\$ 14	\$ 14	\$ -	\$ -	1	1	0	0
LED E	1,710	\$ 288	26	66	0.05	0.05	0.05	0.05	\$ 14	\$ 14	\$ 14	\$ 14	1	1	1	1
LED F	2,902	\$ 798	40	73	0.00	0.05	0.10	0.10	\$ -	\$ 40	\$ 80	\$ 80	0	2	4	4
LED E	1,320	\$ 318	20	66	0.10	0.05	0.00	0.00	\$ 32	\$ 16	\$ -	\$ -	2	1	0	0
LED E	2,207	\$ 334	35	63	0.20	0.10	0.05	0.05	\$ 67	\$ 33	\$ 17	\$ 17	7	3	2	2
LED F	2,902	\$ 798	40	73	0.25	0.20	0.10	0.10	\$ 199	\$ 160	\$ 80	\$ 80	10	8	4	4
LED G	6,045	\$ 1,274	90	67	0.35	0.50	0.70	0.70	\$ 446	\$ 637	\$ 892	\$ 892	32	45	63	63
					1.00	1.00	1.00	1.00	\$ 772	\$ 914	\$ 1,083	\$ 1,083	53	62	74	74
AVERAGE:									\$ 880	\$ 928	\$ 987	\$ 975	61	67	75	76
\$/W									\$14.34	\$13.77	\$13.08	\$12.82				

Figure 87: Sales Canopies Calculation Results and Recommendations

Sales Canopies Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance		0.655	0.908	1.135	W/sf
	LPW	35	36	35	36	lm/W
2016	LPW	67	69	71	70	lm/W
	Change		0.341	0.449	0.579	Limit of Reduction
	Proposed		0.500	0.800	1.000	W/sf

Figure 88: Sales Canopies Lumen Equivalency Calculation Pt. 1

Sales Canopy Calculations T-24 2016 - Incumbent Lamps

Downlight						
2008 Basis of Design						
Lamp Type	Luminaire	Wattage	System Watts	LLD	Maintained Luminaire Lumens	LPW
CFL	Lum. A	13	16	0.861	493	31
CFL	Lum. A	18	20	0.860	763	38
CFL	Lum. B	26	29	0.860	851	29
CFL	Lum. B	32	36	0.860	1,134	32
CFL	Lum. B	42	46	0.860	1,513	33
CFL	Lum. C	(3) 32	68	0.860	1,748	26
CFL	Lum. C	(2) 42	93	0.860	2,276	24
CFL	Lum. C	(2) 57	128	0.860	3,408	27
PSMH	Lum. D	50	67	0.464	1,022	15
PSMH	Lum. D	70	92	0.589	2,108	23
PSMH	Lum. D	100	129	0.550	2,986	23
PSMH	Lum. D	150	190	0.786	7,026	37
PSMH	Lum. E	175	198	0.694	5,447	28
PSMH	Lum. E	250	291	0.733	8,096	28

Weighting				Weighted LPW			
LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
0.05	0.00	0.00	0.00	2	0	0	0
0.05	0.05	0.00	0.00	2	2	0	0
0.05	0.05	0.05	0.00	1	1	1	0
0.10	0.05	0.05	0.05	3	2	2	2
0.10	0.10	0.05	0.05	3	3	2	2
0.15	0.10	0.10	0.10	4	3	3	3
0.15	0.10	0.10	0.10	4	2	2	2
0.05	0.05	0.05	0.10	1	1	1	3
0.15	0.05	0.05	0.05	2	1	1	1
0.10	0.15	0.15	0.05	2	3	3	1
0.05	0.15	0.15	0.10	1	3	3	2
0.00	0.10	0.10	0.15	0	4	4	6
0.00	0.05	0.10	0.15	0	1	3	4
0.00	0.00	0.05	0.10	0	0	1	3

1.00	1.00	1.00	1.00	26	27	27	28
------	------	------	------	----	----	----	----

Recessed Linear Fluorescent						
2008 Basis of Design						
Lamp Type	Luminaire	Wattage	System Watts	LLD	Maintained Luminaire Lumens	LPW
T8	Lum. F	25	26	0.940	1,023	39
T8	Lum. F	32	33	0.940	1,403	43
T8	Lum. F	(2) 25	52	0.940	2,021	39
T8	Lum. F	(2) 32	66	0.940	2,558	39
T5	Lum. F	21	25	0.950	1,293	52
T5	Lum. F	28	31	0.950	1,768	57
T5	Lum. G	(2) 21	50	0.950	2,417	48
T5	Lum. H	(2) 28	62	0.950	2,560	41
T5HO	Lum. J	39	41	0.931	1,649	40
T5HO	Lum. H	54	62	0.930	2,972	48
T5HO	Lum. K	(2) 39	82	0.931	3,862	47
T5HO	Lum. K	(2) 54	124	0.930	5,540	45

Weighting				Weighted LPW			
LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
0.10	0.10	0.05	0.05	4	4	2	2
0.15	0.10	0.05	0.05	6	4	2	2
0.10	0.10	0.10	0.05	4	4	4	2
0.15	0.10	0.15	0.10	6	4	6	4
0.10	0.10	0.05	0.05	5	5	3	3
0.15	0.10	0.05	0.05	9	6	3	3
0.10	0.10	0.10	0.05	5	5	5	2
0.15	0.10	0.15	0.15	6	4	6	6
0.00	0.05	0.10	0.10	0	2	4	4
0.00	0.05	0.10	0.10	0	2	5	5
0.00	0.05	0.05	0.10	0	2	2	5
0.00	0.05	0.05	0.15	0	2	2	7

1.00	1.00	1.00	1.00	45	45	44	44
------	------	------	------	----	----	----	----

AVERAGE:

35	36	35	36
----	----	----	----

Figure 89: Sales Canopies Equivalency Calculation Pt. 2

Sales Canopy Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	10	611	60	0.05	0.00	0.00	0.00	3	0	0	0
LED	LED A	10	611	60	0.05	0.05	0.00	0.00	3	3	0	0
LED	LED A	10	611	60	0.05	0.05	0.05	0.00	3	3	3	0
LED	LED B	13	811	62	0.10	0.05	0.05	0.05	6	3	3	3
LED	LED C	20	1,320	66	0.10	0.10	0.05	0.05	7	7	3	3
LED	LED D	23	1,443	62	0.15	0.10	0.10	0.10	9	6	6	6
LED	LED D	26	1,710	66	0.15	0.10	0.10	0.10	10	7	7	7
LED	LED E	40	2,902	73	0.05	0.05	0.05	0.10	4	4	4	7
LED	LED F	22	1,519	68	0.15	0.05	0.05	0.05	10	3	3	3
LED	LED G	31	2,375	77	0.10	0.15	0.15	0.05	8	12	12	4
LED	LED H	39	3,525	90	0.05	0.15	0.15	0.10	4	13	13	9
LED	LED G	90	6,045	67	0.00	0.10	0.10	0.15	0	7	7	10
LED	LED G	90	6,045	67	0.00	0.05	0.10	0.15	0	3	7	10
LED	LED G	119	7,288	61	0.00	0.00	0.05	0.10	0	0	3	6
					1.00	1.00	1.00	1.00	67	71	71	69

2016 LED Equivalency					Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED J	18	1,135	65	0.10	0.10	0.05	0.05	6	6	3	3
LED	LED J	25	1,500	59	0.15	0.10	0.05	0.05	9	6	3	3
LED	LED K	25	1,502	61	0.10	0.10	0.10	0.05	6	6	6	3
LED	LED L	23	1,894	81	0.15	0.10	0.15	0.10	12	8	12	8
LED	LED J	18	1,135	65	0.10	0.10	0.05	0.05	6	6	3	3
LED	LED J	25	1,500	59	0.15	0.10	0.05	0.05	9	6	3	3
LED	LED K	25	1,502	61	0.10	0.10	0.10	0.05	6	6	6	3
LED	LED L	23	1,894	81	0.15	0.10	0.15	0.15	12	8	12	12
LED	LED M	16	1,202	73	0.00	0.05	0.10	0.10	0	4	7	7
LED	LED L	23	1,894	81	0.00	0.05	0.10	0.10	0	4	8	8
LED	LED K	49	3,004	61	0.00	0.05	0.05	0.10	0	3	3	6
LED	LED K	52	4,005	77	0.00	0.05	0.05	0.15	0	4	4	11
					1.00	1.00	1.00	1.00	67	68	71	72
AVERAGE:									67	69	71	70

Figure 90: Sales Canopies Cost Calculation Pt. 1

Sales Canopy Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Wattage	System Watts	Initial Cost	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
CFL	Lum. A	13	16	\$ 147	0.861	493	31	0.05	0.00	0.00	0.00	\$ 7	\$ -	\$ -	\$ -	1	0	0	0
CFL	Lum. A	18	20	\$ 176	0.860	763	38	0.05	0.05	0.00	0.00	\$ 9	\$ 9	\$ -	\$ -	1	1	0	0
CFL	Lum. B	26	29	\$ 636	0.860	851	29	0.05	0.05	0.05	0.00	\$ 32	\$ 32	\$ 32	\$ -	1	1	1	0
CFL	Lum. B	32	36	\$ 446	0.860	1,134	32	0.10	0.05	0.05	0.05	\$ 45	\$ 22	\$ 22	\$ 22	4	2	2	2
CFL	Lum. B	42	46	\$ 446	0.860	1,513	33	0.10	0.10	0.05	0.05	\$ 45	\$ 45	\$ 22	\$ 22	5	5	2	2
CFL	Lum. C	(3) 32	68	\$ 246	0.860	1,748	26	0.15	0.10	0.10	0.10	\$ 37	\$ 25	\$ 25	\$ 25	10	7	7	7
CFL	Lum. C	(2) 42	93	\$ 321	0.860	2,276	24	0.15	0.10	0.10	0.10	\$ 48	\$ 32	\$ 32	\$ 32	14	9	9	9
CFL	Lum. C	(2) 57	128	\$ 321	0.860	3,408	27	0.05	0.05	0.05	0.10	\$ 16	\$ 16	\$ 16	\$ 32	6	6	6	13
PSMH	Lum. D	50	67	\$ 483	0.464	1,022	15	0.15	0.05	0.05	0.05	\$ 72	\$ 24	\$ 24	\$ 24	10	3	3	3
PSMH	Lum. D	70	92	\$ 483	0.589	2,108	23	0.10	0.15	0.15	0.05	\$ 48	\$ 72	\$ 72	\$ 24	9	14	14	5
PSMH	Lum. D	100	129	\$ 506	0.550	2,986	23	0.05	0.15	0.15	0.10	\$ 25	\$ 76	\$ 76	\$ 51	6	19	19	13
PSMH	Lum. D	150	190	\$ 528	0.786	7,026	37	0.00	0.10	0.10	0.15	\$ -	\$ 53	\$ 53	\$ 79	0	19	19	29
PSMH	Lum. E	175	198	\$ 470	0.694	5,447	28	0.00	0.05	0.10	0.15	\$ -	\$ 23	\$ 47	\$ 70	0	10	20	30
PSMH	Lum. E	250	291	\$ 469	0.733	8,096	28	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 23	\$ 47	0	0	15	29
								1.00	1.00	1.00	1.00	\$ 384	\$ 429	\$ 445	\$ 429	68	97	118	141

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Wattage	System Watts	Initial Cost	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
T8	Lum. F	25	26	\$ 423	0.940	1,023	39	0.10	0.10	0.05	0.05	\$ 42	\$ 42	\$ 21	\$ 21	3	3	1	1
T8	Lum. F	32	33	\$ 423	0.940	1,403	43	0.15	0.10	0.05	0.05	\$ 63	\$ 42	\$ 21	\$ 21	5	3	2	2
T8	Lum. F	(2) 25	52	\$ 425	0.940	2,021	39	0.10	0.10	0.10	0.05	\$ 42	\$ 42	\$ 42	\$ 21	5	5	5	3
T8	Lum. F	(2) 32	66	\$ 425	0.940	2,558	39	0.15	0.10	0.15	0.10	\$ 64	\$ 42	\$ 64	\$ 42	10	7	10	7
T5	Lum. F	21	25	\$ 423	0.950	1,293	52	0.10	0.10	0.05	0.05	\$ 42	\$ 42	\$ 21	\$ 21	3	3	1	1
T5	Lum. F	28	31	\$ 423	0.950	1,768	57	0.15	0.10	0.05	0.05	\$ 63	\$ 42	\$ 21	\$ 21	5	3	2	2
T5	Lum. G	(2) 21	50	\$ 425	0.950	2,417	48	0.10	0.10	0.10	0.05	\$ 42	\$ 42	\$ 42	\$ 21	5	5	5	3
T5	Lum. H	(2) 28	62	\$ 425	0.950	2,560	41	0.15	0.10	0.15	0.15	\$ 64	\$ 42	\$ 64	\$ 64	9	6	9	9
T5HO	Lum. J	39	41	\$ 312	0.931	1,649	40	0.00	0.05	0.10	0.10	\$ -	\$ 16	\$ 31	\$ 31	0	2	4	4
T5HO	Lum. H	54	62	\$ 312	0.930	2,972	48	0.00	0.05	0.10	0.10	\$ -	\$ 16	\$ 31	\$ 31	0	3	6	6
T5HO	Lum. K	(2) 39	82	\$ 469	0.931	3,862	47	0.00	0.05	0.05	0.10	\$ -	\$ 23	\$ 23	\$ 47	0	4	4	8
T5HO	Lum. K	(2) 54	124	\$ 471	0.930	5,540	45	0.00	0.05	0.05	0.15	\$ -	\$ 24	\$ 24	\$ 71	0	6	6	19
								1.00	1.00	1.00	1.00	\$ 424	\$ 417	\$ 406	\$ 413	44	50	56	64
								AVERAGE:				\$ 412	\$ 421	\$ 418	\$ 418	56	73	87	103
								\$/W				\$ 7.37	\$ 5.74	\$ 4.81	\$ 4.08				

Figure 91: Sales Canopies Cost Calculation Pt. 2

Sales Canopy Calculations T-24 2016 - LED

2016 LED Equivalency						Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	2017 Cost	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	10	611	\$ 218	60	0.05	0.00	0.00	0.00	\$ 11	\$ -	\$ -	\$ -	1	0	0	0
LED	LED A	10	611	\$ 218	60	0.05	0.05	0.00	0.00	\$ 11	\$ 11	\$ -	\$ -	1	1	0	0
LED	LED A	10	611	\$ 218	60	0.05	0.05	0.05	0.00	\$ 11	\$ 11	\$ 11	\$ -	1	1	1	0
LED	LED B	13	811	\$ 230	62	0.10	0.05	0.05	0.05	\$ 23	\$ 12	\$ 12	\$ 12	1	1	1	1
LED	LED C	20	1,320	\$ 255	66	0.10	0.10	0.05	0.05	\$ 25	\$ 25	\$ 13	\$ 13	2	2	1	1
LED	LED D	23	1,443	\$ 255	62	0.15	0.10	0.10	0.10	\$ 38	\$ 25	\$ 25	\$ 25	3	2	2	2
LED	LED D	26	1,710	\$ 267	66	0.15	0.10	0.10	0.10	\$ 40	\$ 27	\$ 27	\$ 27	4	3	3	3
LED	LED E	40	2,902	\$ 638	73	0.05	0.05	0.05	0.10	\$ 32	\$ 32	\$ 32	\$ 64	2	2	2	4
LED	LED F	22	1,519	\$ 267	68	0.15	0.05	0.05	0.05	\$ 40	\$ 13	\$ 13	\$ 13	3	1	1	1
LED	LED G	31	2,375	\$ 606	77	0.10	0.15	0.15	0.05	\$ 61	\$ 91	\$ 91	\$ 30	3	5	5	2
LED	LED H	39	3,525	\$ 392	90	0.05	0.15	0.15	0.10	\$ 20	\$ 59	\$ 59	\$ 39	2	6	6	4
LED	LED G	90	6,045	\$ 1,019	67	0.00	0.10	0.10	0.15	\$ -	\$ 102	\$ 102	\$ 153	0	9	9	14
LED	LED G	90	6,045	\$ 1,019	67	0.00	0.05	0.10	0.15	\$ -	\$ 51	\$ 102	\$ 153	0	5	9	14
LED	LED G	119	7,288	\$ 1,247	61	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 62	\$ 125	0	0	6	12
						1.00	1.00	1.00	1.00	\$ 312	\$ 459	\$ 548	\$ 654	23	36	45	56

2016 LED Equivalency						Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	2017 Cost	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED J	18	1,135	\$ 316	65	0.10	0.10	0.05	0.05	\$ 32	\$ 32	\$ 16	\$ 16	2	2	1	1
LED	LED J	25	1,500	\$ 396	59	0.15	0.10	0.05	0.05	\$ 59	\$ 40	\$ 20	\$ 20	4	3	1	1
LED	LED K	25	1,502	\$ 585	61	0.10	0.10	0.10	0.05	\$ 59	\$ 59	\$ 59	\$ 29	2	2	2	1
LED	LED L	23	1,894	\$ 488	81	0.15	0.10	0.15	0.10	\$ 73	\$ 49	\$ 73	\$ 49	4	2	4	2
LED	LED J	18	1,135	\$ 316	65	0.10	0.10	0.05	0.05	\$ 32	\$ 32	\$ 16	\$ 16	2	2	1	1
LED	LED J	25	1,500	\$ 396	59	0.15	0.10	0.05	0.05	\$ 59	\$ 40	\$ 20	\$ 20	4	3	1	1
LED	LED K	25	1,502	\$ 585	61	0.10	0.10	0.10	0.05	\$ 59	\$ 59	\$ 59	\$ 29	2	2	2	1
LED	LED L	23	1,894	\$ 488	81	0.15	0.10	0.15	0.15	\$ 73	\$ 49	\$ 73	\$ 73	4	2	4	4
LED	LED M	16	1,202	\$ 442	73	0.00	0.05	0.10	0.10	\$ -	\$ 22	\$ 44	\$ 44	0	1	2	2
LED	LED L	23	1,894	\$ 488	81	0.00	0.05	0.10	0.10	\$ -	\$ 24	\$ 49	\$ 49	0	1	2	2
LED	LED K	49	3,004	\$ 711	61	0.00	0.05	0.05	0.10	\$ -	\$ 36	\$ 36	\$ 71	0	2	2	5
LED	LED K	52	4,005	\$ 761	77	0.00	0.05	0.05	0.15	\$ -	\$ 38	\$ 38	\$ 114	0	3	3	8
						1.00	1.00	1.00	1.00	\$ 446	\$ 477	\$ 501	\$ 530	23	25	25	29
AVERAGE:										\$ 352	\$ 464	\$ 534	\$ 617	23	31	35	43
\$/W										\$ 15.42	\$ 15.22	\$ 15.26	\$ 14.42				

Figure 92: Non-Sales Canopies Calculation Results and Recommendations

Non-Sales Canopies Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	0.084	0.205	0.408	0.585	W/sf
	LPW	45	44	44	43	lm/W
2016	LPW	69	70	73	75	lm/W
	Change	0.054	0.130	0.247	0.336	Limit of Reduction
	Proposed	0.080	0.160	0.300	0.400	W/sf

Figure 93: Non-Sales Canopies Lumen Equivalency Calculation Pt. 1

Non Sales Canopy Calculations T-24 2016 - Incumbent Lamps

Downlight

2008 Basis of Design							Weighting				Weighted LPW			
Lamp Type	Luminaire	Wattage	System Watts	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
CFL	Lum. A	13	16	0.861	493	31	0.20	0.15	0.10	0.05	6	5	3	2
CFL	Lum. A	18	20	0.860	763	38	0.20	0.20	0.15	0.05	8	8	6	2
CFL	Lum. B	26	29	0.860	851	29	0.20	0.20	0.15	0.10	6	6	4	3
CFL	Lum. B	32	36	0.860	1,134	32	0.10	0.10	0.15	0.15	3	3	5	5
CFL	Lum. B	42	46	0.860	1,513	33	0.05	0.10	0.15	0.20	2	3	5	7
PSMH	Lum. B	50	67	0.464	1,022	15	0.10	0.05	0.05	0.05	2	1	1	1
PSMH	Lum. B	70	92	0.589	2,108	23	0.10	0.05	0.10	0.10	2	1	2	2
PSMH	Lum. B	100	129	0.550	2,986	23	0.05	0.10	0.10	0.15	1	2	2	3
PSMH	Lum. B	150	190	0.786	7,026	37	0.00	0.05	0.05	0.15	0	2	2	6
							1.00	1.00	1.00	1.00	29	31	30	30

Recessed Linear Fluorescent

2008 Basis of Design							Weighting				Weighted LPW			
Lamp Type	Luminaire	Wattage	System Watts	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
T8	Lum. C	25	26	0.940	1,023	39	0.05	0.05	0.05	0.05	2	2	2	2
T8	Lum. C	32	33	0.940	1,403	43	0.20	0.15	0.15	0.10	9	6	6	4
T8	Lum. C	(2) 25	52	0.940	2,021	39	0.05	0.10	0.05	0.05	2	4	2	2
T8	Lum. C	(2) 32	66	0.940	2,558	39	0.20	0.20	0.20	0.15	8	8	8	6
T5	Lum. C	21	25	0.950	1,293	52	0.05	0.05	0.05	0.05	3	3	3	3
T5	Lum. C	28	31	0.950	1,768	57	0.20	0.15	0.15	0.10	11	9	9	6
T5	Lum. D	(2) 21	50	0.950	2,417	48	0.05	0.10	0.05	0.05	2	5	2	2
T5	Lum. C	(2) 28	62	0.950	2,560	41	0.20	0.20	0.20	0.15	8	8	8	6
T5HO	Lum. E	39	41	0.931	1,649	40	0.00	0.00	0.05	0.05	0	0	2	2
T5HO	Lum. C	54	62	0.930	2,972	48	0.00	0.00	0.05	0.10	0	0	2	5
T5HO	Lum. F	(2) 39	82	0.931	3,862	47	0.00	0.00	0.00	0.05	0	0	0	2
T5HO	Lum. F	(2) 54	124	0.930	5,540	45	0.00	0.00	0.00	0.10	0	0	0	4
							1.00	1.00	1.00	1.00	45	44	44	45

Gasket Linear Fluorescent

2008 Basis of Design							Weighting				Weighted LPW			
Lamp Type	Luminaire	Wattage	System Watts	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
T8	Lum. G	17	19	0.940	954	50	0.05	0.05	0.05	0.05	3	3	3	3
T8	Lum. G	32	33	0.940	2,084	63	0.20	0.15	0.15	0.10	13	9	9	6
T8	Lum. G	(2) 17	38	0.940	1,907	50	0.05	0.10	0.05	0.05	3	5	3	3
T8	Lum. G	(2) 32	66	0.940	4,167	63	0.20	0.20	0.20	0.15	13	13	13	9
T5	Lum. G	14	17	0.950	856	50	0.05	0.05	0.05	0.05	3	3	3	3
T5	Lum. G	28	31	0.950	1,856	60	0.20	0.15	0.15	0.10	12	9	9	6
T5	Lum. G	(2) 14	34	0.950	1,713	50	0.05	0.10	0.05	0.05	3	5	3	3
T5	Lum. G	(2) 28	62	0.950	3,712	60	0.20	0.20	0.20	0.15	12	12	12	9
T5HO	Lum. G	24	27	0.872	1,277	47	0.00	0.00	0.05	0.05	0	0	2	2
T5HO	Lum. G	54	62	0.930	3,109	50	0.00	0.00	0.05	0.10	0	0	3	5
T5HO	Lum. G	(2) 24	54	0.872	2,554	47	0.00	0.00	0.00	0.05	0	0	0	2
T5HO	Lum. G	(2) 54	124	0.930	6,218	50	0.00	0.00	0.00	0.10	0	0	0	5
							1.00	1.00	1.00	1.00	59	58	58	56

AVERAGE: 45 44 44 43

Figure 94: Non-Sales Canopies Equivalency Calculation Pt. 2

Non Sales Canopy Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	10	611	60	0.20	0.15	0.10	0.05	12	9	6	3
LED	LED A	10	611	60	0.20	0.20	0.15	0.05	12	12	9	3
LED	LED A	10	611	60	0.20	0.20	0.15	0.10	12	12	9	6
LED	LED B	13	811	62	0.10	0.10	0.15	0.15	6	6	9	9
LED	LED C	20	1,320	66	0.05	0.10	0.15	0.20	3	7	10	13
LED	LED D	22	1,519	68	0.10	0.05	0.05	0.05	7	3	3	3
LED	LED E	35	2,202	63	0.10	0.05	0.10	0.10	6	3	6	6
LED	LED F	39	3,525	90	0.05	0.10	0.10	0.15	4	9	9	13
LED	LED G	90	6,045	67	0.00	0.05	0.05	0.15	0	3	3	10
					1.00	1.00	1.00	1.00	63	65	65	68

2016 LED Equivalency					Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED H	18	1,135	65	0.05	0.05	0.05	0.05	3	3	3	3
LED	LED H	25	1,500	59	0.20	0.15	0.15	0.10	12	9	9	6
LED	LED J	25	1,502	61	0.05	0.10	0.05	0.05	3	6	3	3
LED	LED K	23	1,894	81	0.20	0.20	0.20	0.15	16	16	16	12
LED	LED H	18	1,135	65	0.05	0.05	0.05	0.05	3	3	3	3
LED	LED H	25	1,500	59	0.20	0.15	0.15	0.10	12	9	9	6
LED	LED J	25	1,502	61	0.05	0.10	0.05	0.05	3	6	3	3
LED	LED K	23	1,894	81	0.20	0.20	0.20	0.15	16	16	16	12
LED	LED L	16	2,919	177	0.00	0.00	0.05	0.05	0	0	9	9
LED	LED K	23	1,894	81	0.00	0.00	0.05	0.10	0	0	4	8
LED	LED J	49	3,004	61	0.00	0.00	0.00	0.05	0	0	0	3
LED	LED J	52	4,005	77	0.00	0.00	0.00	0.10	0	0	0	8
					1.00	1.00	1.00	1.00	69	69	76	76

2016 LED Equivalency					Weighting				Weighted LPW			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED M	22	1,457	66	0.05	0.05	0.05	0.05	3	3	3	3
LED	LED M	21	1,562	73	0.20	0.15	0.15	0.10	15	11	11	7
LED	LED M	22	1,457	66	0.05	0.10	0.05	0.05	3	7	3	3
LED	LED N	43	3,797	88	0.20	0.20	0.20	0.15	18	18	18	13
LED	LED M	22	1,457	66	0.05	0.05	0.05	0.05	3	3	3	3
LED	LED M	21	1,562	73	0.20	0.15	0.15	0.10	15	11	11	7
LED	LED M	22	1,457	66	0.05	0.10	0.05	0.05	3	7	3	3
LED	LED P	42	3,443	82	0.20	0.20	0.20	0.15	16	16	16	12
LED	LED M	22	1,457	66	0.00	0.00	0.05	0.05	0	0	3	3
LED	LED N	27	2,776	102	0.00	0.00	0.05	0.10	0	0	5	10
LED	LED P	28	2,766	98	0.00	0.00	0.00	0.05	0	0	0	5
LED	LED P	56	4,580	82	0.00	0.00	0.00	0.10	0	0	0	8
					1.00	1.00	1.00	1.00	77	76	78	80

AVERAGE: 69 70 73 75

Figure 95: Non-Sales Canopies Cost Calculation Pt. 1

Non Sales Canopy Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Wattage	System Watts	Cost	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
CFL	Lum. A	13	16	\$ 147	0.861	493	31	0.20	0.15	0.10	0.05	\$ 29	\$ 22	\$ 15	\$ 7	3	2	2	1
CFL	Lum. A	18	20	\$ 176	0.860	763	38	0.20	0.20	0.15	0.05	\$ 35	\$ 35	\$ 26	\$ 9	4	4	3	1
CFL	Lum. B	26	29	\$ 636	0.860	851	29	0.20	0.20	0.15	0.10	\$ 127	\$ 127	\$ 95	\$ 64	6	6	4	3
CFL	Lum. B	32	36	\$ 446	0.860	1,134	32	0.10	0.10	0.15	0.15	\$ 45	\$ 45	\$ 67	\$ 67	4	4	5	5
CFL	Lum. B	42	46	\$ 446	0.860	1,513	33	0.05	0.10	0.15	0.20	\$ 22	\$ 45	\$ 67	\$ 89	2	5	7	9
PSMH	Lum. B	50	67	\$ 483	0.464	1,022	15	0.10	0.05	0.05	0.05	\$ 48	\$ 24	\$ 24	\$ 24	7	3	3	3
PSMH	Lum. B	70	92	\$ 483	0.589	2,108	23	0.10	0.05	0.10	0.10	\$ 48	\$ 24	\$ 48	\$ 48	9	5	9	9
PSMH	Lum. B	100	129	\$ 506	0.550	2,986	23	0.05	0.10	0.10	0.15	\$ 25	\$ 51	\$ 51	\$ 76	6	13	13	19
PSMH	Lum. B	150	190	\$ 528	0.786	7,026	37	0.00	0.05	0.05	0.15	\$ -	\$ 26	\$ 26	\$ 79	0	10	10	29
								1.00	1.00	1.00	1.00	\$ 381	\$ 399	\$ 420	\$ 463	41	51	56	80

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	Wattage	System Watts	Cost	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
T8	Lum. C	25	26	\$ 423	0.940	1,023	39	0.05	0.05	0.05	0.05	\$ 21	\$ 21	\$ 21	\$ 21	1	1	1	1
T8	Lum. C	32	33	\$ 423	0.940	1,403	43	0.20	0.15	0.15	0.10	\$ 85	\$ 63	\$ 63	\$ 42	7	5	5	3
T8	Lum. C	(2) 25	52	\$ 425	0.940	2,021	39	0.05	0.10	0.05	0.05	\$ 21	\$ 42	\$ 21	\$ 21	3	5	3	3
T8	Lum. C	(2) 32	66	\$ 425	0.940	2,558	39	0.20	0.20	0.20	0.15	\$ 85	\$ 85	\$ 85	\$ 64	13	13	13	10
T5	Lum. C	21	25	\$ 423	0.950	1,293	52	0.05	0.05	0.05	0.05	\$ 21	\$ 21	\$ 21	\$ 21	1	1	1	1
T5	Lum. C	28	31	\$ 423	0.950	1,768	57	0.20	0.15	0.15	0.10	\$ 85	\$ 63	\$ 63	\$ 42	6	5	5	3
T5	Lum. D	(2) 21	50	\$ 425	0.950	2,417	48	0.05	0.10	0.05	0.05	\$ 21	\$ 42	\$ 21	\$ 21	3	5	3	3
T5	Lum. C	(2) 28	62	\$ 425	0.950	2,560	41	0.20	0.20	0.20	0.15	\$ 85	\$ 85	\$ 85	\$ 64	12	12	12	9
T5HO	Lum. E	39	41	\$ 312	0.931	1,649	40	0.00	0.00	0.05	0.05	\$ -	\$ -	\$ 16	\$ 16	0	0	2	2
T5HO	Lum. C	54	62	\$ 312	0.930	2,972	48	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 16	\$ 31	0	0	3	6
T5HO	Lum. F	(2) 39	82	\$ 469	0.931	3,862	47	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 23	0	0	0	4
T5HO	Lum. F	(2) 54	124	\$ 471	0.930	5,540	45	0.00	0.00	0.00	0.10	\$ -	\$ -	\$ -	\$ 47	0	0	0	12
								1.00	1.00	1.00	1.00	\$ 424	\$ 424	\$ 413	\$ 414	46	48	48	58

2008 Basis of Design								Weighting				Weighted LPW				Weighted W				
Lamp Type	Luminaire	Wattage	System Watts	Cost	LLD	Maintained Luminaire Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	
T8	Lum. G	17	19	\$ 96	0.940	954	50	0.05	0.05	0.05	0.05	\$ 5	\$ 5	\$ 5	\$ 5	1	1	1	1	
T8	Lum. G	32	33	\$ 133	0.940	2,084	63	0.20	0.15	0.15	0.10	\$ 27	\$ 20	\$ 20	\$ 13	7	5	5	3	
T8	Lum. G	(2) 17	38	\$ 147	0.940	1,907	50	0.05	0.10	0.05	0.05	\$ 7	\$ 15	\$ 7	\$ 7	2	4	2	2	
T8	Lum. G	(2) 32	66	\$ 138	0.940	4,167	63	0.20	0.20	0.20	0.15	\$ 28	\$ 28	\$ 28	\$ 21	13	13	13	10	
T5	Lum. G	14	17	\$ 161	0.950	856	50	0.05	0.05	0.05	0.05	\$ 8	\$ 8	\$ 8	\$ 8	1	1	1	1	
T5	Lum. G	28	31	\$ 161	0.950	1,856	60	0.20	0.15	0.15	0.10	\$ 32	\$ 24	\$ 24	\$ 16	6	5	5	3	
T5	Lum. G	(2) 14	34	\$ 171	0.950	1,713	50	0.05	0.10	0.05	0.05	\$ 9	\$ 17	\$ 9	\$ 9	2	3	2	2	
T5	Lum. G	(2) 28	62	\$ 171	0.950	3,712	60	0.20	0.20	0.20	0.15	\$ 34	\$ 34	\$ 34	\$ 26	12	12	12	9	
T5HO	Lum. G	24	27	\$ 161	0.872	1,277	47	0.00	0.00	0.05	0.05	\$ -	\$ -	\$ 8	\$ 8	0	0	1	1	
T5HO	Lum. G	54	62	\$ 161	0.930	3,109	50	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ -	\$ 8	\$ 16	0	0	3	6
T5HO	Lum. G	(2) 24	54	\$ 170	0.872	2,554	47	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 8	0	0	0	3	
T5HO	Lum. G	(2) 54	124	\$ 170	0.930	6,218	50	0.00	0.00	0.00	0.10	\$ -	\$ -	\$ -	\$ 17	0	0	0	12	
								1.00	1.00	1.00	1.00	\$ 149	\$ 151	\$ 151	\$ 154	44	44	45	54	

AVERAGE: \$ 318 \$ 325 \$ 328 \$ 344 44 48 50 64

\$/W: \$7.28 \$6.81 \$6.59 \$5.39

Figure 96: Non-Sales Canopies Cost Calculation Pt. 2

Non Sales Canopy Calculations T-24 2016 - LED

2016 LED Equivalency							Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	2017 Cost	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	10	611	\$ 218	0.700	60	0.20	0.15	0.10	0.05	\$ 44	\$ 33	\$ 22	\$ 11	2	2	1	1
LED	LED A	10	611	\$ 218	0.700	60	0.20	0.20	0.15	0.05	\$ 44	\$ 44	\$ 33	\$ 11	2	2	2	1
LED	LED A	10	611	\$ 218	0.700	60	0.20	0.20	0.15	0.10	\$ 44	\$ 44	\$ 33	\$ 22	2	2	2	1
LED	LED B	13	811	\$ 230	0.700	62	0.10	0.10	0.15	0.15	\$ 23	\$ 23	\$ 35	\$ 35	1	1	2	2
LED	LED C	20	1,320	\$ 255	0.700	66	0.05	0.10	0.15	0.20	\$ 13	\$ 25	\$ 38	\$ 51	1	2	3	4
LED	LED D	22	1,519	\$ 267	0.700	68	0.10	0.05	0.05	0.05	\$ 27	\$ 13	\$ 13	\$ 13	2	1	1	1
LED	LED E	35	2,202	\$ 267	0.700	63	0.10	0.05	0.10	0.10	\$ 27	\$ 13	\$ 27	\$ 27	3	2	3	3
LED	LED F	39	3,525	\$ 392	0.700	90	0.05	0.10	0.10	0.15	\$ 20	\$ 39	\$ 39	\$ 59	2	4	4	6
LED	LED G	90	6,045	\$ 1,019	0.700	67	0.00	0.05	0.05	0.15	\$ -	\$ 51	\$ 51	\$ 153	0	5	5	14
							1.00	1.00	1.00	1.00	\$ 239	\$ 285	\$ 290	\$ 381	16	20	22	32

2016 LED Equivalency							Weighting				Weighted Cost				Weighted W			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	2017 Cost	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED H	18	1,135	\$ 316	0.700	65	0.05	0.05	0.05	0.05	\$ 16	\$ 16	\$ 16	\$ 16	1	1	1	1
LED	LED H	25	1,500	\$ 396	0.700	59	0.20	0.15	0.15	0.10	\$ 79	\$ 59	\$ 59	\$ 40	5	4	4	3
LED	LED J	25	1,502	\$ 585	0.700	61	0.05	0.10	0.05	0.05	\$ 29	\$ 59	\$ 29	\$ 29	1	2	1	1
LED	LED K	23	1,894	\$ 488	0.700	81	0.20	0.20	0.20	0.15	\$ 98	\$ 98	\$ 98	\$ 73	5	5	5	4
LED	LED H	18	1,135	\$ 316	0.700	65	0.05	0.05	0.05	0.05	\$ 16	\$ 16	\$ 16	\$ 16	1	1	1	1
LED	LED H	25	1,500	\$ 396	0.700	59	0.20	0.15	0.15	0.10	\$ 79	\$ 59	\$ 59	\$ 40	5	4	4	3
LED	LED J	25	1,502	\$ 585	0.700	61	0.05	0.10	0.05	0.05	\$ 29	\$ 59	\$ 29	\$ 29	1	2	1	1
LED	LED K	23	1,894	\$ 488	0.700	81	0.20	0.20	0.20	0.15	\$ 98	\$ 98	\$ 98	\$ 73	5	5	5	4
LED	LED L	16	2,919	\$ 442	1.700	177	0.00	0.00	0.05	0.05	\$ -	\$ -	\$ 22	\$ 22	0	0	1	1
LED	LED K	23	1,894	\$ 488	0.700	81	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 24	\$ 49	0	0	1	2
LED	LED J	49	3,004	\$ 711	0.700	61	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 36	0	0	0	2
LED	LED J	52	4,005	\$ 761	0.700	77	0.00	0.00	0.00	0.10	\$ -	\$ -	\$ -	\$ 76	0	0	0	5
							1.00	1.00	1.00	1.00	\$ 444	\$ 463	\$ 451	\$ 498	24	24	23	27

2016 LED Equivalency							Weighting				Weighted LPW				Weighted W			
Lamp Type	Luminaire	2017 Fixture Watts	Maintained Luminaire Lumens	2017 Cost	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED M	22	1,457	\$ 238	0.700	66	0.05	0.05	0.05	0.05	\$ 12	\$ 12	\$ 12	\$ 12	1	1	1	1
LED	LED M	21	1,562	\$ 291	0.700	73	0.20	0.15	0.15	0.10	\$ 58	\$ 44	\$ 44	\$ 29	4	3	3	2
LED	LED M	22	1,457	\$ 238	0.700	66	0.05	0.10	0.05	0.05	\$ 12	\$ 24	\$ 12	\$ 12	1	2	1	1
LED	LED N	43	3,797	\$ 433	0.800	88	0.20	0.20	0.20	0.15	\$ 87	\$ 87	\$ 87	\$ 65	9	9	9	6
LED	LED M	22	1,457	\$ 238	0.700	66	0.05	0.05	0.05	0.05	\$ 12	\$ 12	\$ 12	\$ 12	1	1	1	1
LED	LED M	21	1,562	\$ 291	0.700	73	0.20	0.15	0.15	0.10	\$ 58	\$ 44	\$ 44	\$ 29	4	3	3	2
LED	LED M	22	1,457	\$ 238	0.700	66	0.05	0.10	0.05	0.05	\$ 12	\$ 24	\$ 12	\$ 12	1	2	1	1
LED	LED P	42	3,443	\$ 498	0.850	82	0.20	0.20	0.20	0.15	\$ 100	\$ 100	\$ 100	\$ 75	8	8	8	6
LED	LED M	22	1,457	\$ 238	0.700	66	0.00	0.00	0.05	0.05	\$ -	\$ -	\$ 12	\$ 12	0	0	1	1
LED	LED N	27	2,776	\$ 433	0.800	102	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 22	\$ 43	0	0	1	3
LED	LED P	28	2,766	\$ 544	0.930	98	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 27	0	0	0	1
LED	LED P	56	4,580	\$ 544	0.800	82	0.00	0.00	0.00	0.10	\$ -	\$ -	\$ -	\$ 54	0	0	0	6
							1.00	1.00	1.00	1.00	\$ 351	\$ 345	\$ 355	\$ 382	30	30	30	32
AVERAGE:											\$ 345	\$ 364	\$ 365	\$ 421	23	25	25	30
											\$14.83	\$14.80	\$14.52	\$13.80				

Figure 97: Guard Station Calculation Results and Recommendations

Guard Station Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	0.154	0.355	0.708	0.985	W
	LPW	31	30	28	29	lm/W
2016	LPW	77	80	83	86	lm/W
	Change	0.062	0.133	0.240	0.329	Limit of Reduction
	Proposed	0.100	0.300	0.500	0.750	W/sf

Figure 98: Guard Station Lumen Equivalency Calculation Pt. 1

Guard Station Calculations T-24 2016 - Incumbent Lamps

Wall Pack														
2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
26	CFL	Lum. A	27	710	0.860	26	0.20	0.10	0.05	0.05	5	3	1	1
32	CFL	Lum. A	36	947	0.860	26	0.25	0.15	0.05	0.05	7	4	1	1
42	CFL	Lum. A	47	1,262	0.860	27	0.25	0.20	0.10	0.05	7	5	3	1
70	PSMH	Lum. A	90	1,509	0.589	17	0.15	0.25	0.25	0.15	3	4	4	3
100	PSMH	Lum. A	129	2,138	0.550	17	0.10	0.15	0.25	0.20	2	2	4	3
150	PSMH	Lum. A	190	5,029	0.786	26	0.05	0.10	0.15	0.20	1	3	4	5
175	PSMH	Lum. B	198	4,944	0.648	25	0.00	0.05	0.10	0.20	0	1	2	5
250	PSMH	Lum. B	291	6,552	0.611	23	0.00	0.00	0.05	0.10	0	0	1	2
							1.00	1.00	1.00	1.00	24	23	21	22
Area														
2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
18	CFL	Lum. C	19	690	0.861	36	0.05	0.05	0.00	0.00	2	2	0	0
26	CFL	Lum. C	27	1,026	0.860	38	0.20	0.10	0.05	0.05	8	4	2	2
32	CFL	Lum. C	36	1,440	0.860	40	0.20	0.15	0.05	0.05	8	6	2	2
42	CFL	Lum. C	47	1,920	0.860	41	0.25	0.20	0.10	0.05	10	8	4	2
70	PSMH	Lum. D	90	1,984	0.589	22	0.15	0.20	0.25	0.15	3	4	6	3
100	PSMH	Lum. D	129	2,809	0.550	22	0.10	0.15	0.25	0.20	2	3	5	4
150	PSMH	Lum. D	190	6,558	0.786	35	0.05	0.10	0.15	0.20	2	3	5	7
175	PSMH	Lum. D	198	5,053	0.648	26	0.00	0.05	0.10	0.20	0	1	3	5
250	PSMH	Lum. D	291	6,697	0.611	23	0.00	0.00	0.05	0.10	0	0	1	2
							1.00	1.00	1.00	1.00	35	32	28	28
Pole Mounted Flood														
2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
70	PSMH	Lum. E	90	2,769	0.589	31	0.30	0.25	0.15	0.10	9	8	5	3
100	PSMH	Lum. E	129	3,923	0.550	30	0.25	0.25	0.15	0.15	8	8	5	5
150	PSMH	Lum. E	190	9,229	0.786	49	0.20	0.20	0.20	0.20	10	10	10	10
175	PSMH	Lum. E	198	6,964	0.648	35	0.15	0.15	0.25	0.25	5	5	9	9
250	PSMH	Lum. E	291	9,230	0.611	32	0.10	0.15	0.25	0.30	3	5	8	10
							1.00	1.00	1.00	1.00	35	35	36	36
AVERAGE:											31	30	28	29

Figure 99: Guard Station Lumen Equivalency Calculation Pt. 2

Guard Station Calculations T-24 2016 - LED

2016 LED Equivalency						Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	514	0.700	9	6	81	0.20	0.10	0.05	0.05	16	8	4	4
LED A	895	0.700	16	11	78	0.25	0.15	0.05	0.05	19	12	4	4
LED B	1,373	0.958	18	13	108	0.25	0.20	0.10	0.05	27	22	11	5
LED B	2,341	0.903	38	27	87	0.15	0.25	0.25	0.15	13	22	22	13
LED C	2,733	0.700	50	35	77	0.10	0.15	0.25	0.20	8	12	19	15
LED D	5,312	0.887	71	50	106	0.05	0.10	0.15	0.20	5	11	16	21
LED D	6,645	0.887	87	61	108	0.00	0.05	0.10	0.20	0	5	11	22
LED E	9,622	0.946	110	78	123	0.00	0.00	0.05	0.10	0	0	6	12
						1.00	1.00	1.00	1.00	89	91	93	97

2016 LED Equivalency						Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	852	0.768	30	21	40	0.05	0.05	0.00	0.00	2	2	0	0
LED F	852	0.768	30	21	40	0.20	0.10	0.05	0.05	8	4	2	2
LED G	1,172	0.700	27	19	61	0.20	0.15	0.05	0.05	12	9	3	3
LED G	1,441	0.700	27	19	75	0.25	0.20	0.10	0.05	19	15	8	4
LED G	2,261	0.700	54	38	59	0.15	0.20	0.25	0.15	9	12	15	9
LED H	3,331	0.700	53	37	89	0.10	0.15	0.25	0.20	9	13	22	18
LED H	5,965	0.700	107	76	79	0.05	0.10	0.15	0.20	4	8	12	16
LED H	5,391	0.700	84	60	90	0.00	0.05	0.10	0.20	0	5	9	18
LED H	7,662	0.700	128	90	85	0.00	0.00	0.05	0.10	0	0	4	8
						1.00	1.00	1.00	1.00	63	68	75	78

2016 LED Equivalency						Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED J	2,946	0.700	45	32	92	0.30	0.25	0.15	0.10	28	23	14	9
LED J	4,613	0.700	94	67	69	0.25	0.25	0.15	0.15	17	17	10	10
LED K	9,058	0.700	179	127	71	0.20	0.20	0.20	0.20	14	14	14	14
LED K	7,294	0.700	149	106	69	0.15	0.15	0.25	0.25	10	10	17	17
LED L	12,700	0.858	170	121	105	0.10	0.15	0.25	0.30	11	16	26	32
						1.00	1.00	1.00	1.00	80	81	82	83
AVERAGE:										77	80	83	86

Figure 100: Guard Station Cost Calculation Pt. 1

Guard Station Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
26	CFL	Lum. A	27	\$ 365	710	0.860	26	0.20	0.10	0.05	0.05	\$ 73	\$ 36	\$ 18	\$ 18	5	3	1	1
32	CFL	Lum. A	36	\$ 368	947	0.860	26	0.25	0.15	0.05	0.05	\$ 92	\$ 55	\$ 18	\$ 18	9	5	2	2
42	CFL	Lum. A	47	\$ 368	1,262	0.860	27	0.25	0.20	0.10	0.05	\$ 92	\$ 74	\$ 37	\$ 18	12	9	5	2
70	PSMH	Lum. A	90	\$ 377	1,509	0.589	17	0.15	0.25	0.25	0.15	\$ 57	\$ 94	\$ 94	\$ 57	14	23	23	14
100	PSMH	Lum. A	129	\$ 382	2,138	0.550	17	0.10	0.15	0.25	0.20	\$ 38	\$ 57	\$ 96	\$ 76	13	19	32	26
150	PSMH	Lum. A	190	\$ 393	5,029	0.786	26	0.05	0.10	0.15	0.20	\$ 20	\$ 39	\$ 59	\$ 79	10	19	29	38
175	PSMH	Lum. B	198	\$ 974	4,944	0.648	25	0.00	0.05	0.10	0.20	\$ -	\$ 49	\$ 97	\$ 195	0	10	20	40
250	PSMH	Lum. B	291	\$1,229	6,552	0.611	23	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 61	\$ 123	0	0	15	29
								1.00	1.00	1.00	1.00	\$ 372	\$ 405	\$ 481	\$ 584	62	88	125	152

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
18	CFL	Lum. C	19	\$ 600	690	0.861	36	0.05	0.05	0.00	0.00	\$ 30	\$ 30	\$ -	\$ -	1	1	0	0
26	CFL	Lum. C	27	\$ 600	1,026	0.860	38	0.20	0.10	0.05	0.05	\$ 120	\$ 60	\$ 30	\$ 30	5	3	1	1
32	CFL	Lum. C	36	\$ 600	1,440	0.860	40	0.20	0.15	0.05	0.05	\$ 120	\$ 90	\$ 30	\$ 30	7	5	2	2
42	CFL	Lum. C	47	\$ 600	1,920	0.860	41	0.25	0.20	0.10	0.05	\$ 150	\$ 120	\$ 60	\$ 30	12	9	5	2
70	PSMH	Lum. D	90	\$1,035	1,984	0.589	22	0.15	0.20	0.25	0.15	\$ 155	\$ 207	\$ 259	\$ 155	14	18	23	14
100	PSMH	Lum. D	129	\$1,035	2,809	0.550	22	0.10	0.15	0.25	0.20	\$ 104	\$ 155	\$ 259	\$ 207	13	19	32	26
150	PSMH	Lum. D	190	\$1,035	6,558	0.786	35	0.05	0.10	0.15	0.20	\$ 52	\$ 104	\$ 155	\$ 207	10	19	29	38
175	PSMH	Lum. D	198	\$1,235	5,053	0.648	26	0.00	0.05	0.10	0.20	\$ -	\$ 62	\$ 123	\$ 247	0	10	20	40
250	PSMH	Lum. D	291	\$1,235	6,697	0.611	23	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 62	\$ 123	0	0	15	29
								1.00	1.00	1.00	1.00	\$ 731	\$ 828	\$ 978	\$1,030	61	85	125	152

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
70	PSMH	Lum. E	90	\$ 335	2,769	0.589	31	0.30	0.25	0.15	0.10	\$ 101	\$ 84	\$ 50	\$ 34	27	23	14	9
100	PSMH	Lum. E	129	\$ 355	3,923	0.550	30	0.25	0.25	0.15	0.15	\$ 89	\$ 89	\$ 53	\$ 53	32	32	19	19
150	PSMH	Lum. E	190	\$ 358	9,229	0.786	49	0.20	0.20	0.20	0.20	\$ 72	\$ 72	\$ 72	\$ 72	38	38	38	38
175	PSMH	Lum. E	198	\$ 358	6,964	0.648	35	0.15	0.15	0.25	0.25	\$ 54	\$ 54	\$ 89	\$ 89	30	30	50	50
250	PSMH	Lum. E	291	\$ 358	9,230	0.611	32	0.10	0.15	0.25	0.30	\$ 36	\$ 54	\$ 89	\$ 107	29	44	73	87
								1.00	1.00	1.00	1.00	\$ 350	\$ 352	\$ 354	\$ 355	156	166	193	203
AVERAGE:												\$ 484	\$ 528	\$ 605	\$ 657	93	113	148	169
\$/W												\$5.20	\$4.67	\$4.08	\$ 3.89				

Figure 101: Guard Station Cost Calculation Pt. 2

Guard Station Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	514	\$ 207	6	81	0.20	0.10	0.05	0.05	\$ 41	\$ 21	\$ 10	\$ 10	1	1	0	0
LED A	895	\$ 237	11	78	0.25	0.15	0.05	0.05	\$ 59	\$ 36	\$ 12	\$ 12	3	2	1	1
LED B	1,373	\$ 428	13	108	0.25	0.20	0.10	0.05	\$ 107	\$ 86	\$ 43	\$ 21	3	3	1	1
LED B	2,341	\$ 428	27	87	0.15	0.25	0.25	0.15	\$ 64	\$ 107	\$ 107	\$ 64	4	7	7	4
LED C	2,733	\$ 996	35	77	0.10	0.15	0.25	0.20	\$ 100	\$ 149	\$ 249	\$ 199	4	5	9	7
LED D	5,312	\$ 1,476	50	106	0.05	0.10	0.15	0.20	\$ 74	\$ 148	\$ 221	\$ 295	3	5	8	10
LED D	6,645	\$ 1,583	61	108	0.00	0.05	0.10	0.20	\$ -	\$ 79	\$ 158	\$ 317	0	3	6	12
LED E	9,622	\$ 1,512	78	123	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 76	\$ 151	0	0	4	8
					1.00	1.00	1.00	1.00	\$ 445	\$ 625	\$ 876	\$ 1,070	17	25	35	43

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	852	\$ 979	21	40	0.05	0.05	0.00	0.00	\$ 49	\$ 49	\$ -	\$ -	1	1	0	0
LED F	852	\$ 979	21	40	0.20	0.10	0.05	0.05	\$ 196	\$ 98	\$ 49	\$ 49	4	2	1	1
LED G	1,172	\$ 670	19	61	0.20	0.15	0.05	0.05	\$ 134	\$ 101	\$ 34	\$ 34	4	3	1	1
LED G	1,441	\$ 701	19	75	0.25	0.20	0.10	0.05	\$ 175	\$ 140	\$ 70	\$ 35	5	4	2	1
LED G	2,261	\$ 508	38	59	0.15	0.20	0.25	0.15	\$ 76	\$ 102	\$ 127	\$ 76	6	8	10	6
LED H	3,331	\$ 1,204	37	89	0.10	0.15	0.25	0.20	\$ 120	\$ 181	\$ 301	\$ 241	4	6	9	7
LED H	5,965	\$ 1,720	76	79	0.05	0.10	0.15	0.20	\$ 86	\$ 172	\$ 258	\$ 344	4	8	11	15
LED H	5,391	\$ 1,810	60	90	0.00	0.05	0.10	0.20	\$ -	\$ 91	\$ 181	\$ 362	0	3	6	12
LED H	7,662	\$ 1,810	90	85	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 91	\$ 181	0	0	5	9
					1.00	1.00	1.00	1.00	\$ 837	\$ 932	\$ 1,110	\$ 1,321	27	34	45	52

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED J	2,946	\$ 522	32	92	0.30	0.25	0.15	0.10	\$ 157	\$ 131	\$ 78	\$ 52	10	8	5	3
LED J	4,613	\$ 522	67	69	0.25	0.25	0.15	0.15	\$ 131	\$ 131	\$ 78	\$ 78	17	17	10	10
LED K	9,058	\$ 1,060	127	71	0.20	0.20	0.20	0.20	\$ 212	\$ 212	\$ 212	\$ 212	25	25	25	25
LED K	7,294	\$ 994	106	69	0.15	0.15	0.25	0.25	\$ 149	\$ 149	\$ 249	\$ 249	16	16	26	26
LED L	12,700	\$ 1,383	121	105	0.10	0.15	0.25	0.30	\$ 138	\$ 207	\$ 346	\$ 415	12	18	30	36
					1.00	1.00	1.00	1.00	\$ 787	\$ 830	\$ 963	\$ 1,006	80	84	97	101
AVERAGE:									\$ 690	\$ 796	\$ 983	\$ 1,133	41	48	59	65
\$/W									\$16.7	\$16.7	\$16.68	\$17.31				

Figure 102: Student Pick-up/Drop-off Zone Calculation Results and Recommendations

Student Pickup/Dropoff Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance		0.15	0.45		W/sf
	LPW	29	28	27	26	lm/W
2016	LPW	96	95	94	94	lm/W
	Change		0.04	0.13		Limit of Reduction
	Proposed		0.10	0.25		W/sf

Figure 103: Student Pick-up/Drop-off Zone Lumen Equivalency Calculation Pt. 1

Student Pick Up Calculations T-24 2016 - Incumbent Lamps

Downlight										Weighting				Weighted LPW			
2008 Basis of Design										LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	Initial Lamp Lumens	Maintained Lamp Lumens	System Watts	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	LPW								
32	CFL	Lum. A	2,400	2,064	36	751	646	0.860	18	0.10	0.10	0.05	0.00	2	2	1	0
42	CFL	Lum. A	3,200	2,752	47	1,001	861	0.860	18	0.25	0.10	0.05	0.05	5	2	1	1
70	PSMH	Lum. B	5,600	3,300	90	2,431	1,433	0.589	16	0.25	0.20	0.20	0.10	4	3	3	2
100	PSMH	Lum. B	8,500	4,675	129	3,691	2,030	0.550	16	0.15	0.20	0.20	0.25	2	3	3	4
150	PSMH	Lum. C	14,000	11,000	190	6,467	5,081	0.786	27	0.15	0.20	0.25	0.30	4	5	7	8
175	PSMH	Lum. C	12,800	8,300	198	5,913	3,834	0.648	19	0.10	0.20	0.25	0.30	2	4	5	6
										1.00	1.00	1.00	1.00	19	19	20	20

Wall Pack										Weighting				Weighted LPW			
2008 Basis of Design										LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	Initial Lamp Lumens	Maintained Lamp Lumens	System Watts	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	LPW								
26	CFL	Lum. D	1,800	1,548	27	826	710	0.860	26	0.10	0.10	0.05	0.00	3	3	1	0
32	CFL	Lum. D	2,400	2,064	36	1,101	947	0.860	26	0.15	0.10	0.10	0.05	4	3	3	1
42	CFL	Lum. D	3,200	2,752	47	1,468	1,262	0.860	27	0.20	0.15	0.10	0.10	5	4	3	3
70	PSMH	Lum. D	5,600	3,300	90	2,561	1,509	0.589	17	0.25	0.20	0.15	0.10	4	3	3	2
100	PSMH	Lum. D	8,500	4,675	129	3,887	2,138	0.550	17	0.15	0.25	0.15	0.15	2	4	2	2
150	PSMH	Lum. D	14,000	11,000	190	6,401	5,029	0.786	26	0.10	0.15	0.25	0.20	3	4	7	5
175	PSMH	Lum. E	12,800	8,300	198	7,624	4,944	0.648	25	0.05	0.05	0.15	0.25	1	1	4	6
250	PSMH	Lum. E	18,000	11,000	291	10,721	6,552	0.611	23	0.00	0.00	0.05	0.15	0	0	1	3
										1.00	1.00	1.00	1.00	23	22	23	23

Area										Weighting				Weighted LPW			
2008 Basis of Design										LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
Wattage	Lamp Type	Luminaire	Initial Lamp Lumens	Maintained Lamp Lumens	System Watts	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	LPW								
18	CFL	Lum. F	1,150	990	20	802	690	0.861	35	0.05	0.05	0.00	0.00	2	2	0	0
26	CFL	Lum. F	1,800	1,548	28	1,193	1,026	0.860	37	0.05	0.05	0.05	0.00	2	2	2	0
32	CFL	Lum. F	2,400	2,064	36	1,674	1,440	0.860	40	0.10	0.10	0.10	0.05	4	4	4	2
42	CFL	Lum. F	3,200	2,752	47	2,232	1,920	0.860	41	0.20	0.15	0.20	0.10	8	6	8	4
50	MH	Lum. G	3,450	1,600	67	2,905	1,347	0.464	20	0.30	0.20	0.20	0.15	6	4	4	3
70	MH	Lum. G	5,600	3,300	92	4,715	2,778	0.589	30	0.20	0.20	0.20	0.25	6	6	6	8
100	MH	Lum. G	8,500	4,675	129	7,157	3,936	0.550	31	0.05	0.15	0.15	0.25	2	5	5	8
150	MH	Lum. G	14,000	11,000	190	11,998	9,427	0.786	50	0.05	0.10	0.10	0.20	2	5	5	10
										1.00	1.00	1.00	1.00	32	33	34	34

										AVERAGE:				24	25	25	26
--	--	--	--	--	--	--	--	--	--	-----------------	--	--	--	----	----	----	----

Figure 104: Student Pick-up/Drop-off Zone Equivalency Calculation Pt. 2

Student Pick Up Calculations T-24 2016 - LED

2016 LED Equivalency							Weighting				Weighted LPW					
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	784	549	0.700	25	18	22	4	23%	0.10	0.10	0.05	0.00	2	2	1	0
LED B	1,175	823	0.700	28	20	30	12	63%	0.25	0.10	0.05	0.05	7	3	1	1
LED C	2,443	1,710	0.700	37	26	47	31	194%	0.25	0.20	0.20	0.10	12	9	9	5
LED C	3,153	2,207	0.700	49	35	45	29	184%	0.15	0.20	0.20	0.25	7	9	9	11
LED D	6,586	4,610	0.700	88	62	74	48	178%	0.15	0.20	0.25	0.30	11	15	19	22
LED E	5,963	4,174	0.700	69	49	85	66	339%	0.10	0.20	0.25	0.30	9	17	21	26
							1.00	1.00	1.00	1.00	48	55	61	65		

2016 LED Equivalency							Weighting				Weighted LPW					
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	734	514	0.700	9	6	81	55	209%	0.10	0.10	0.05	0.00	8	8	4	0
LED F	1,278	895	0.700	16	11	78	52	196%	0.15	0.10	0.10	0.05	12	8	8	4
LED G	1,433	1,373	0.958	18	13	108	81	300%	0.20	0.15	0.10	0.10	22	16	11	11
LED G	2,593	2,341	0.903	38	27	87	70	418%	0.25	0.20	0.15	0.10	22	17	13	9
LED H	3,904	2,733	0.700	50	35	77	61	367%	0.15	0.25	0.15	0.15	12	19	12	12
LED J	6,587	6,231	0.946	74	53	118	92	346%	0.10	0.15	0.25	0.20	12	18	30	24
LED K	7,491	6,645	0.887	87	61	108	83	333%	0.05	0.05	0.15	0.25	5	5	16	27
LED J	11,557	10,251	0.887	142	101	102	79	352%	0.00	0.00	0.05	0.15	0	0	5	15
							1.00	1.00	1.00	1.00	92	92	98	101		

2016 LED Equivalency							Weighting				Weighted LPW					
Luminaire	Initial Luminaire Lumens	Maintained Luminaire Lumens	LLD	2014 Fixture Watts	2017 Fixture Watts	LPW	LPW Diff.	Percentage Increase	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED L	1,110	852	0.768	30	21	40	6	16%	0.05	0.05	0.00	0.00	2	2	0	0
LED L	1,110	852	0.768	30	21	40	3	9%	0.05	0.05	0.05	0.00	2	2	2	0
LED M	1,674	1,172	0.7	27	19	61	21	53%	0.10	0.10	0.10	0.05	6	6	6	3
LED M	2,059	1,441	0.7	27	19	75	34	84%	0.20	0.15	0.20	0.10	15	11	15	8
LED N	3,139	2,969	0.946	34	24	122	102	507%	0.30	0.20	0.20	0.15	37	24	24	18
LED N	4,709	4,455	0.946	51	36	124	93	309%	0.20	0.20	0.20	0.25	25	25	25	31
LED N	6,727	6,364	0.946	77	55	117	86	282%	0.05	0.15	0.15	0.25	6	17	17	29
LED N	12,552	11,874	0.946	139	99	120	71	143%	0.05	0.10	0.10	0.20	6	12	12	24
							1.00	1.00	1.00	1.00	98	100	102	113		
											79	82	87	93		

Figure 105: Student Pick-up/Drop-off Zone Cost Calculation Pt. 1

Student Pick Up Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
32	CFL	Lum. A	36	\$ 334	646	0.860	18	0.10	0.10	0.05	0.00	\$ 33	\$ 33	\$ 17	\$ -	4	4	2	0
42	CFL	Lum. A	47	\$ 334	861	0.860	18	0.25	0.10	0.05	0.05	\$ 83	\$ 33	\$ 17	\$ 17	12	5	2	2
70	PSMH	Lum. B	90	\$ 300	1,433	0.589	16	0.25	0.20	0.20	0.10	\$ 75	\$ 60	\$ 60	\$ 30	23	18	18	9
100	PSMH	Lum. B	129	\$ 215	2,030	0.550	16	0.15	0.20	0.20	0.25	\$ 32	\$ 43	\$ 43	\$ 54	19	26	26	32
150	PSMH	Lum. C	190	\$ 603	5,081	0.786	27	0.15	0.20	0.25	0.30	\$ 90	\$ 121	\$ 151	\$ 181	29	38	48	57
175	PSMH	Lum. C	198	\$ 489	3,834	0.648	19	0.10	0.20	0.25	0.30	\$ 49	\$ 98	\$ 122	\$ 147	20	40	50	59
								1.00	1.00	1.00	1.00	\$ 363	\$ 388	\$ 409	\$ 428	106	130	145	160

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
26	CFL	Lum. D	27	\$ 365	710	0.860	26	0.10	0.10	0.05	0.00	\$ 36	\$ 36	\$ 18	\$ -	3	3	1	0
32	CFL	Lum. D	36	\$ 368	947	0.860	26	0.15	0.10	0.10	0.05	\$ 55	\$ 37	\$ 37	\$ 18	5	4	4	2
42	CFL	Lum. D	47	\$ 368	1,262	0.860	27	0.20	0.15	0.10	0.10	\$ 74	\$ 55	\$ 37	\$ 37	9	7	5	5
70	PSMH	Lum. D	90	\$ 377	1,509	0.589	17	0.25	0.20	0.15	0.10	\$ 94	\$ 75	\$ 57	\$ 38	23	18	14	9
100	PSMH	Lum. D	129	\$ 382	2,138	0.550	17	0.15	0.25	0.15	0.15	\$ 57	\$ 96	\$ 57	\$ 57	19	32	19	19
150	PSMH	Lum. D	190	\$ 393	5,029	0.786	26	0.10	0.15	0.25	0.20	\$ 39	\$ 59	\$ 98	\$ 79	19	29	48	38
175	PSMH	Lum. E	198	\$1,289	4,944	0.648	25	0.05	0.05	0.15	0.25	\$ 64	\$ 64	\$ 193	\$ 322	10	10	30	50
250	PSMH	Lum. E	291	\$1,229	6,552	0.611	23	0.00	0.00	0.05	0.15	\$ -	\$ -	\$ 61	\$ 184	0	0	15	44
								0.75	0.80	0.85	0.95	\$ 421	\$ 423	\$ 559	\$ 735	88	102	134	166

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
18	CFL	Lum. F	20	\$ 600	690	0.861	35	0.05	0.05	0.00	0.00	\$ 30	\$ 30	\$ -	\$ -	1	1	0	0
26	CFL	Lum. F	28	\$ 600	1,026	0.860	37	0.05	0.05	0.05	0.00	\$ 30	\$ 30	\$ 30	\$ -	1	1	1	0
32	CFL	Lum. F	36	\$ 600	1,440	0.860	40	0.10	0.10	0.10	0.05	\$ 60	\$ 60	\$ 60	\$ 30	4	4	4	2
42	CFL	Lum. F	47	\$ 600	1,920	0.860	41	0.20	0.15	0.20	0.10	\$ 120	\$ 90	\$ 120	\$ 60	9	7	9	5
50	MH	Lum. G	67	\$ 767	1,347	0.464	20	0.30	0.20	0.20	0.15	\$ 230	\$ 153	\$ 153	\$ 115	20	13	13	10
70	MH	Lum. G	92	\$ 767	2,778	0.589	30	0.20	0.20	0.20	0.25	\$ 153	\$ 153	\$ 153	\$ 192	18	18	18	23
100	MH	Lum. G	129	\$ 778	3,936	0.550	31	0.05	0.15	0.15	0.25	\$ 39	\$ 117	\$ 117	\$ 195	6	19	19	32
150	MH	Lum. G	190	\$ 793	9,427	0.786	50	0.05	0.10	0.10	0.20	\$ 40	\$ 79	\$ 79	\$ 159	10	19	19	38
								1.00	1.00	1.00	1.00	\$ 702	\$ 713	\$ 713	\$ 750	70	83	85	110
AVERAGE:												\$ 414	\$ 431	\$ 485	\$ 552	\$ 97	\$ 117	\$ 136	\$ 157
\$/W												\$ 4.28	\$ 3.69	\$ 3.57	\$ 3.52				

Figure 106: Student Pick-up/Drop-off Zone Cost Calculation Pt. 2

Student Pick Up Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	549	\$ 220	18	22	0.10	0.10	0.05	0.00	\$ 22	\$ 22	\$ 11	\$ -	2	2	1	0
LED B	823	\$ 227	20	30	0.25	0.10	0.05	0.05	\$ 57	\$ 23	\$ 11	\$ 11	5	2	1	1
LED C	1,710	\$ 314	26	47	0.25	0.20	0.20	0.10	\$ 78	\$ 63	\$ 63	\$ 31	6	5	5	3
LED C	2,207	\$ 229	35	45	0.15	0.20	0.20	0.25	\$ 34	\$ 46	\$ 46	\$ 57	5	7	7	9
LED D	4,610	\$ 625	62	74	0.15	0.20	0.25	0.30	\$ 94	\$ 125	\$ 156	\$ 187	9	12	16	19
LED E	4,174	\$ 445	49	85	0.10	0.20	0.25	0.30	\$ 45	\$ 89	\$ 111	\$ 134	5	10	12	15
					1.00	1.00	1.00	1.00	\$ 330	\$ 367	\$ 398	\$ 421	33	38	42	46

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	514	\$ 186	6	81	0.10	0.10	0.05	0.00	\$ 19	\$ 19	\$ 9	\$ -	1	1	0	0
LED F	895	\$ 213	11	78	0.15	0.10	0.10	0.05	\$ 32	\$ 21	\$ 21	\$ 11	2	1	1	1
LED G	1,373	\$ 386	13	108	0.20	0.15	0.10	0.10	\$ 77	\$ 58	\$ 39	\$ 39	3	2	1	1
LED G	2,341	\$ 386	27	87	0.25	0.20	0.15	0.10	\$ 96	\$ 77	\$ 58	\$ 39	7	5	4	3
LED H	2,733	\$ 339	35	77	0.15	0.25	0.15	0.15	\$ 51	\$ 85	\$ 51	\$ 51	5	9	5	5
LED J	6,231	\$ 1,360	53	118	0.10	0.15	0.25	0.20	\$ 136	\$ 204	\$ 340	\$ 272	5	8	13	11
LED K	6,645	\$ 1,424	61	108	0.05	0.05	0.15	0.25	\$ 71	\$ 71	\$ 214	\$ 356	3	3	9	15
LED J	10,251	\$ 1,367	101	102	0.00	0.00	0.05	0.15	\$ -	\$ -	\$ 68	\$ 205	0	0	5	15
					1.00	1.00	1.00	1.00	\$ 482	\$ 535	\$ 800	\$ 972	25	29	40	51

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	2017 Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED L	852	\$ 881	21	40	0.05	0.05	0.00	0.00	\$ 44	\$ 44	\$ -	\$ -	1	1	0	0
LED L	852	\$ 881	21	40	0.05	0.05	0.05	0.00	\$ 44	\$ 44	\$ 44	\$ -	1	1	1	0
LED M	1,172	\$ 603	19	61	0.10	0.10	0.10	0.05	\$ 60	\$ 60	\$ 60	\$ 30	2	2	2	1
LED M	1,441	\$ 603	19	75	0.20	0.15	0.20	0.10	\$ 121	\$ 90	\$ 121	\$ 60	4	3	4	2
LED N	2,969	\$ 1,286	24	122	0.30	0.20	0.20	0.15	\$ 386	\$ 257	\$ 257	\$ 193	7	5	5	4
LED N	4,455	\$ 1,286	36	124	0.20	0.20	0.20	0.25	\$ 257	\$ 257	\$ 257	\$ 321	7	7	7	9
LED N	6,364	\$ 1,286	55	117	0.05	0.15	0.15	0.25	\$ 64	\$ 193	\$ 193	\$ 321	3	8	8	14
LED N	11,874	\$ 1,384	99	120	0.05	0.10	0.10	0.20	\$ 69	\$ 138	\$ 138	\$ 277	5	10	10	20
					1.00	1.00	1.00	1.00	\$1,045	\$1,084	\$1,070	\$1,203	30	37	37	49
									\$ 447	\$ 489	\$ 586	\$ 664	\$30	\$35	\$41	\$48
									\$14.84	\$13.88	\$14.42	\$13.98				

Figure 107: Outdoor Dining Calculation Results and Recommendations

Outdoor Dining Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	0.014	0.135	0.240	0.400	W/sf
	LPW	7	7	8	8	lm/W
2016	LPW	74	80	84	88	lm/W
	Change	0.001	0.012	0.022	0.037	Limit of Reduction
	Proposed	0.010	0.100	0.150	0.200	W/sf

Figure 108: Outdoor Dining Lumen Equivalency Calculation Pt. 1

Outdoor Dining Calculations T-24 2016 - Incumbent Lamps

String Light							2008 Basis of Design				Weighting				Weighted LPW			
Lamp Type	Lamp	Manufacturer	System Watts	Maintained Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4				
Incandescent	G16.5	Lum. A	15	81	0.9	5	0.25	0.15	0.10	0.05	1	1	1	0				
Incandescent	G16.5	Lum. A	25	153	0.9	6	0.15	0.20	0.15	0.10	1	1	1	1				
Incandescent	G16.5	Lum. A	40	297	0.9	7	0.10	0.15	0.25	0.35	1	1	2	3				
Incandescent	B10	Lum. A	15	105	0.9	7	0.25	0.15	0.10	0.05	2	1	1	0				
Incandescent	B10	Lum. A	25	189	0.9	8	0.15	0.20	0.15	0.10	1	2	1	1				
Incandescent	B10	Lum. A	40	414	0.9	10	0.10	0.15	0.25	0.35	1	2	3	4				
							1.00	1.00	1.00	1.00	7	7	8	8				
AVERAGE:							7	7	8	8								

Figure 109: Outdoor Dining Equivalency Calculation Pt. 2

Outdoor Dining Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted LPW			
Lamp Type	Lamp	2017 Fixture Watts	Maitained Lumens	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	1.3	53	59	0.25	0.15	0.10	0.05	15	9	6	3
LED	LED B	2.1	126	85	0.15	0.20	0.15	0.10	13	17	13	8
LED	LED C	3.2	189	85	0.10	0.15	0.25	0.35	8	13	21	30
LED	LED D	1.7	70	59	0.25	0.15	0.10	0.05	15	9	6	3
LED	LED E	2.1	129	86	0.15	0.20	0.15	0.10	13	17	13	9
LED	LED F	5.0	350	101	0.10	0.15	0.25	0.35	10	15	25	35
					1.00	1.00	1.00	1.00	74	80	84	88
AVERAGE:					74	80	84	88				

Figure 110: Outdoor Dining Cost Calculation Pt. 1

Outdoor Dining Calculations T-24 2016 - Incumbent Lamps

String Light								2008 Basis of Design				Weighting				Weighted Cost				Weighted W			
Lamp Type	Lamp	Manufacturer	System Watts	Maintained Lumens	Cost	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4				
Incandescent	G16.5	Lum. A	15	81	\$ 2	0.9	5	0.25	0.15	0.10	0.05	\$ 0	\$ 0	\$ 0	\$ 0	4	2	2	1				
Incandescent	G16.5	Lum. A	25	153	\$ 2	0.9	6	0.15	0.20	0.15	0.10	\$ 0	\$ 0	\$ 0	\$ 0	4	5	4	3				
Incandescent	G16.5	Lum. A	40	297	\$ 2	0.9	7	0.10	0.15	0.25	0.35	\$ 0	\$ 0	\$ 0	\$ 1	4	6	10	14				
Incandescent	B10	Lum. A	15	105	\$ 1	0.9	7	0.25	0.15	0.10	0.05	\$ 0	\$ 0	\$ 0	\$ 0	4	2	2	1				
Incandescent	B10	Lum. A	25	189	\$ 1	0.9	8	0.15	0.20	0.15	0.10	\$ 0	\$ 0	\$ 0	\$ 0	4	5	4	3				
Incandescent	B10	Lum. A	40	414	\$ 1	0.9	10	0.10	0.15	0.25	0.35	\$ 0	\$ 0	\$ 0	\$ 0	4	6	10	14				
								1.00	1.00	1.00	1.00	\$ 1	\$ 1	\$ 1	\$ 1	23	27	31	35				
AVERAGE:								\$ 1	\$ 1	\$ 1	\$ 1	23	27	31	35								
\$/W								\$ 0.06	\$ 0.05	\$ 0.05	\$ 0.04												

Figure 111: Outdoor Dining Cost Calculation Pt. 2

Outdoor Dining Calculations T-24 2016 - LED

2016 LED Equivalency						Weighting				Weighted Cost				Weighted W			
Lamp Type	Lamp	2017 Fixture Watts	Maintained Lumens	Cost	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED	LED A	1.3	53	\$ 12	59	0.25	0.15	0.10	0.05	\$ 3	\$ 2	\$ 1	\$ 1	0	0	0	0
LED	LED B	2.1	126	\$ 10	85	0.15	0.20	0.15	0.10	\$ 2	\$ 2	\$ 2	\$ 1	0	0	0	0
LED	LED C	3.2	189	\$ 18	85	0.10	0.15	0.25	0.35	\$ 2	\$ 3	\$ 4	\$ 6	0	0	1	1
LED	LED D	1.7	70	\$ 12	59	0.25	0.15	0.10	0.05	\$ 3	\$ 2	\$ 1	\$ 1	0	0	0	0
LED	LED E	2.1	129	\$ 10	86	0.15	0.20	0.15	0.10	\$ 2	\$ 2	\$ 2	\$ 1	0	0	0	0
LED	LED F	5.0	350	\$ 32	101	0.10	0.15	0.25	0.35	\$ 3	\$ 5	\$ 8	\$ 11	0	1	1	2
						1.00	1.00	1.00	1.00	\$ 14	\$ 15	\$ 18	\$ 21	2	3	3	3
AVERAGE:						\$ 14	\$ 15	\$ 18	\$ 21	2	3	3	3				
						\$ 6	\$ 6	\$ 6	\$ 6								

Figure 112: Special Security Lighting for Retail Calculation Results and Recommendations

Special Security Lighting for Retail Recommendations

		LZ1	LZ2	LZ3	LZ4	
2013	Allowance	0.007	0.009	0.019		W/sf
	LPW	30	29	27	28	lm/W
2016	LPW	75	77	81	84	lm/W
	Change	0.003	0.003	0.006		Limit of Reduction
	Proposed	0.005	0.007	0.012		W

Figure 113: Special Security Lighting for Retail Lumen Equivalency Calculation Pt. 1

Special Security Calculations T-24 2016 - Incumbent Lamps

Wall Pack														
2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
26	CFL	Lum. A	27	710	0.860	26	0.25	0.15	0.10	0.10	7	4	3	3
32	CFL	Lum. A	36	947	0.860	26	0.25	0.25	0.15	0.15	7	7	4	4
42	CFL	Lum. A	47	1,262	0.860	27	0.25	0.25	0.20	0.15	7	7	5	4
70	PSMH	Lum. A	90	1,509	0.589	17	0.10	0.15	0.15	0.10	2	3	3	2
100	PSMH	Lum. A	129	2,138	0.550	17	0.10	0.10	0.20	0.15	2	2	3	2
150	PSMH	Lum. A	190	5,029	0.786	26	0.05	0.10	0.15	0.20	1	3	4	5
175	PSMH	Lum. B	198	4,944	0.648	25	0.00	0.00	0.05	0.10	0	0	1	2
250	PSMH	Lum. B	291	6,552	0.611	23	0.00	0.00	0.00	0.05	0	0	0	1
							1.00	1.00	1.00	1.00	25	24	23	24

Area														
2008 Basis of Design							Weighting				Weighted LPW			
Wattage	Lamp Type	Luminaire	System Watts	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
18	CFL	Lum. C	19	690	0.861	36	0.10	0.10	0.05	0.00	4	4	2	0
26	CFL	Lum. C	27	1,026	0.860	38	0.25	0.15	0.10	0.10	9	6	4	4
32	CFL	Lum. C	36	1,440	0.860	40	0.20	0.20	0.15	0.15	8	8	6	6
42	CFL	Lum. C	47	1,920	0.860	41	0.20	0.25	0.15	0.15	8	10	6	6
70	PSMH	Lum. D	90	1,984	0.589	22	0.10	0.15	0.15	0.10	2	3	3	2
100	PSMH	Lum. D	129	2,809	0.550	22	0.10	0.10	0.20	0.15	2	2	4	3
150	PSMH	Lum. D	190	6,558	0.786	35	0.05	0.05	0.15	0.20	2	2	5	7
175	PSMH	Lum. D	198	5,053	0.648	26	0.00	0.00	0.05	0.10	0	0	1	3
250	PSMH	Lum. D	291	6,697	0.611	23	0.00	0.00	0.00	0.05	0	0	0	1
							1.00	1.00	1.00	1.00	35	35	32	32
							AVERAGE:				30	29	27	28

Figure 114: Special Security Lighting for Retail Equivalency Calculation Pt. 2

Special Security Calculations T-24 2016 - LED

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	514	6	81	0.25	0.15	0.10	0.10	20	12	8	8
LED A	895	11	78	0.25	0.25	0.15	0.15	19	19	12	12
LED B	1,373	13	108	0.25	0.25	0.20	0.15	27	27	22	16
LED B	2,341	27	87	0.10	0.15	0.15	0.10	9	13	13	9
LED C	2,733	35	77	0.10	0.10	0.20	0.15	8	8	15	12
LED D	6,231	53	118	0.05	0.10	0.15	0.20	6	12	18	24
LED E	6,645	61	108	0.00	0.00	0.05	0.10	0	0	5	11
LED D	10,251	101	102	0.00	0.00	0.00	0.05	0	0	0	5
				1.00	1.00	1.00	1.00	89	91	93	96

2016 LED Equivalency				Weighting				Weighted LPW			
Luminaire	Maintained Luminaire Lumens	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	852	21	40	0.10	0.10	0.05	0.00	4	4	2	0
LED F	852	21	40	0.25	0.15	0.10	0.10	10	6	4	4
LED G	1,172	19	61	0.20	0.20	0.15	0.15	12	12	9	9
LED G	1,441	19	75	0.20	0.25	0.15	0.15	15	19	11	11
LED G	2,261	38	59	0.10	0.15	0.15	0.10	6	9	9	6
LED H	3,331	37	89	0.10	0.10	0.20	0.15	9	9	18	13
LED H	5,965	76	79	0.05	0.05	0.15	0.20	4	4	12	16
LED H	5,391	60	90	0.00	0.00	0.05	0.10	0	0	5	9
LED H	7,662	90	85	0.00	0.00	0.00	0.05	0	0	0	4
				1.00	1.00	1.00	1.00	60	63	69	73
AVERAGE:								75	77	81	84

Figure 115: Special Security Lighting for Retail Cost Calculation Pt. 1

Special Security Calculations T-24 2016 - Incumbent Lamps

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
26	CFL	Lum. A	27	\$ 365	710	0.860	26	0.25	0.15	0.10	0.10	\$ 91	\$ 55	\$ 36	\$ 36	7	4	3	3
32	CFL	Lum. A	36	\$ 368	947	0.860	26	0.25	0.25	0.15	0.15	\$ 92	\$ 92	\$ 55	\$ 55	9	9	5	5
42	CFL	Lum. A	47	\$ 368	1,262	0.860	27	0.25	0.25	0.20	0.15	\$ 92	\$ 92	\$ 74	\$ 55	12	12	9	7
70	PSMH	Lum. A	90	\$ 377	1,509	0.589	17	0.10	0.15	0.15	0.10	\$ 38	\$ 57	\$ 57	\$ 38	9	14	14	9
100	PSMH	Lum. A	129	\$ 382	2,138	0.550	17	0.10	0.10	0.20	0.15	\$ 38	\$ 38	\$ 76	\$ 57	13	13	26	19
150	PSMH	Lum. A	190	\$ 393	5,029	0.786	26	0.05	0.10	0.15	0.20	\$ 20	\$ 39	\$ 59	\$ 79	10	19	29	38
175	PSMH	Lum. B	198	\$ 393	4,944	0.648	25	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 20	\$ 39	0	0	10	20
250	PSMH	Lum. B	291	\$ 393	6,552	0.611	23	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 20	0	0	0	15
								1.00	1.00	1.00	1.00	\$ 371	\$ 373	\$ 377	\$ 380	59	70	95	116

2008 Basis of Design								Weighting				Weighted Cost				Weighted W			
Wattage	Lamp Type	Luminaire	System Watts	Cost	Maintained Luminaire Lumens	LLD	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
18	CFL	Lum. C	19	\$ 600	690	0.861	36	0.10	0.10	0.05	0.00	\$ 60	\$ 60	\$ 30	\$ -	2	2	1	0
26	CFL	Lum. C	27	\$ 600	1,026	0.860	38	0.25	0.15	0.10	0.10	\$ 150	\$ 90	\$ 60	\$ 60	7	4	3	3
32	CFL	Lum. C	36	\$ 600	1,440	0.860	40	0.20	0.20	0.15	0.15	\$ 120	\$ 120	\$ 90	\$ 90	7	7	5	5
42	CFL	Lum. C	47	\$ 600	1,920	0.860	41	0.20	0.25	0.15	0.15	\$ 120	\$ 150	\$ 90	\$ 90	9	12	7	7
70	PSMH	Lum. D	90	\$1,035	1,984	0.589	22	0.10	0.15	0.15	0.10	\$ 104	\$ 155	\$ 155	\$ 104	9	14	14	9
100	PSMH	Lum. D	129	\$1,035	2,809	0.550	22	0.10	0.10	0.20	0.15	\$ 104	\$ 104	\$ 207	\$ 155	13	13	26	19
150	PSMH	Lum. D	190	\$1,035	6,558	0.786	35	0.05	0.05	0.15	0.20	\$ 52	\$ 52	\$ 155	\$ 207	10	10	29	38
175	PSMH	Lum. D	198	\$1,235	5,053	0.648	26	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 62	\$ 123	0	0	10	20
250	PSMH	Lum. D	291	\$1,235	6,697	0.611	23	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 62	0	0	0	15
								1.00	1.00	1.00	1.00	\$ 709	\$ 731	\$ 849	\$ 891	57	61	94	116
AVERAGE:												\$ 540	\$ 552	\$ 613	\$ 635	58	66	95	116
\$/W												\$9.35	\$8.43	\$6.49	\$5.49				

Figure 116: Special Security Lighting for Retail Cost Calculation Pt. 2

Special Security Calculations T-24 2016 - LED

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED A	514	\$ 207	6	81	0.25	0.15	0.10	0.10	\$ 52	\$ 31	\$ 21	\$ 21	2	1	1	1
LED A	895	\$ 237	11	78	0.25	0.25	0.15	0.15	\$ 59	\$ 59	\$ 36	\$ 36	3	3	2	2
LED B	1,373	\$ 428	13	108	0.25	0.25	0.20	0.15	\$ 107	\$ 107	\$ 86	\$ 64	3	3	3	2
LED B	2,341	\$ 428	27	87	0.10	0.15	0.15	0.10	\$ 43	\$ 64	\$ 64	\$ 43	3	4	4	3
LED C	2,733	\$ 996	35	77	0.10	0.10	0.20	0.15	\$ 100	\$ 100	\$ 199	\$ 149	4	4	7	5
LED D	6,231	\$ 1,583	53	118	0.05	0.10	0.15	0.20	\$ 79	\$ 158	\$ 237	\$ 317	3	5	8	11
LED E	6,645	\$ 1,583	61	108	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 79	\$ 158	0	0	3	6
LED D	10,251	\$ 1,583	101	102	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 79	0	0	0	5
					1.00	1.00	1.00	1.00	\$ 440	\$ 520	\$ 722	\$ 867	17	20	27	34

2016 LED Equivalency					Weighting				Weighted Cost				Weighted W			
Luminaire	Maintained Luminaire Lumens	Cost	2017 Fixture Watts	LPW	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4	LZ1	LZ2	LZ3	LZ4
LED F	852	\$ 979	21	40	0.10	0.10	0.05	0.00	\$ 98	\$ 98	\$ 49	\$ -	2	2	1	0
LED F	852	\$ 979	21	40	0.25	0.15	0.10	0.10	\$ 245	\$ 147	\$ 98	\$ 98	5	3	2	2
LED G	1,172	\$ 670	19	61	0.20	0.20	0.15	0.15	\$ 134	\$ 134	\$ 101	\$ 101	4	4	3	3
LED G	1,441	\$ 670	19	75	0.20	0.25	0.15	0.15	\$ 134	\$ 168	\$ 101	\$ 101	4	5	3	3
LED G	2,261	\$ 508	38	59	0.10	0.15	0.15	0.10	\$ 51	\$ 76	\$ 76	\$ 51	4	6	6	4
LED H	3,331	\$ 1,204	37	89	0.10	0.10	0.20	0.15	\$ 120	\$ 120	\$ 241	\$ 181	4	4	7	6
LED H	5,965	\$ 1,720	76	79	0.05	0.05	0.15	0.20	\$ 86	\$ 86	\$ 258	\$ 344	4	4	11	15
LED H	5,391	\$ 1,810	60	90	0.00	0.00	0.05	0.10	\$ -	\$ -	\$ 91	\$ 181	0	0	3	6
LED H	7,662	\$ 1,810	90	85	0.00	0.00	0.00	0.05	\$ -	\$ -	\$ -	\$ 91	0	0	0	5
					1.00	1.00	1.00	1.00	\$ 868	\$ 829	\$ 1,013	\$ 1,146	26	27	37	43
AVERAGE:									\$ 654	\$ 674	\$ 868	\$ 1,006	21	24	32	38
									\$ 30.43	\$ 28.65	\$ 27.32	\$ 26.14				

APPENDIX I: STATEWIDE COST EFFECTIVENESS CALCULATION RESULTS

Since the outdoor hardscape is not estimated as part of the construction forecasts, statewide estimates for this measure are more difficult to establish. As stated in the main body of the report, the Statewide CASE Team made construction percentage estimates based on economic activity to predict the LZ percentages of the total construction activity per building type.

Note that the cost effectiveness values are based on calculating the reduction in wattage from the previous allowance to the proposed allowance, and are not based on the technical feasibility of the swap from an incumbent light source technology to LED, which results in a lumen-for-lumen equivalent comparison.

The allowances do not reduce fully to the lumen equivalent values as projected by the Statewide CASE Team research as an accommodation for both the uncertainty of forward efficacy projections and LED price reductions, the specific LPA values proposed are not as aggressive as they may have been. This approach was taken as a prudent level of conservatism for the changes as an acknowledgement that the changes are substantial and will create an impact in the lighting design industry in California.

This proposal for the change from incumbent light source technologies to LED is intended to provide a measure of improvement in energy use in the state without the change being too disruptive or difficult to accommodate. If this were a change in the LPA values based on advancement of the technology of the light sources (for example, when the industry went from T12 lamps to T8 lamps), the values in the LPA table would be much more aggressively set than this CASE recommends.

With the exception of the general hardscape allowance, the calculations for cost effectiveness provide a comparison of a single luminaire-for-luminaire exchange with no additional savings associated with reduced load on the electrical system (reduced wire size or fewer circuits) or better lumen distribution associated with a product. This likely overstates the added cost for the LED technology, and does not include any benefits from enhanced controls approaches that are enabled when using the LED technology.

These two factors contribute to overstate incremental costs and understate energy savings in a lumen-comparable lighting system.

Table 37: Cost-effectiveness Summary¹ – Weighted Average Across Lighting Zones

Climate Zone	Units	Benefit: TDV Energy Cost Savings ² (2017 PV\$)	Cost: Total Incremental Cost ³ (2017 PV\$)	Change in Lifecycle Cost ⁴ (2017 PV\$)	Benefit to Cost Ratio ⁵
General Hardscape	Per Square Foot	0.44	Lower	-0.44	Infinite
Building Entrances	Each	372.54	Lower	-372.54	Infinite
Primary Entrances	Each	407.74	665.23	-407.74	0.61
Drive Up Windows	Each	380.43	392.00	-380.43	0.97
Vehicle Service Uncovered Fuel Dispenser	Each Pump Face	337.29	1,719.88	-337.29	0.20
ATM Machine	Each	1,244.42	288.00	-1,244.42	4.3
Outdoor Sales Frontage	Per linear foot	32.70	69.09	-32.70	0.47
Hardscape Ornamental Lighting	Per Square Foot	N/A	N/A	N/A	N/A
Building Facades	Per Square Foot	0.57	2.18	-0.57	0.26
Outdoor Sales Lots	Per Square Foot	1.61	2.08	-1.61	0.77
Vehicle Service Station Hardscape	Per Square Foot	1.06	1.86	-1.06	0.57
Vehicle Service Station Canopies	Per Square Foot	2.46	9.10	-2.46	0.27
Sales Canopies	Per Square Foot	0.69	7.44	-0.69	0.09
Non-sales Canopies	Per Square Foot	0.71	1.60	-0.71	0.45
Guard Stations	Per Square Foot	1.36	5.24	-1.36	0.26
Student Pick-up/Drop-off Zone	Per Square Foot	0.47	1.88	-.47	0.25
Outdoor Dining	Per Square Foot	0.21	0.93	-0.21	0.23
Special Security Lighting for Retail	Per Square Foot	0.05	0.20	-0.05	0.23

1. Relative to existing conditions. All cost values presented in 2017 dollars.
2. Present value of TDV cost savings equals TDV electricity savings plus TDV natural gas savings; $\Delta TDV\$ = \Delta TDV\$\text{E} + \Delta TDV\$\text{G}$.
3. Total incremental cost equals incremental construction cost (post adoption) plus present value of incremental maintenance cost; $\Delta C = \Delta CI_{PA} + \Delta CM$.
4. Negative values indicate the measure is cost-effective. Change in lifecycle cost equals cost premium minus TDV energy cost savings; $\Delta LCC = \Delta C - \Delta TDV\$$
5. The benefit to cost ratio is the TDV energy costs savings divided by the total incremental costs; $B/C = \Delta TDV\$ \div \Delta C$. The measure is cost effective if the B/C ratio is greater than 1.0.

APPENDIX B: DOCKETED COMMENTS LOG

CEC administered a public pre-rulemaking and rulemaking process to update the Title 24 Standards. The table below lists comments that were submitted to CEC through the pre-rulemaking and rulemaking process that are pertinent to this measure. The version of the CASE Report that is presented in Appendix A was developed taking comments that were submitted to CEC in response to the Scoping Workshops held April – August 2014 into account. See Section 3 of this report for a discussion of issues that stakeholders raised in comments that were submitted to CEC after the Statewide CASE Team submitted the CASE Report to CEC (comments submitted in response to the November 3, 2014 Scoping Workshop, the 45-Day Language, and the 15-Day Language).

Comment Letter #	Comment Letter ID	Link
Comments Submitted to CEC Response to Scoping Workshops Held April - August 2014		
1	Acuity Brands	Acuity Brands Comments - on 6-24-14 Staff Workshop Title 24 on Proposed Lighting Efficiency Measures for Residential and Nonreside 2014-07-23 TN-73476.pdf
2	Eaton Cooper Lighting	Eatons Cooper Lighting Business Comments on Staff Workshop on Proposed Lighting Efficiency Measure for Residential and Nonresiden 2014-07-25 TN-73483.pdf
3	Ecology Action	Ecology Action Comments on Proposed Title 24 2016 Code Language 2014-10-10 TN-73823.pdf
4	NEMA	NEMA Comments on Staff Workshop on Proposed Lighting Efficiency Measures for Residential and Nonresidential Buildings 2014-07-25 TN-73481.pdf
5	NRDC	Natural Resources defense Councils Comments on the Title 24 2016 Pre-Rulemaking Workshops 2014-08-07 TN-73569.pdf
Comments Submitted to CEC in Response to Scoping Workshops Held November 3, 2014		
6	CA Labor Management Cooperation Committee	CA State Labor Management Cooperation Committee - Thomas Enslow proposed amendments to Title 24 Part 1 Section 10-103-A 2015-01-08 TN-74265.pdf
7	City of Los Angeles, Dept. of Building and Safety	Behzad Eghtesady Recommended Changes 11-03-14 TN-73916.pdf
8	Eaton Cooper Lighting	Eatons Cooper Lighting Business Comments 2014-12-10 TN-74282 .pdf
9	Ecology Action	Ecology Action Comment letter 2014-10-31 TN-73988.pdf
10	NRDC	Natural Resources defense Council Comments on Draft Title 24 2016 Standards 2014-11-24 TN-74069.pdf
11	Toby Lewis	Toby Lewis Comments - T24 2016 Lighting Draft 2014-11-24 TN-74062.pdf
Comments Submitted to CEC in Response to 45-Day Language and 45-day Hearings Held March 2-3, 2015		
12	Acuity	Acuity Brands - C- English and T- Hernandez - Additional Comments on Title 24 2016 45-Day Proposed Standard 2015-03-29 TN-75567.pdf
13	CA Business Properties Association	California Business Properties Association - Matthew Hargrove Comment on Title 24 45-Day Language 2015-02-26 TN-75237.pdf

14	NRDC	Natural Resources defense Council Comments on the February 2015 45-Day Language 2015-03-30 TN-75557.pdf
15	Philips	Philips Keith Cook Comments on Title 24 45 Day Language 2015-03-17 TN-75418.pdf
Comments Submitted to CEC in Response to 15-Day Language		
16	RNM Engineering	RNM Engineering Inc-s Comments to Section 140 7 2015-06-09 TN-75946.pdf

APPENDIX C: REVISIONS TO COST-EFFECTIVENESS AND STATEWIDE IMPACTS CALCULATIONS COMPARED TO DRAFT VERSION OF CASE REPORT

The statewide calculations for impacts and cost-effectiveness that are included in the Draft version of the CASE Report are no longer directly related to the adopted 2016 Standards language presented by CEC because there were substantial revisions made to the proposed language before being released by CEC in the 45-Day Language and subsequently in the 15-Day Language.

As a result, the following full measure calculations (as provided in the Draft CASE Report) have been modified.

6.1 Draft CASE Report Energy Savings Estimates

Provided below is the full-measure rollup of the statewide energy impacts for this measure:

Table 4: *DRAFT CASE REPORT VERSION* Statewide energy impacts

	First Year Statewide Savings ¹			TDV Savings ²
	Electricity Savings ³ (GWh)	Demand Reduction (MW)	Natural Gas Savings (MMtherms)	TDV Electricity Cost Savings ⁴ (Million \$)
TOTAL	44.3	N/A	N/A	73.5

1. First year savings from all buildings built statewide during the first year the 2016 Standards are in effect.
2. First year TDV savings from all buildings built statewide during the first year the 2016 Standards are in effect.
3. Site electricity savings.
4. Calculated using CEC's 2016 TDV factors and methodology.

6.2 Draft CASE Report Cost-effectiveness Estimates

Provided below is the full-measure rollup of the Statewide cost-effectiveness calculation for this measure:

Table 5: *DRAFT CASE REPORT VERSION* Cost-effectiveness summary¹ – statewide weighted average across lighting zones for all measure line-items

Climate Zone	Units	Benefit: TDV Energy Cost Savings ² (2017 PV\$)	Cost: Total Incremental Cost ³ (2017 PV\$)	Change in Lifecycle Cost ⁴ (2017 PV\$)	Benefit to Cost Ratio ⁵
Outdoor Lighting LPA (Entire Measure)	Per Square Foot	0.41	0.11	-0.41	3.8

1. Relative to existing conditions. All cost values presented in 2017 dollars. “Hospital” building category exclude from cost and savings projections.
2. Present value of TDV cost savings equals TDV electricity savings plus TDV natural gas savings; $\Delta TDV\$ = \Delta TDV\$E + \Delta TDV\$G$.
3. Total incremental cost equals incremental construction cost (post adoption) plus present value of incremental maintenance cost; $\Delta C = \Delta CI_{PA} + \Delta CM$.
4. Negative values indicate the measure is cost-effective. Change in lifecycle cost equals cost premium minus TDV energy cost savings; $\Delta LCC = \Delta C - \Delta TDV\$$
5. The benefit to cost ratio is the TDV energy costs savings divided by the total incremental costs; $B/C = \Delta TDV\$ \div \Delta C$. The measure is cost-effective if the B/C ratio is greater than 1.0.

Given data regarding the new construction forecast for 2017, the Statewide CASE Team estimates that that lifecycle cost savings (over 15 years) of all buildings constructed during the first year the 2016 Standards are in effect will be \$73.5 million (DRAFT CASE REPORT PROJECTIONS).

6.3 Changes from the Draft Version to the Final Version

As discussed in Section 3, substantial portions of the Statewide CASE Team recommendations were not adopted by CEC into the 2016 Standards, and therefore the relationship of the draft estimates to the final estimates is unclear without understanding the adjustments included in the final estimates.

CEC wished to accommodate the new IES RP-20 document, and the Statewide CASE Team developed recommendations to include in Table 140.7-A, which roll back recommendations from the Draft CASE Report somewhat to ensure a compliance option with both Title 24 Standards and the most current design practice recommendations from the IES.

This change increases the allowances for lighting zones 2 and 3, but only for parking lots that are paved with concrete. This is a more expensive method of paving a parking lot than asphalt, and is typically not used, so the impact on the state construction results was set at 10% of the total hardscape construction square footage.

This change reduced the average wattage per square foot savings from 0.055 W/sf to 0.038 W/sf for the concrete areas. Rolled up for all the construction Statewide, this reduced the savings from 0.055 W/sf to 0.053 W/sf, which is approximately 4% for the General Hardscape portion of the measure.

Note that since this was a change in the design criteria, this does not reflect a reduction in the potential energy savings *had the new IES RP-20 lighting standards been implemented using incumbent light source technology*. In this circumstance, the Title 24 Standards allowances in Table 140.7-A would have to have been revised upwards from the 2013 levels to accommodate the new criteria, and the change to LED technology permitted the values in Table 140.7-A to

be reduced just not as much as would have been possible without the change in the RP-20 document.

Secondly, almost all of the line item recommendations in Table 140.7-B (Specific Applications allowances table) had been rejected by CEC in the adopted 2016 Standards. This eliminates a considerable portion of the measure, and is the source for almost all of the reductions in savings from the Draft CASE Report to this document.

These changes have reduced the statewide savings prediction by approximately 36%, from 44 GWh to 28 GWh. A cursory analysis of the individual measures indicates that approximately 96% of the reduction (15.7 GWh) is due to the removal of the recommended values in Table 140.7-B, and only 4.3% is due to the changes in Table 140.7-A.